

# Ductless Mini-Split Heat Pump Impact Evaluation

December 30, 2016

**Prepared for:**

The Electric and Gas Program Administrators of Massachusetts and Rhode Island  
Part of the Residential Evaluation Program Area

The Cadmus Group, Inc.

An Employee-Owned Company • [www.cadmusgroup.com](http://www.cadmusgroup.com)

This page left blank.

Prepared by:  
Dave Korn, PE, CEM  
John Walczyk, CEM  
Ari Jackson  
Andrew Machado, PE, CEM  
John Kongoletos, CEM  
Eric Pfann

The Cadmus Group, Inc.

This page left blank.

## Table of Contents

Executive Summary.....	1
Research Objectives .....	1
Sample Design.....	1
Findings.....	4
Analysis Notes.....	4
Operating Hours.....	5
Equivalent Full Load Hours .....	5
Savings .....	9
Cold Climate Performance .....	15
Discussion .....	20
Cooling .....	20
Heating.....	21
COP/SEER/HSPF .....	21
Savings Values.....	22
Controls and Zoning.....	23
Recommendations.....	23
Program .....	23
Future Studies.....	24
Introduction .....	26
Program and Evaluation.....	27
Research Objectives .....	27
Existing Research.....	28
Method .....	30
Sample Design .....	30
Engineering Background.....	32
Efficiency Metrics.....	32
Seasonal Efficiency Metrics.....	34
Energy .....	36
Airflow.....	37
Data Collection .....	38

Power .....	38
Fan Current .....	39
Airflow .....	40
Temperature and Relative Humidity .....	41
Heating Systems.....	43
Site Attributes .....	45
Analysis.....	46
Airflow.....	46
Weather Normalization .....	46
Climate During the Study .....	47
Manual J: Residential Load Calculation .....	49
Savings .....	50
Results.....	54
Load Shapes.....	54
Operating Hours .....	60
Equivalent Full Load Hours .....	61
Performance .....	73
Unit Efficiency COP .....	86
Cold Climate Performance .....	87
Multi-Head Performance .....	89
Performance Related to Installing Contractors .....	91
Heating System Interaction .....	93
Unit Sizing.....	95
Behavior Influence.....	101
Additional Findings .....	102
Filter Cleanliness .....	102
Outdoor Unit Placement.....	103
Indoor Unit Placement.....	107
Unit Controls.....	108
Staging of Alternative Heating Systems.....	109
Localized Heating .....	115

Non-Energy Benefits .....	115
Discussion.....	117
Cooling.....	117
Heating .....	118
COP/SEER/HSPF.....	118
Savings Values .....	119
Controls and Zoning .....	120
Airflow .....	120
Recommendations .....	122
Recommendations.....	122
Program .....	122
Future Studies .....	123
Appendix A: Measuring Airflow in DMSHPs.....	124
Appendix B: Baseline Memorandum Chart .....	142
Appendix C: TRM Memorandum, December 2, 2016.....	143
Appendix D: Example DMSHP Time Series Data .....	147

## Table of Figures

Figure ES-1. Locations of Sampled Residences .....	3
Figure ES-2. DMSHP EFLH vs. Season* .....	7
Figure ES-3. DMSHP Usage vs. Purchase Intent and Season .....	8
Figure ES-4. Average Heating COP vs. Outdoor Air Temperature for Cold-Climate and Non-Cold-Climate Systems—Winter 2015 .....	16
Figure ES-5. Average Heating COP vs. Outdoor Air Temperature for Cold-Climate and Non-Cold-Climate Systems—Winter 2016 .....	16
Figure ES-6. Operational Break Point Temperature of Heating with DMSHP, Winter 2016, All Units .....	18
Figure ES-7. Operational Break Point Temperature of Heating with DMSHP, Winter 2016, Cold Climate Units .....	19
Figure 1. DMSHP Outdoor Unit .....	26
Figure 2. DMSHP Indoor Unit .....	26
Figure 3. Locations of Sampled Residences .....	31
Figure 4. Indoor Unit Mass Flow .....	36
Figure 5. Power Metering Setup Installed on an Outdoor Unit .....	39
Figure 6. Current Transformers Installed on Fan Wires .....	40
Figure 7. Balometer .....	40
Figure 8. Outdoor Entering Air Temperature and Relative Humidity Sensor .....	42
Figure 9. Leaving Air Sensors on a DMSHP Head .....	42
Figure 10. Entering Air Sensors on a DMSHP Head .....	43
Figure 11. Boiler System Monitoring .....	44
Figure 12. Furnace System Monitoring .....	45
Figure 13. Cumulative Distribution of Winter Hours Versus Temperature Bin .....	48
Figure 14. Cumulative Distribution of Summer Hours Versus Temperature Bin .....	49
Figure 15. Winter 2015 Average Power Consumption vs. Time of Day, N=99 .....	54
Figure 16. Summer 2015 Average Power Consumption vs. Time of Day, N=115 .....	55
Figure 17. Winter 2016 Average Power Consumption vs. Time of Day, N=60 .....	55
Figure 18. Winter 2015 Average Power Consumption While Heating vs. Outdoor Air Temperature .....	56
Figure 19. Summer 2015 Average Power Consumption While Cooling vs. Outdoor Air Temperature, N=114 .....	57

Figure 20. Winter 2016 Average Power Consumption While Heating vs. Outdoor Air Temperature, N=57	57
Figure 21. Winter 2015 Average Power Consumption vs. Time, N=99	58
Figure 22. Winter 2015 Average Power Consumption vs. Time, N=51, Cold Climate Units	58
Figure 23. Summer 2015 Average Power Consumption vs. Time, N=115	59
Figure 24. Winter 2016 Average Power Consumption vs. Time, N=60	59
Figure 25. Winter 2016 Average Power Consumption vs. Time, N=35, Cold Climate Units	60
Figure 26. DMSHP EFLH vs. Season	62
Figure 27. DMSHP EFLH vs. Season, Cold Climate Units	63
Figure 28. DMSHP EFLH vs. Purchase Intent and Season	64
Figure 29. DMSHP EFLH vs. Purchase Intent and Season, Cold Climate Units	64
Figure 30. Measured Seasonal Efficiencies	74
Figure 31. Measured Seasonal Efficiencies, Cold Climate Units	74
Figure 32. Winter 2015 Measured HSPF vs. EFLH, N=86	75
Figure 33. Summer 2015 Measured SEER vs. EFLH, N=113	75
Figure 34. Winter 2016 Measured HSPF vs. EFLH, N=57	76
Figure 35. Winter 2015 HSPF vs. System Configuration, N=87	77
Figure 36. Summer 2015 SEER vs. System Configuration, N=114	77
Figure 37. Winter 2016 HSPF vs. System Configuration, N=57	78
Figure 38. Winter 2015 HSPF vs. System Configuration and Usage, N=86	78
Figure 39. Summer 2015 SEER vs. System Configuration and Usage, N=113	79
Figure 40. Winter 2016 HSPF vs. System Configuration and Usage, N=57	79
Figure 41. Seasonal Efficiencies vs. Purchase Intent	80
Figure 42. Seasonal Efficiencies vs. Purchase Intent, Cold Climate Units	80
Figure 43. Winter 2015 Maximum Observed Capacity vs. Rated Capacity, N=98	81
Figure 44. Summer 2015 Maximum Observed Capacity vs. Rated Capacity, N=114	82
Figure 45. Winter 2016 Maximum Observed Capacity vs. Rated Capacity, N=60	82
Figure 46. Winter 2015 Rated HSPF vs. Rated Capacity, N=98	83
Figure 47. Summer 2015 Rated SEER vs. Rated Capacity, N=114	83
Figure 48. Winter 2016 Rated HSPF vs. Rated Capacity, N=60	84
Figure 49. Winter 2015 Observed HSPF vs. Rated HSPF, N=86	85

Figure 50. Summer 2015 Observed SEER vs. Rated SEER, N=113.....	85
Figure 51. Winter 2015 Observed HSPF vs. Rated HSPF, N=57 .....	85
Figure 52. Winter 2015 Average COP vs. Outdoor Air Temperature, N=87 .....	86
Figure 53. Summer 2015 Average COP vs. Outdoor Air Temperature, N=114 .....	87
Figure 54. Average Heating COP vs. Outdoor Air Temperature for Cold-Climate and Non-Cold-Climate Systems – Winter 2015 .....	88
Figure 55. Average Heating COP vs. Outdoor Air Temperature for Cold-Climate and Non-Cold-Climate Systems – Winter 2016 .....	89
Figure 56. Average Heating COP vs. Outdoor Air Temperature for One-, Two-, and Three-Head Systems .....	90
Figure 57. Average Heating COP vs. Outdoor Air Temperature for One-, Two-, and Three-Head Non-Cold-Climate Systems .....	91
Figure 58. Average Winter 2015 COP vs. Outdoor Air Temperature for Installing Contractor .....	92
Figure 59. Average Winter 2016 COP vs. Outdoor Air Temperature for Installing Contractor .....	92
Figure 60. Site M0193, Heating System Interaction .....	93
Figure 61. Site M0198, Heating System Interaction .....	94
Figure 62. Site M0011, Heating System Interaction .....	94
Figure 63. Calculated Thermal Loads of Spaces Served by DMSHPs, N=141 .....	96
Figure 64. Ratio of DMSHP Rated Capacity to Calculated Thermal Load of Spaces Served, N=140 .....	96
Figure 65. Ratio of DMSHP Rated Capacity to Floor Area of Spaces Served .....	97
Figure 66. Heating and Cooling Rated Capacities Normalized by Calculated Design Loads .....	98
Figure 67. Relationship Between Design Cooling, Design Heating, and Rated Capacities as a Function of Floor Area Served.....	99
Figure 68. Normalized HVAC System Capacities .....	100
Figure 69. Behavior Influence Postcard .....	101
Figure 70. DMSHP Usage for Behavior Influence Postcard Recipients .....	102
Figure 71. Filter Maintenance .....	103
Figure 72. Clearances Underneath Outdoor Units .....	104
Figure 73. Clearances Around Outdoor Units .....	105
Figure 74. Maintaining Clearances in Wintertime .....	106
Figure 75. DMSHPs in Windy Environment.....	107
Figure 76. Vertical Clearance on Indoor Unit.....	108

Figure 77. Operation of DMSHP Remote Control .....	109
Figure 78. Operational Break Point Temperature of Heating with DMSHP, Winter 2016, All Units .....	112
Figure 79. Operational Break Point Temperature of Heating with DMSHP, Winter 2016, Cold Climate Units .....	113
Figure 80. Operational Break Point Temperature of Heating with DMSHP, Assumed HSPF of 13.....	114
Figure 81. LBNL-5983E Figure 14 .....	126
Figure 82. LBNL-5983E Figure 14, Adapted .....	127
Figure 83. Inlet vs. Outlet Flow .....	127
Figure 84. Proximity Sensor Arrangement (NREL Image 18330) .....	128
Figure 85. Optical Tachometer Data Collection .....	130
Figure 86. Basis of Experimental Powered Flow Hood Setup (Figure 4 from Williamson 2015).....	132
Figure 87. Convergence Nozzle: ASHRAE 51-1999 Figure 5 (Excerpt) .....	133
Figure 88. Powered Flow Hood Testing Setup .....	133
Figure 89. Powered Flow Hood Testing Setup .....	134
Figure 90. Extended Testing Site B: Large-Unit Powered Flow Hood .....	135
Figure 91. Indoor Head Prior to Testing.....	136
Figure 92. Non-Powered Flow Hood (Balometer) Setup .....	137
Figure 93. Non-Powered Flow Hood (Balometer) Setup .....	138
Figure 94. Vane Position: Powered Flow Hood.....	139
Figure 95. Coil State: Wet vs. Dry .....	140
Figure 96. Powered Flow Hood Flow Restriction.....	141

## Table of Tables

Table ES-1. Program Populations Strata .....	2
Table ES-2. Average Nameplate Ratings for Outdoor Units .....	4
Table ES-3. Observed Run Hours for Nominal Heating and Cooling Seasons* .....	5
Table ES-4. Average EFLH.....	6
Table ES-5. Energy Savings by Season and Baseline System.....	9
Table ES-6. Demand Savings by Season and Baseline System .....	10
Table ES-7. Energy Savings, Each Baseline Applied to All Sites, Top 25%.....	11
Table ES-8. Peak Demand Savings, Baseline Applied Based on Survey Responses and Existing Systems, Top 25%.....	12
Table ES-9. Weighted Average Savings, Fuel Switching.....	13
Table ES-10. Weighted Average Savings, Non-Fuel Switching.....	14
Table 1. Program Populations.....	27
Table 2. Comparison of Previous Research.....	29
Table 3. Program Populations Strata .....	31
Table 4. Average Ratings for Measured Outdoor Units.....	32
Table 5. Observed Weather During the Study .....	47
Table 6. Savings Calculation Methodology for Alternative Heating/Cooling Equipment.....	53
Table 7. CFs for Peak Winter and Summer Periods .....	60
Table 8. Observed Run Hours for Nominal Heating and Cooling Seasons* .....	61
Table 9. Average EFLH.....	62
Table 10. Energy Savings, Each Baseline Applied to All Sites.....	65
Table 11. Peak Demand Savings, Each Baseline Applied to All Sites .....	66
Table 12. Energy Savings, Baseline Applied Based on Survey Responses and Existing Systems .....	67
Table 13. Peak Demand Savings, Baseline Applied Based on Survey Responses and Existing Systems.....	67
Table 14. Energy Savings, Each Baseline Applied to All Sites, Top 25%.....	69
Table 15. Peak Demand Savings, Each Baseline Applied to All Sites, Top 25%.....	69
Table 16. Weighted Average Savings, Fuel Switching.....	71
Table 17. Weighted Average Savings, Non-Fuel Switching.....	72
Table 18. Cold-Climate Unit Listing.....	87

Table 19. Heating and Cooling Capacities, N=137 ..... 98  
Table 20. Savings for Residential DMSHPs..... 144  
Table 21. Heating and Cooling Equivalent Full Load Hours for DMSHP..... 144  
Table 22. Recommended DMSHP Baselines ..... 145

## Executive Summary

The Massachusetts and Rhode Island Program Administrators (PAs) commissioned Cadmus and its subcontractors, Navigant and Tetra Tech, (the evaluation team) to conduct an *in situ* evaluation of ductless mini-split heat pumps (DMSHPs). The evaluation team initially planned to study 132 Massachusetts homes that participated in the COOL SMART Program. The PAs, however, extended the scope of work to include 20 Rhode Island homes that participated in the High Efficiency Heating and Cooling Rebate Program.

### Research Objectives

The evaluation sought to address many utility and consumer questions about DMSHPs, focusing on power and energy consumption, heat output, efficiency, and interactions with existing HVAC equipment. The specific research questions follow:

- How much energy is being saved with the average installation of a DMSHP through the programs?
- What are the relevant baseline equipment configurations and associated energy consumptions and load shapes?
- During each season, when are DMSHPs operating, how much energy are they consuming, and how much heating and cooling are they providing?
- How does DMSHP performance correlate with rated capacity, rated efficiency, and ambient conditions?
- How do cold-climate DMSHPs and standard unit performances compare?
- How does unit sizing affect heating performance?
- How do DMSHPs interact with central heating systems?
- What factors limit the use and performance of DMSHPs?
- Are program contractors sizing DMSHPs properly?

### Sample Design

The evaluation team used the following participant parameters to stratify program populations into key groups:

- Cold-climate or non-cold-climate unit sites<sup>1</sup>

---

<sup>1</sup> DMSHP manufacturers offer units that claim high performance at very cold (below 0 °F) outdoor ambient temperatures. The evaluation team used the Efficiency Vermont Technical Reference Manual that was current during the study's planning phase to identify cold-climate units. As the report shows, units not characterized as cold climate can operate at 0 °F, although there are not the same claims of high performance at very cold temperatures.

- Single- or multi-head unit sites<sup>2</sup>
- Installed by the largest vendor or by all other contractors

In collaboration with evaluation stakeholders, the team identified these parameters at the study’s outset, and then used them to inform sample targets during the participant recruiting process. Initially, the team designed the sampling based on Massachusetts’ 2012–2013 program population, but later expanded this to include Massachusetts’ 2014 program population and Rhode Island’s 2013 program population. Massachusetts participants from the 2014 program year did not receive online surveys (i.e., the study added them after the surveys had been completed). In 2015, a separate Rhode Island survey examined the similarity between Massachusetts and Rhode Island populations. This sought to justify the application of the study results to the Rhode Island population. Sample sizes were determined by the PAs and the evaluation team with a target of 90/20 confidence and precision for each stratum, assuming a coefficient of variation of 0.7. Table ES-1 details these program populations, as measured by participant surveys, program tracking data, and collected evaluation data.

**Table ES-1. Program Populations Strata**

Sites	MA 2012–2013 Program Participant Share	MA 2014 Program Participant Share	RI 2013 Program Participant Share	Study Sample Participant Share	Study Sample Participant Planned Target	Study Sample Participant Count
Cold-climate unit sites <sup>(1)</sup>	41%	15%	22%	51%	34	78
Non-cold-climate unit sites	59%	85%	78%	49%	34	74
Single-head unit sites	48%	Unknown <sup>(2)</sup>	73%	50%	34	107
Multiple-head unit sites	52%	Unknown	27%	50%	34	45
Installed by largest (MA) vendor sites	13%	7%	0%	28%	34	43
Installed by all other vendor sites	87%	93%	100%	72%	34	109
<b>Population Total</b>	<b>3,229</b>	<b>1,055</b>	<b>507</b>	<b>n/a</b>	<b>n/a</b>	<b>n/a</b>
<b>Sample Total<sup>(3)</sup></b>	<b>112</b>	<b>20</b>	<b>20</b>	<b>n/a</b>	<b>135</b>	<b>152</b>

<sup>(1)</sup>All cold-climate unit sites contained single-head units only.

<sup>(2)</sup>Because 2014 Massachusetts participants were not surveyed, these data were not readily available for the total program population.

<sup>(3)</sup>Many categories overlap, producing a strata total greater than the overall totals.

<sup>2</sup> A DMSHP consist of an outdoor unit that serves one or more indoor heads that deliver heating and cooling. Single-head units have one such head; multi-head units have more than one head.

Figure ES-1 shows the locations of studied homes and systems in Massachusetts and Rhode Island.

**Figure ES-1. Locations of Sampled Residences**



Table ES-2 shows the average nameplate attributes of DMSHPs metered at the 152 sites. Units averaged about 1.3 tons and just over 20 SEER and 10 HSPF.

During the pilot phase in summer 2014, the team initially installed metering equipment at 30 sites. The team then installed metering equipment at 102 sites during fall 2014 and at the remaining 20 Rhode Island sites in January 2015. During spring 2015, three homeowners sold their homes, and the team removed meters prior to closing. Initially, the study planned to remove all meters in fall 2015, but, as winter 2014/2015 experienced an unusually large amount of snowfall that buried many outdoor units, the study sponsors decided a portion of meters should be left in for winter 2015/2016. In fall 2015, roughly 45 Massachusetts sites were removed; the remaining 85 were removed in spring 2016. At the client's request, the team removed all meters on Rhode Island sites in late fall 2015.

**Table ES-2. Average Nameplate Ratings for Outdoor Units**

System Category	Sample Size	Average Rated Cooling Capacity (nominal cooling at 95°F) <sup>(1)</sup> [Btu/h]	Average Rated Heating Capacity at 47°F [Btu/h]	Average Rated Heating Capacity at 17°F [Btu/h]	Average Rated EER <sup>(2)</sup> [Btu/Wh]	Average Rated SEER <sup>(3)</sup> [Btu/Wh]	Average Rated HSPF <sup>(4)</sup> [Btu/Wh]
All	152	16,435	19,491	11,426	13.2	20.6	10.3
Cold Climate Units (CC)	78	14,680	17,985	10,409	13.8	22.3	11.0
Non CC, multi	45	20,444	23,484	13,682	12.4	17.9	9.2
Non CC single	29	14,414	17,268	10,632	12.7	20.3	10.2

<sup>(1)</sup>Capacity is measured per Air-Conditioning, Heating, and Refrigeration Institute (AHRI) guidelines for various outdoor temperatures: 95 °F, 47 °F, and 17 °F.

<sup>(2)</sup>Energy Efficiency Ratio (EER) equals the cooling heating provided (in BTUs), divided by the power consumption in watts—essentially the coefficient of performance (COP) times 3.412. It is tested at an outdoor temperature of 95°F and an indoor temperature of 80°F.

<sup>(3)</sup>Seasonal Energy Efficiency Ratio (SEER) equals the cooling heating provided (in BTUs), divided by the power consumption in watts—essentially the coefficient of performance (COP) times 3.412. It is tested at outside air temperatures ranging from 67°F to 95°F, with the lower temperatures weighted more heavily, and is meant to represent seasonal performance. The indoor temperature is set to 80°F.

<sup>(4)</sup>Heating Seasonal Performance Factor (HSPF) equals the heating provided (in BTUs), divided by the power consumption in watts—essentially the COP times 3.412. It is tested at outside air temperatures ranging from 17°F to 62°F, and represents seasonal performance. The indoor temperature is set to 70°F.

## Findings

### Analysis Notes

This report uses many box and whisker plot graphs. The boxes show a range of data from the 25<sup>th</sup> to the 75<sup>th</sup> percentile, otherwise known as the 1<sup>st</sup> and 3<sup>rd</sup> quartiles. The middle line in each box is the median data point, or the 50<sup>th</sup> percentile. Half of the data lie above this line and half fall below. The lines extending above and below the boxes represent the upper 25% and lowest 25% of the data, respectively.

The evaluation team based all energy-use calculations on “site” energy, meaning the calculations did not include line losses and energy-generation losses. Compared energy costs—energy costs at the site or meter—represent the amount paid by the consumer.

In all, the study metered 152 homes. Of these, nearly all power meter files were sufficiently complete for a basic analysis. This study’s analyses were based on continual logging of BTUs and COP. To meter this effectively, meter sets had to concurrently log total power, fan amperage, supply temperature and relative humidity (RH), and return temperature and RH. If these parameters were not metered for a period, BTUs could not be calculated for that period. Consequently, sample sizes (n) shown in the graphs were lower than 152. Similarly, 85 sites metered for winter 2015/2016 resulted in sample sizes lower

than 85 for the second consecutive winter. Nevertheless, as this study represents the largest DMSHP study completed to date, the net sample sizes provide a broad and detailed view of DMSHP operations.

We present results for two winters: 2015 where near historically deep snowfalls buried many units for up to 1 month and 2016 which was warmer and had little snow. Because the units were buried and not fully functional for 2015 and because this is not likely to re-occur, we recommend using the winter 2016 results. Both winter’s results are shown throughout the report.

**Operating Hours**

Table ES-3 shows simple run-time hours for metered DMSHPs, with a unit logged as running if its power draw exceeded a threshold standby power of 60W. Looking at the nominal heating season, the average unit ran about 27% of the time (793 hours) during 2015, and about 24% of the time (703 hours) during 2016. Note that an operating hour differs from a full-load hour in that an operating hour simply means that the unit remained on at some capacity, whereas a full-load hour indicates the unit ran at full capacity.

**Table ES-3. Observed Run Hours for Nominal Heating and Cooling Seasons\***

Season	Example Period of Operation	Season (Days)	Season (Hours)	Mean Percent Runtime	Operation Hours
Winter 2015	December-March	121	2,904	27.3%	793
Summer 2015	June-August	92	2,208	19.4%	428
Winter 2016	December-March	121	2,904	24.2%	703

\*These observed run times address periods where the unit drew more than 60W (non-standby).

**Equivalent Full Load Hours**

Table ES-4 shows the average equivalent full load hours (EFLH) across all units for two heating seasons and one cooling season studied, comparing these values with those prescribed in the Massachusetts and Rhode Island Technical Reference Manuals (TRMs) and the averages of the top 25% of sites in the study. Values for the two heating seasons (442 and 451) remained consistent with the value (447) presented in this study’s October 12, 2015, Heating Memorandum, but differed from the current 1,200 TRM value. The summer value (218) was roughly 15% lower than the value shown in the Cooling Memorandum<sup>3</sup> (distributed in February 2016 and finalized (259) on May 2, 2016), and differed from the 360 TRM value. This reduction in average cooling EFLH resulted from this report’s use of site-specific, typical meteorological year (TMY) data, in contrast to statewide TMY data used in the memo, as well as the evaluation team filtering out energy usage that consumed power but did not provide cooling. The right most column of Table ES-4 shows the average EFLH of the units in the top 25<sup>th</sup> percentile. These values are at or above the TRM values.

<sup>3</sup> Cadmus Group. *Ductless Mini-Split Heat Pump Draft Cooling Season Results*. January 22, 2016.

**Table ES-4. Average EFLH**


Season	2013–2015 MA TRM	2014 RI TRM	Average Study EFLH	Average of Top 25% of Measured EFLH
Winter 2015	1,200	1,200	442	1,275
Summer 2015	360	360	218	499
Winter 2016	1,200	1,200	451	1,117

This study produced EFLH lower than values indicated in the applicable Massachusetts and Rhode Island TRMs for conventional heating and cooling systems (e.g., gas-fired furnaces, central air conditioning).

These variances occurred for the following reasons:

- Not all units were used routinely for each season. Many units were lightly used (or not used at all) for heating or cooling. Figure ES-2 illustrates this behavior, with the bottom of the box indicating the 25<sup>th</sup> percentile of the hour range at or very near zero for winter 2015.
- Many units remained off during the summer’s cooler periods.
- Some units in heating mode operated coincidentally with primary systems (many of which were fossil fuel-based).
- Systems were sized larger than the cooling needs of the immediate spaces they served, as discussed later in the report.
- The units operated at some level for 19% to 27% of the time for the two winter and one summer season, and were off or on standby for much of the time (Table ES-2). Comparing the EFLH to the total operating hours one can see that the units operate on average at about 56% and 64% of capacity for winter 2015 and winter 2016 and at about 51% of capacity for the summer.
- TRM sources for legacy EFLH values could be inappropriate for DMSHPs. The cooling EFLH value (360) was based on a 2009 study of central air conditioners. The heating EFLH value (1,200) was sourced from a “Massachusetts Common Assumption” also used for other types of heating equipment. Both legacy values appear high relative to this study’s findings, supporting the theory that homeowners used DMSHPs differently than conventional heating or cooling equipment.
- The average ELFH of the top 25<sup>th</sup> percentile of units have values close to or above the TRM values.

Figure ES-2. DMSHP EFLH vs. Season\*

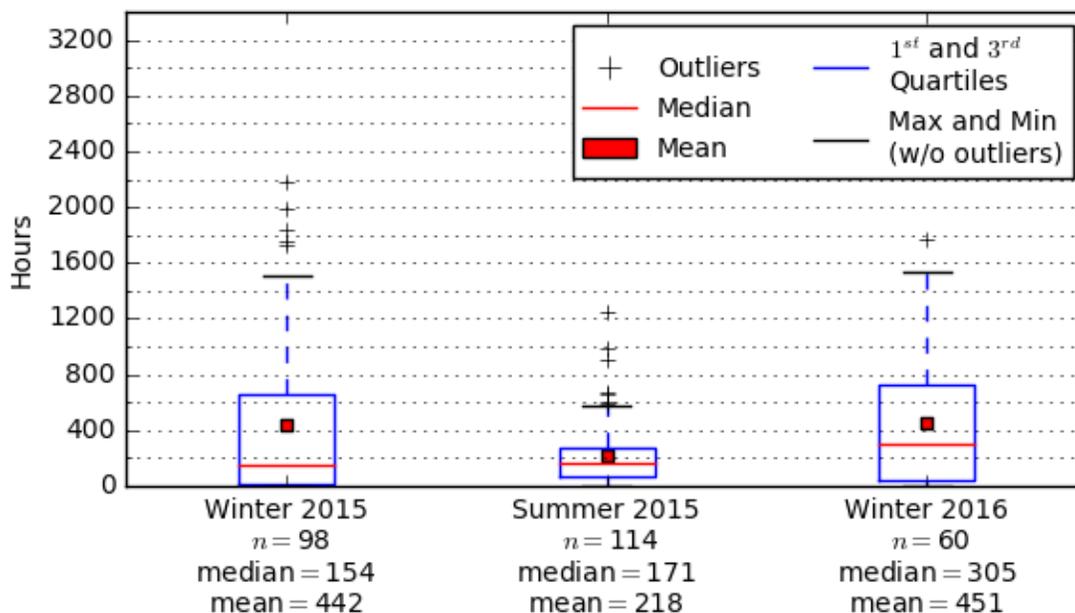

\*The blue boxes delineate first and third data quartiles. The lines (whiskers) indicate upper and lower quartiles. The plus symbols represent outliers (points greater than or less than 1.5\*(Inter Quartile Range), where the IQR equals the distance between the first and third quartiles).

Figure ES-3 more closely examines this variation, showing that units bought for “both heating and cooling” were used much more for heating than units where users identified their purchases as for “cooling only.” Winter 2016 was a milder than winter 2015, and units operated more efficiently during the former season, resulting in lower EFLH for users intending “both heating and cooling.” During winter 2016, units purchased for “cooling only” saw some heating usage.

Figure ES-3. DMSHP Usage vs. Purchase Intent and Season

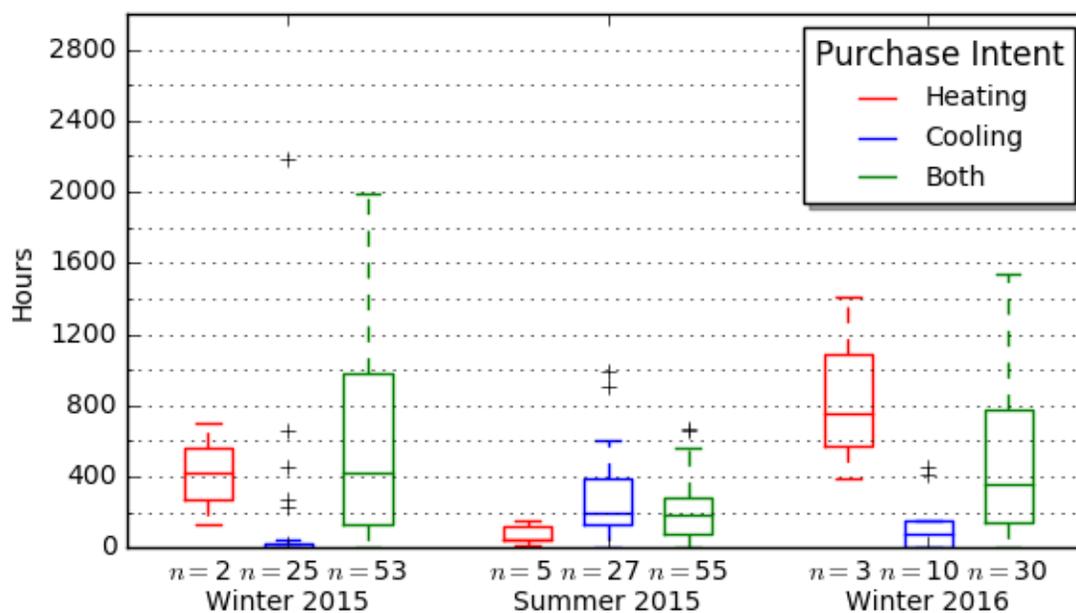


Table ES-5 shows average savings per DMSHP by season and baseline system. As the evaluation team expected, homes heated by electric resistance realized the highest savings; the lowest savings were for a DMSHP (HSPF = 8.2). Three columns present energy use and savings:

- Electricity consumed by the DMSHP
- Energy saved by heat provided by the DMSHP
- Net energy savings after subtracting DMSHP electric consumption

Credit was not taken for the reduction of energy used by a conventional furnace fan or boiler pump. This assumption is conservative because there is likely some reduction in fan and pump use, however, without a pre post study of DMSHP use it is difficult to discern the reduction. On average, a standard boiler pump uses about 120 kWh per year<sup>4</sup> and a fan uses about 440 kWh<sup>5</sup> per year for heating. Where a DMSHP can be used as the primary source of heating, this electricity use could be substantially reduced, increasing savings and decreasing DMSHP net electricity use.

<sup>4</sup> Forthcoming Cadmus boiler pump study for National Grid. 2016.

<sup>5</sup> Air-Conditioning, Heating & Refrigeration Institute (AHRI) average = 365W/ 1,000 CFM. At 1,200 CFM and 1,000 run-time hours, this is 438 kWh.

## Savings

For electric savings, the study used actual DMSHP performance, decrementing the baseline unit's efficiency from its nameplate rating by the same proportion that the efficient unit's performance differed from its rating. Cooling savings increased with lower efficiency baselines. Savings calculations relative to a central air conditioner baseline included a 15% duct loss,<sup>6</sup> decreasing the central unit's net efficiency. Table ES-6 shows demand savings.

**Table ES-5. Energy Savings by Season and Baseline System**

Season	Baseline System	Sample Size	Electric Usage of DMSHP [kWh]	Baseline Energy Reduction	Net Energy Savings	Precision at 90% Confidence [%]
Winter 2015	90% AFUE Furnace <sup>(1)</sup>	98	683	4.87 MMBtu	2.54 MMBtu	37
	85% AFUE Furnace <sup>(2)</sup>		683	5.16 MMBtu	2.83 MMBtu	36
	82% AFUE Boiler		683	4.54 MMBtu	2.21 MMBtu	39
	HSPF 7.7 DMSHP		683	907 kWh	224 kWh	21
	HSPF 8.2 DMSHP		683	851 kWh	168 kWh	21
	Electric Resistance		683	1,092 kWh	409 kWh	48
Summer 2015	EER 9.8 Window AC	114	159	213 kWh	54 kWh	15
	SEER 13.0 Central AC		159	288 kWh	129 kWh	14
	SEER 13.0 DMSHP		159	245 kWh	86 kWh	14
	SEER 14.5 DMSHP		159	220 kWh	61 kWh	15
Winter 2016	90% AFUE Furnace	60	763	6.9 MMBtu	4.3 MMBtu	37
	85% AFUE Furnace		763	7.31 MMBtu	4.7 MMBtu	36
	82% AFUE Boiler		763	6.44 MMBtu	3.83 MMBtu	37
	HSPF 7.7 DMSHP		763	989 kWh	226 kWh	22
	HSPF 8.2 DMSHP		763	929 kWh	166 kWh	23
	Electric Resistance		763	1,547 kWh	784 kWh	42

<sup>(1)</sup> Duct losses assumed at 15%.

<sup>(2)</sup> Baseline efficiency prescribed by relevant Massachusetts (2013-2015) and Rhode Island (2015) TRMs in force when the study began.

<sup>6</sup> *Massachusetts Technical Reference Manual, 2013–2015 Program Years, HVAC-Duct Sealing, assumed baseline efficiency.*

Table ES-6. Demand Savings by Season and Baseline System

Season	Baseline System	Sample Size	Electric Usage of DMSHP [kW]	Baseline Power Reduction [kW]	Average Peak Period Demand Savings [kW]	Precision at 90% Confidence [%]
Winter 2015	90% AFUE Furnace	98	0.21	0	-0.21	33
	85% AFUE Furnace		0.21	0	-0.21	33
	82% AFUE Boiler		0.21	0	-0.21	33
	HSPF 7.7 DMSHP		0.21	0.28	0.07	22
	HSPF 8.2 DMSHP		0.21	0.26	0.05	22
	Electric Resistance		0.21	0.33	0.12	43
Summer 2015	EER 9.8 Window AC	114	0.11	0.15	0.04	16
	SEER 13.0 Central AC		0.11	0.20	0.09	15
	SEER 13.0 DMSHP		0.11	0.05	0.06	15
	SEER 14.5 DMSHP		0.11	0.07	0.04	15
Winter 2016	90% AFUE Furnace	60	0.25	0	-0.25	34
	85% AFUE Furnace		0.25	0	-0.25	34
	82% AFUE Boiler		0.25	0	-0.25	34
	HSPF 7.7 DMSHP		0.25	0.33	0.08	24
	HSPF 8.2 DMSHP		0.25	0.31	0.06	25
	Electric Resistance		0.25	0.58	0.33	38

To examine the practical potential savings achievable by DMSHPs used more frequently, the evaluation team took sites in the top 25%, based on savings. Table ES-7 and Table ES-8 show savings for this subpopulation. Usage and savings were much higher than the mean, as one would expect mathematically. In practical terms, these were savings expected upon removing units lightly used or not used from the population.

**Table ES-7. Energy Savings, Each Baseline Applied to All Sites, Top 25%**

Season	Baseline System	Sample Size	Electric Usage of DMSHP [kWh]	Baseline Energy Reduction	Average Energy Savings	Precision at 90% Confidence [%]
Winter 2015	90% AFUE Furnace	25	1,414	14.7 MMBtu	9.84 MMBtu	22
	85% AFUE Furnace		1,414	15.5 MMBtu	10.70 MMBtu	22
	82% AFUE Boiler		1,414	13.1 MMBtu	8.86 MMBtu	22
	HSPF 7.7 DMSHP		1,894	2,536 kWh	642 kWh	10
	HSPF 8.2 DMSHP		1,894	2,382 kWh	488 kWh	11
	Electric Resistance		1,414	3,287 kWh	1,873 kWh	24
Summer 2015	EER 9.8 Window AC	29	358	484 kWh	126 kWh	12
	SEER 13.0 Central AC		371	663 kWh	292 kWh	11
	SEER 13.0 DMSHP		363	556 kWh	193 kWh	12
	SEER 14.5 DMSHP		332	468 kWh	136 kWh	14
Winter 2016	90% AFUE Furnace	15	1,566	18.68 MMBtu	13.34 MMBtu	30
	85% AFUE Furnace		1,566	19.78 MMBtu	14.44 MMBtu	30
	82% AFUE Boiler		1,566	17.43 MMBtu	12.09 MMBtu	31
	HSPF 7.7 DMSHP		1,862	2,433 kWh	571 kWh	13
	HSPF 8.2 DMSHP		1,761	2,184 kWh	423 kWh	15
	Electric Resistance		1,566	4,188	2,622 kWh	33

Similarly, Table ES-8 shows demand savings for the top 25% of sites.

Table ES-8. Peak Demand Savings, Baseline Applied Based on Survey Responses and Existing Systems, Top 25%

Season	Baseline System	Sample Size	Electric Usage of DMSHP [kW]	Baseline Power Reduction [kW]	Average Peak Period Demand Savings [kW]	Precision at 90% Confidence [%]
Winter 2015	90% AFUE Furnace	25	0.47	0	-0.47	18
	85% AFUE Furnace		0.47	0	-0.47	18
	82% AFUE Boiler		0.47	0	-0.47	18
	HSPF 7.7 DMSHP		0.62	0.82	0.20	13
	HSPF 8.2 DMSHP		0.56	0.70	0.14	14
	Electric Resistance		0.47	1.02	0.55	19
Summer 2015	EER 9.8 Window AC	29	0.24	0.33	0.09	13
	SEER 13.0 Central AC		0.25	0.45	0.20	11
	SEER 13.0 DMSHP		0.23	0.36	0.13	12
	SEER 14.5 DMSHP		0.22	0.31	0.09	13
Winter 2016	90% AFUE Furnace	15	0.54	0	-0.54	25
	85% AFUE Furnace		0.54	0	-0.54	25
	82% AFUE Boiler		0.54	0	-0.54	25
	HSPF 7.7 DMSHP		0.61	0.80	0.19	12
	HSPF 8.2 DMSHP		0.61	0.76	0.15	15
	Electric Resistance		0.54	1.64	1.1	26

Using baseline weighting from the previously published Baseline Memorandum, the evaluation team calculated average weighted savings for each of the three studied seasons, both for a single and specific baseline, as shown in Table ES-9. The terms “Single Baseline” and “Specific Baseline” differentiate the methodologies used in calculating savings; the former averages DMSHP usage across all participants and applies various baselines to the result, and the latter calculates savings using survey responses indicating participant specific baselines. Generally, winter 2016, with data unaffected by the large snowfalls of 2015, realized higher savings. Specific baselines showed savings similar to, or somewhat higher than, single baselines, but at poorer (higher) precisions.

**Table ES-9. Weighted Average Savings, Fuel Switching**

Fuel Switching					Single Baseline						Specific Baseline					
Season	Baseline System	Base Eff.	Efficiency Metric	Savings Units	n	Mean Savings	Mean Savings [kWh]	Population with Baseline [%]	Expected Baseline Savings [kWh]	Precision [%]	Sample Size	Mean Savings	Mean Savings [kWh]	Pop. with Baseline [%]	Expected Baseline Savings [kWh]	Precision [%]
Winter 2015	Furnace	0.85	AFUE	MMBtu	98	2.83	829	13%	108	36	10	1.62	475	13%	62	109
	Boiler	0.82	AFUE	MMBtu		2.21	648	35%	227	39	27	2.83	829	35%	291	68
	ER	1	COP	kWh		409	409	4%	16	48	3	398	398	4%	15	334
	DHP	7.7	HSPF	kWh		224	224	48%	108	21	37	163	163	48%	78	41
	Weighted Total							100%	458	31				100%	446	71
Summer 2015	Window AC	9.8	EER	kWh	114	54	54	17%	9	15	9	93	93	17%	16	33
	CAC	13	SEER	kWh		129	129	13%	17	14	7	95	95	13%	12	50
	DHP	13	SEER	kWh		86	86	70%	61	14	38	103	103	70%	72	26
	Weighted Total							100%	86	14				100%	100	30
Winter 2016	Furnace	0.85	AFUE	MMBtu	60	4.70	1378	16%	218	36	6	3.05	894	16%	141	103
	Boiler	0.82	AFUE	MMBtu		3.83	1123	37%	414	37	14	6.17	1808	37%	666	82
	ER	1	COP	kWh		784	784	5%	41	42	2	1778	1778	5%	94	35
	DHP	7.7	HSPF	kWh		226	226	42%	95	22	16	176	176	42%	74	55
	Weighted Total							100%	768	31				100%	975	71

Table ES-10 shows non-fuel switching savings that are lower than fuel switching savings because baseline DMSHP savings are lower than fuel heating savings.

**Table ES-10. Weighted Average Savings, Non-Fuel Switching**

Season	Non Fuel Switching				Single baseline						Specific baseline					
	Baseline System	Base Eff.	Efficiency Metric	Savings Units	n	Mean Savings	Mean Savings [kWh]	Population with Baseline [%]	Expected Baseline Savings [kWh]	Precision [%]	Sample Size	Mean Savings	Mean Savings [kWh]	Pop. with Baseline [%]	Expected Baseline Savings [kWh]	Precision [%]
Winter 2015	ER	1	COP	kWh	98	409	409	8%	31	48	3	398	398	8%	30	334
	DHP	7.7	HSPF	kWh		224	224	93%	207	21	37	163	163	93%	150	41
	Weighted Total							100%	238	23					100%	180
Summer 2015	Window AC	9.8	EER	kWh	114	54	54	17%	9	15	9	93	93	17%	16	33
	CAC	13	SEER	kWh		129	129	13%	17	14	7	95	95	13%	12	50
	DHP	13	SEER	kWh		86	86	70%	61	14	38	103	103	70%	72	26
	Weighted Total							100%	86	14					100%	100
Winter 2016	ER	1	COP	kWh	60	784	784	11%	87	42	2	1778	1778	11%	198	35
	DHP	7.7	HSPF	kWh		226	226	89%	201	22	16	176	176	89%	156	55
	Weighted Total							100%	288	25					100%	354

### Cold Climate Performance

DMSHP manufacturers offer units with claims of increased performance at very cold outdoor ambient temperatures in raltion to standard units. This report characterizes these as “cold-climate” units and all others as standard or “non-cold-climate” units. The evaluation team used the Efficiency Vermont TRM, current during study’s planning phase, to identify cold-climate units. DMSHP manufacturers continue to offer new units with claims of increased performance at very cold outdoor ambient temperatures. Currently, various makers claim DMSHPs offer 100% capacity at 20°F or at 5°F (depending upon how they are rated) and operate down to -15°F.

Figure ES-4 and Figure ES-5 present COPs,<sup>7</sup> plotted for cold-climate and non-cold-climate units against outside ambient temperatures for winter 2015 and winter 2016, respectively. Each data point represents averaged performance from many units. In terms of HSPF, the rated differences were 1.55 for winter 2015 and 1.24 for winter 2016—equivalent to a COP difference of 0.43 and 0.36, respectively<sup>8</sup>. This difference would average across the seasons (see the keys for Figure ES-4 and Figure ES-5). Data for winter 2015—already noted for deep snowfalls that buried many units—indicated separation of efficiencies only at temperatures below 40°F. The COP separation grew to about 0.5 at 0°F. For winter 2016, without snowfall issues, separation of efficiency curves for the entire range of outdoor temperatures grew from about 0.4 at -10°F to about 1.0 at 50°F. These differences were consistent with HSPF ratings and appeared to show efficiency advantages across the temperature spectrum.

The ratings difference also was consistent with comments the evaluation team heard from engineers at a major manufacturer; they stated that cold-climate units were of higher quality and featured more of the newest technologies. As cold-climate units drew the greatest customer demand, the engineers reasoned that putting more effort and innovation into cold-climate models made sense.

Notably, observed non-cold-climate models operated at outdoor ambient temperatures below 0°F, but at lower efficiency levels than cold-climate models. It is difficult to separate improved cold-climate performance from overall, higher seasonal ratings. The 152 units metered through the study and installed prior to summer 2014 had an average 10.3 HSPF; cold-climate units had an average 11 HSPF. Today, units offer HSPFs up to 14.

---

<sup>7</sup> For electrical resistance heating, the COP is 1.0; for fuel heating, it is equivalent to system efficiency (0.7 to 0.9).

<sup>8</sup>  $\Delta_{\text{HSPF}} = 10.81 - 9.57 = 1.24 \text{ Btu/Wh}$ .  $\Delta_{\text{COP}} = 1.24 \text{ Btu/Wh} * 1/3.41 \text{ Wh/Btu} = 0.36$

Figure ES-4. Average Heating COP vs. Outdoor Air Temperature for Cold-Climature and Non-Cold-Climature Systems—Winter 2015

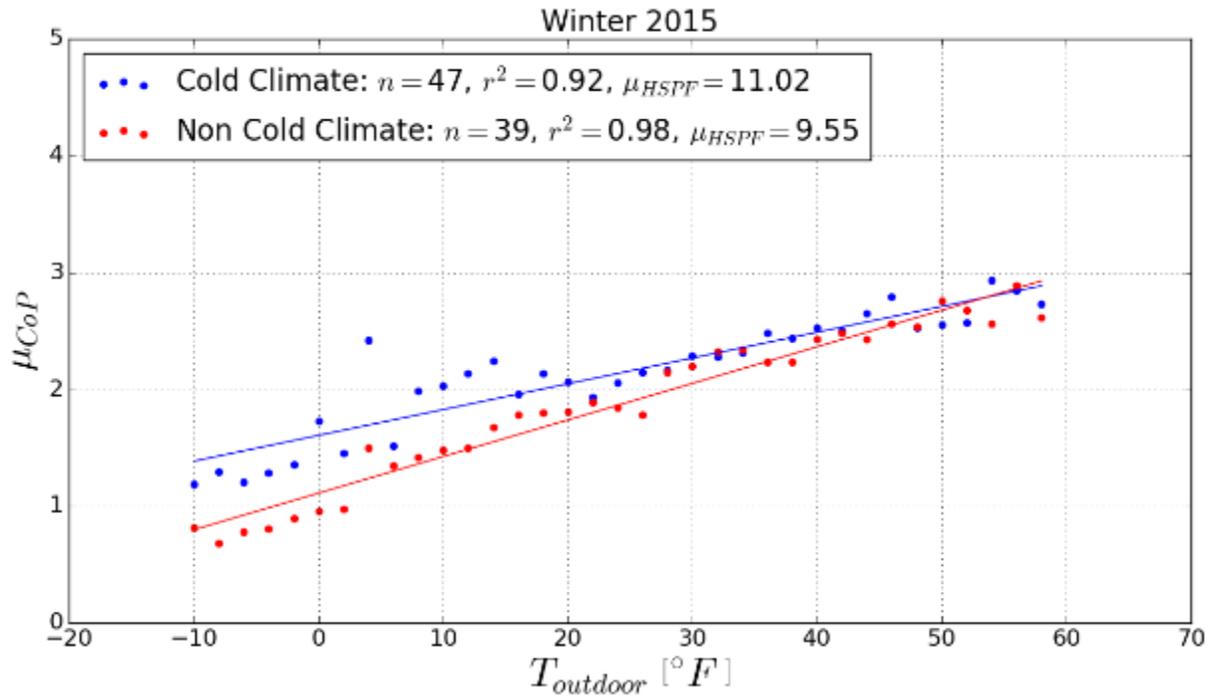


Figure ES-5. Average Heating COP vs. Outdoor Air Temperature for Cold-Climature and Non-Cold-Climature Systems—Winter 2016

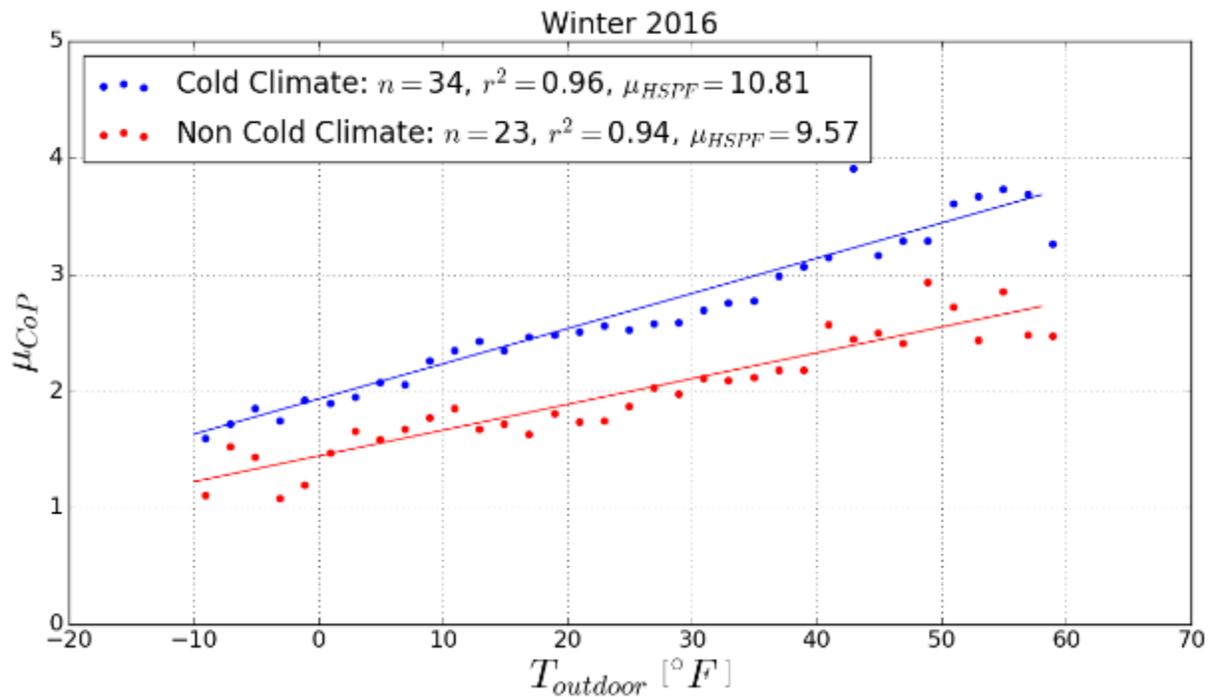


Figure ES-6 provides a two-dimensional map of electricity and fuel prices. A blue circle indicates average energy prices for winter 2016; a red triangle indicates energy pricing for winter 2015. The topographical-style lines show a third dimension: the temperature breakpoint above which a DMSHP is less expensive to operate than an alternative fuel-fired heating system. For example, if the temperature breakpoint was 30°F, above this temperature the DMSHP is more economical to operate; below this temperature, the alternate heat source proved more economical to operate. The evaluation team derived these contours from averages of measured efficiencies for all types of DMSHP systems.

The temperature dependence resulted from DMSHPs' decreasing efficiency at lower temperatures. For natural gas, the figure shows a temperature breakpoint above 70°F for either winter, meaning a DMSHP would essentially never be cost-effective, compared with an 80% efficient heating system.<sup>9</sup> This effectively means a DMSHP does not offer a viable direct replacement for a gas-fired system at today's energy prices.

The figure also shows a temperature balance point about 32°F for an oil-fired system in 2016 and 12°F in 2015. Both winters indicate a propane balance point of -15°F, meaning a DMSHP would always be less expensive than the propane option.

Figure ES-7 shows the same analysis, but addresses units listed as cold climate. These units operate somewhat more efficiently, and the economic balance points shift to colder temperatures, where gas balance points were at or above 58°F for both winters. Oil-fired systems' balance points were 26°F for 2016 and 8°F for 2015. These values do not account for zonal savings. For example, if a homeowner could use a DMSHP to heat 30% less of their home, that temperature balance point would drop by 20°F or more.

---

<sup>9</sup> Here, efficiency means system efficiency, inclusive of duct losses, and furnace fan and boiler pump energy use. It is lower than the rated or measured combustion efficiency.

Figure ES-6. Operational Break Point Temperature of Heating with DMSHP, Winter 2016, All Units


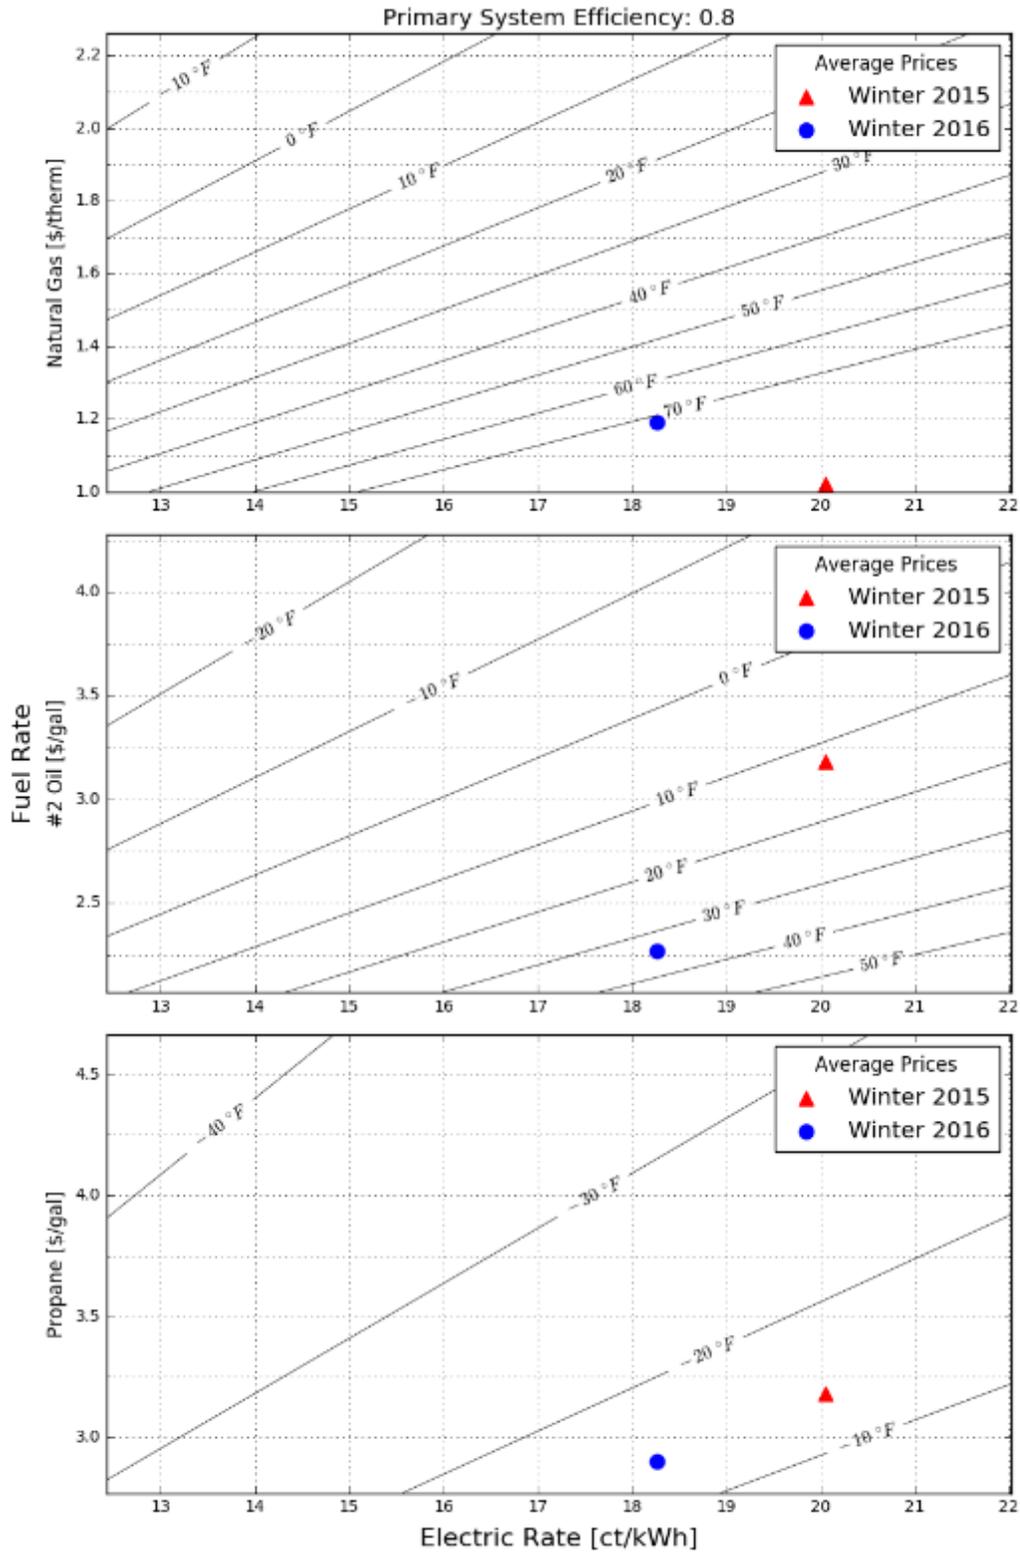


Figure ES-7. Operational Break Point Temperature of Heating with DMSHP, Winter 2016, Cold Climate Units

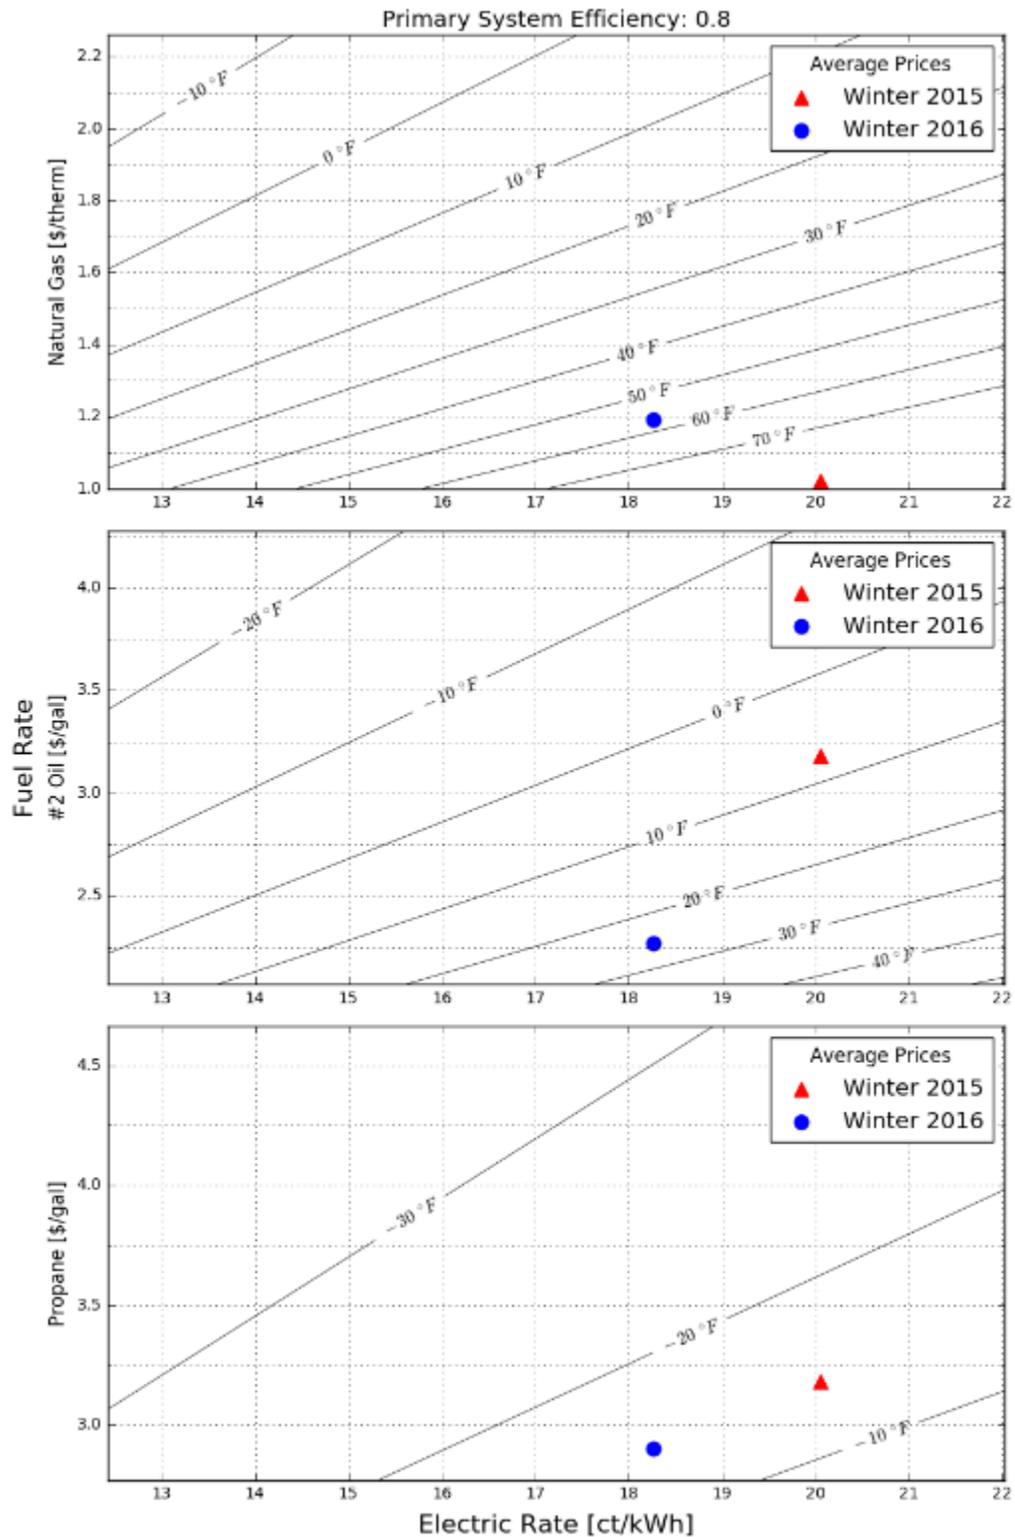

## Discussion

In general, the evaluation team found DMSHPs operated in highly variable ways, resulting in widely varying hours of use, power use, and savings among units. Some variation resulted from variable-speed designs, but the larger factor appeared to be the way users chose to operate their equipment. The following discussion addresses results from cooling, heating, and efficiency ratings.

### Cooling

The evaluation team determined an average EFLH cooling value of 218, well below the 360-hour value assumed in the Massachusetts and Rhode Island TRMs. Units often operated at low capacity or even were turned off for periods. The following elements contributed to the low EFLH:

- Units sometimes operated in dehumidifier or “dry” mode. In dry mode, the indoor unit lowers coil temperatures to induce condensation formation. The unit then operates the fan on its lowest speed setting to not excessively decrease temperature in the space.
- Some units that cooled a seldom-used space were turned on only when needed.
- As DMSHP units experienced neither duct losses nor insufficient evaporator airflow (as some central air conditioning units might), they provided the same cooling level with fewer EFLH. That is: central air conditioners can lose efficiency at the air handler due to low airflow, and then lose more energy through duct leakage as well as through heat losses and gains as ducts pass through unoccupied spaces. DMSHPs do not experience these losses.
- On average, units were sized to provide about 2.6 times the design-cooling load calculated using Manual J. This could result from contractors sizing DSMHP units to meet larger design-heating loads. Units also may be designed to cool adjacent spaces when doors to a cooled room remain open.
- TRM sources for legacy EFLH values may be inappropriate for DMSHPs: the cooling EFLH value was based on a 2009 study of central air conditioners.

Given these factors, the evaluation team found it unsurprising that the average EFLH for cooling fell below the TRM values. A low EFLH would reduce savings calculated by the TRM equation, but not necessarily mean reduced savings. For example, if a unit’s size fell by 50%, the EFLH would roughly double, but the TRM equation would yield the same savings:

$$2 \text{ (EFLH)} * 0.5 \text{ (Capacity)} = \text{EFLH} * \text{Capacity}$$

The team based the above savings discussions on providing identical cooling amounts, but at varying efficiencies (i.e., an air conditioner with an effective 16 SEER could deliver cooling with 75% of the energy as an air conditioner with an effective 12 SEER).

In many cases, DMSHPs produced additional savings beyond simply providing more efficient air conditioning from a purely mechanical standpoint (i.e. zonal savings). Therefore, they may be providing higher savings than indicated by comparisons to baselines. As the report addresses, DMSHPs were installed at a rate of approximately 1 ton of capacity per 1,043 s.f. of home floor area. This value is far

lower than typically observed for central air conditioners. Users frequently shut off DMSHPs due to unoccupied rooms or mild outdoor temperatures. Thereby, DMSHPs can deliver zonal savings by performing less cooling. DMSHP also can run in dehumidification modes, further reducing the need for cooling.

When considering new construction programs, DMSHPs potentially could deliver savings from zonal behaviors when homeowners fully cool only a portion of their houses. Typically, central air conditioners do not offer this option; to cool one room, homeowners must cool their entire houses. In contrast, a DMSHP can cool one room at a time.

For this study, the majority of DMSHPs served as the only cooling source. Homes cooled solely with DMSHPs used an average of 194 kWh for the cooling season, including standby power. Using the Massachusetts TRM value for a central air conditioner's EFLH (360 hours), a home would use approximately 830 kWh/season for a 2.5-ton unit, and about 1,000 kWh/season for a 3-ton unit. This striking difference (830 – 1,000 kWh vs. 194 kWh) argues for investigating marketing and incentivizing DMSHP units as an alternative to central air conditioners in new construction.

### Heating

The study found a heating EFLH value of roughly 450 hours. In nearly all cases, observed DMSHP units provided heat coincidentally with other systems. In most cases, DMSHPs served as secondary systems, either to provide heat for a single space or to provide supplemental heat in addition to a primary system.

The operational cost-effectiveness to a homeowner using a DMSHP for heating depended on alternative heating systems, energy prices for a given period, and outside air temperatures. Compared against electric resistance and propane heating, the DMSHP proved more cost-effective on average for all outdoor air temperatures typically observed during winters in Massachusetts and Rhode Island.

For oil-fired systems, the relative energy price determined the temperature above which a DMSHP became more cost-effective. Current oil prices remain low relative to historic values, but DMSHPs proved cost-effective in comparison to oil. Compared to natural gas heating systems, DMSHP rarely proved cost-effective. This generalization excludes a scenario where a DMSHP heats a single space, negating the need to turn on a whole-house heating system.

### COP/SEER/HSPF

For this study, DMSHP unit efficiencies were directly metered for winter and summer seasons. Most previous studies have estimated COP using metered power alone (not a very accurate technique), or calculated COPs for brief periods and small quantities of units. The evaluation team found unit efficiencies varied widely by site and from period to period. On average, field-measured seasonal efficiencies for most units were below their rated values, although some units met or exceeded their ratings. Measured SEER values below rated values could result from the following:

- Some units were seldom used.

- Some homeowners used DMSHPs only to cool on the hottest days, with their resulting cooling efficiencies closer to rated EER values (i.e., the efficiency rating at 95°F).
- SEER and EER tests run at specific conditions might not fully represent actual operations. In the SEER test, for example, return air was 80°F—much warmer than most homes during cooling seasons.
- Units were used for functions that reduced the rated performance, including fan-only modes and dry or dehumidification modes. These modes may help displace cooling, but, for these SEER calculations, simply show up as energy use without much delivered cooling.

Measured HSPF values could fall below rated values for the following reasons:

- Some homeowners used their DMSHPs during very cold outdoor conditions, when the resulting DMSHP COP was lower than its rated value.
- HSPF tests run under specific conditions that did not fully represent actual operations.
- Units operated at very low capacities (due to low heating needs) realized low efficiencies.
- Site conditions caused units to run in defrost modes for long periods of time, decreasing efficiency. The evaluation team has completed other studies that found marked differences in the frequency of defrost cycles<sup>10</sup> between brands.

Although field-measured efficiencies generally fell below rated efficiencies, this does not mean that manufacturers are not being forthright. There are stipulated test procedures for cooling and heating (47°F and 17°F, respectively), and many manufacturers use third-party laboratories for much of their testing. Hence, they verify rated values. A number of units performed at their rated values, supporting the team’s contention that units can operate at rated efficiencies, and operating conditions and behaviors greatly contribute to delivered efficiencies.

The study metered units with an average nameplate SEER of 20.6 and an average nameplate HSPF of 10.3. Further, manufacturers continue to increase the efficiency ratings of systems they offer. The marketplace currently offers an upper-range SEER of 33, with many units above 25 SEER. Manufacturers offer DMSHP units with rated HSPFs up to 14, with many units above 12 HSPF. These new units would have delivered cooling and heating more efficiently than units measured for this study.

## Savings Values

EFLH and savings values are based on averages, which include lightly used equipment, and on the rated efficiencies of the studied equipment (which are below that now available in the marketplace). While current EFLH and savings values are low relative to legacy TRM values, the evaluation team has observed high heating usage and EFLH in northern New England by populations that are motivated to

---

<sup>10</sup> Forthcoming study of DMSHP by Cadmus in Vermont and Illinois.

displace oil heat.<sup>11</sup> The team recommends incentivizing the highest-tier efficiency levels to increase savings, and combining incentives with contractor and consumer education. This approach could help target higher-use customers that could produce savings towards the higher end of this study's savings distributions.

### Controls and Zoning

Use of preexisting heating systems presented a factor limiting DMSHPs' use for heating. Most furnaces use single-zone systems, meaning a single thermostat and a single set point control a home's temperature. In such homes, if the DMSHP heats one or even two rooms, homeowners may find it difficult to use DMSHPs as a primary heating system as this would under heat other portions of the home.

Though the challenge extends to boiler-heated homes, it might be more solvable in such circumstances because boilers often supply separate zones, served by separate thermostats controlling zone valves or separate secondary pumps. In homes with individually controlled electric strip heating, primary systems can be more readily replaced with a DMSHP.

To increase DMSHP heating use and associated savings, the zone served by the DMSHP should match the primary system zone. This can be accomplished by targeting homes with zoned (i.e., oil or propane-fired) boilers or by installing multi-head systems. The homeowner would then set the DMSHP temperature setting above the primary system thermostat's dead band (e.g., 3-4°F). For example, if the DMSHP were set to 70°F, the primary system's thermostat would be set to 67°F.

This situation could be improved if the DMSHP's thermostat and the primary system's thermostat communicate with each other. When the room was no longer occupied, set points could drop to lower temperatures. This way, the DMSHP would become the primary heating system, and additional zonal savings could be achieved by not fully heating the home's unused spaces.

Recently, products from major makers of ductless systems and wireless thermostats have made progress in developing systems that work together. The evaluation team recommends that makers of various smart thermostats and DMSHP manufacturers continue to collaborate in developing protocols that allow devices to communicate.

## Recommendations

### Program

**Recommendation:** The evaluation team recommends exploring ways to improve the PAs' existing lost opportunity program for DMSHPs, such as how best to encourage the installation of multiple DMSHP heads to better match existing zones and displace primary system operation. Although the EFLHs decreased from the values prescribed in the Massachusetts TRM, the study still finds that a modest level

---

<sup>11</sup> Forthcoming Cadmus DMSHP study in Vermont.

of savings are achievable by moving from a standard efficiency DMSHP to a higher efficiency DMSHP. Substantially more savings could be achieved (i.e., the top 25% of savings) if newly installed DMSHPs are operated more regularly and continuously by better matching and integrating them zonally with primary heating systems, through better configuration design and installation and contractor and customer education and training. For example, contractors would focus their design efforts on specifying the appropriate number and size of DMSHP heads to match and heat entire zone(s) rather than a single room. Customers would then be educated on how to properly set the set points for both their primary and DMSHP heating systems, which will depend on their primary fuel type and outdoor temperatures. Finally, establishing program incentives for the generally more efficient, cold climate heat pumps would lead to increased program savings.

**Recommendation: The evaluation team recommends exploring methods for targeting homes with electric resistance heating for DMSHP retrofits.** DMSHPs will nearly always be less expensive to operate than electric resistance heat, as shown by the COP of DMSHPs remaining above 1.0 on average for nearly all outdoor temperatures. Even at very cold temperatures where some non-cold climate units approach a COP of 1.0, the number of hours in this condition are very few. Prior to new activities, program and consumer cost-effectiveness would require review.

**Recommendation: The team recommends targeting propane-heated homes for DMSHPs.** As Figure ES-6 and Figure ES-7 show DMSHPs always operate less expensively than propane heating systems. Prior to new activities, program and consumer cost-effectiveness and regulatory considerations for fuel switching would require review.

**Recommendation: The team recommends exploring methods for addressing oil-heated homes.** To target these homes, homeowners should be educated to turn off a DMSHP during very cold outdoor conditions (below 8°F in 2015 and below 25°F in 2016), when an oil-fired system would operate less expensively (depending on energy prices and cold temperature COPs). This operating scheme, however, may not appeal to all customer types, as many may not wish to concern themselves about which heating system to operate and when. If oil prices increase against electric energy rates, the switchover temperature point for oil to DMSHP heat may move lower, allowing continual use of a DMSHP. Switchover points for all fuel comparisons will decrease as more efficient DMSHP units become available. Prior to new activities, program and consumer cost-effectiveness and regulatory considerations for fuel switching would require review.

**Recommendation:** Based on large energy-usage differences in DMSHP-cooled homes and central air conditioner-cooled homes, **the team recommends examining opportunities for a new construction measure to substitute DMSHPs for central air conditioners.**

### Future Studies

This study provided a great deal of data describing how DMSHPs actually operate in Massachusetts and Rhode Island homes. These operations varied widely among units, with some used heavily and others used more like appliances turned on for short periods. Highest savings could be achieved by targeting

homes where such units would deliver greater amounts of heating and cooling (i.e., where they can be installed to match the zoning of existing systems).

Another factor in increasing DMSHP savings will be development of controls that allow ductless systems and primary thermostats to interact and share information. The evaluation team recommends either targeting studies for new construction homes without natural gas available and where central air conditioning systems would be installed; or existing homes with electrical resistance and propane heating. These studies would help refine the best ways for DMSHP programs to achieve maximum savings.

Other future studies could explore the use of interfaces between learning thermostats and ductless systems. Future research questions include the following:

- How can utilities target homes with a high probability of using DMSHPs to displace more heating and cooling, therefore producing higher savings?
- What potential exists for new high-HSPF units to displace heating?
- What optimal zonal and control characteristics maximize use of DMSHPs?
- For new construction, how large would zonal savings have to be to avoid installations of single-zone central systems?

## Introduction

Ductless mini-split heat pumps (DMSHPs) have supplied heating and cooling to homes across Europe and Asia for decades. Larger houses and colder climates partly explain the relatively slower adoption of these systems in the United States. Starting in 2008,<sup>12</sup> however, utility efficiency programs in the Pacific Northwest began marketing the technology to North American consumers and identifying its role in the residential HVAC market. The Massachusetts and Rhode Island Program Administrators (PAs) and Energy Efficiency Advisory Council (EEAC) consultants commissioned this study to better understand the impacts of DMSHPs installed in New England homes.

Figure 1 and Figure 2 show a typical DMSHP system installed at a residence in Massachusetts.

**Figure 1. DMSHP Outdoor Unit**



**Figure 2. DMSHP Indoor Unit**



---

<sup>12</sup> Northwest Energy Efficiency Alliance. "Efficient Ductless Heat Pumps (Warming up to Ductless Heat Pumps)." Last modified 2016. Accessed June 30, 2016. <http://neea.org/initiatives/residential/ductless-heat-pumps>

### Program and Evaluation

The Massachusetts PAs COOL SMART Program and National Grid Rhode Island’s High-Efficiency Heating and Cooling Program incentivized the installation of DMSHPs for their residential customers. Table 1 presents the program populations sampled as part of this study.

Table 1. Program Populations

State	Program Year	DMSHP Program Participant Count	Study Sample Participant Count
Massachusetts	2012–2013	3,229	112
Massachusetts	2014	1,055	20
Rhode Island	2013	507	20
<b>Totals</b>		<b>4,791</b>	<b>152</b>

The Massachusetts and Rhode Island PAs commissioned the evaluation team to conduct an *in situ* evaluation of DMSHPs. The team initially planned to study 132 Massachusetts homes that participated in the COOL SMART Program; the PAs, however, extended the scope of work to include 20 Rhode Island homes that participated in the High-Efficiency Heating and Cooling Rebate Program. Consequently, the team selected the sample population from participating customers who installed DMSHPs through the 2012–2013 or 2014 programs. Site visits began in July 2014.

### Research Objectives

The evaluation sought to address many utility and consumer questions about DMSHPs, focusing on power and energy consumption, heat output, efficiency, and interactions with existing HVAC equipment. The specific research questions follow:

- How much energy is being saved with the average installation of a DMSHP through the programs?
- What are the relevant baseline equipment configurations and associated energy consumptions and load shapes?
- During each season, when are DMSHPs operating, how much energy are they consuming, and how much heating and cooling are they providing?
- How does DMSHP performance correlate with rated capacity, rated efficiency, and ambient conditions?
- How do cold-climate DMSHPs and standard unit performances compare?
- How does unit sizing affect heating performance?
- How do DMSHPs interact with central heating systems?
- What factors limit the use and performance of DMSHPs?
- Are program contractors sizing DMSHPs properly?

### *Existing Research*

The evaluation team conducted an initial literature review to identify gaps between this report's objectives and findings presented in past research. Table 2 compares previous available research. Most of these studies collected power levels and supply air temperatures from a relatively small number of units, and used general-efficiency ratings to generate performance and savings. Only studies by Ecotope and Steven Winter Associates, Inc. (SWA) attempted to calculate actual, delivered heating or cooling; of these two, only the SWA study directly measured delivered heating and cooling.

**Table 2. Comparison of Previous Research**

Study Location; Date	# Sampled Units	Length of Study; Months	Parameters Metered					Airflow and BTU Balance	Reference
			Unit Total Power	Supply Air	Return Air	Room	Airflow		
Washington; 2014	60 power only, 35 power & BTU balance	14–19	Yes	Temp.	Temp.	–	Vane Anemometer	Yes	Ecotope, 2014 <sup>(1)</sup>
New York; 2014	25	7	Yes	–	–	Temp.	–	No	ERS, 8/2014 <sup>(2)</sup>
Maine; 2014	51	12	Yes	–	–	Temp.	–	No	EMI, 2014 <sup>(3)</sup>
NH; 2014	9	8	Yes	Temp.	–	Temp.	–	No	ERS, 5/2014 <sup>(4)</sup>
MA, CT, VT; 2015	7	1–2 (4 sites) & 5–7 (3 sites)	Yes	Temp. (3)	Temp. & RH	–	Indoor Head Current, point measurement	Yes	Williamson (SWA), 2015 <sup>(5)</sup>
Massachusetts & RI; 2016	152	14 (67 sites) & 18 (85 sites)	Yes	Temp. (3) & RH	Temp. & RH	Temp. & RH	Indoor Head Current, point measurement	Yes	This Study

\*Temp. = Temperature, RH = Relative Humidity

- <sup>(1)</sup> Ecotope Inc. *Final Summary Report for the Ductless Heat Pump Impact and Process Evaluation*.
- <sup>(2)</sup> Energy & Resource Solutions. *Con Edison EEPS Programs - Impact Evaluation of Residential HVAC Electric Program*. Tech. Consolidated Edison Company of New York, Aug. 2014. Web. June 30, 2016. [http://www.coned.com/energyefficiency/PDF/Con\\_Edison\\_Res\\_HVAC\\_Final\\_Report-8-5-14.pdf](http://www.coned.com/energyefficiency/PDF/Con_Edison_Res_HVAC_Final_Report-8-5-14.pdf)
- <sup>(3)</sup> EMI Consulting. *Emera Maine Heat Pump Pilot Program*. Tech. Emera Maine, September 2014. Web. June 30, 2016. <http://www.emiconsulting.com/assets/Emera-Maine-Heat-Pump-Final-Report-2014.09.30.pdf>
- <sup>(4)</sup> Energy & Resource Solutions. *Emerging Technology Program Primary Research - Ductless Heat Pumps*. Tech. Regional Evaluation, Measurement & Verification Forum; Northeast Energy Efficiency Partnerships, May 2014. Web. June 30, 2016. <http://www.neep.org/primary-research-ductless-mini-split-heat-pumps-0>.
- <sup>(5)</sup> Williamson, James, and Robb Aldrich. *Field Performance of Inverter-Driven Heat Pumps*. Tech. U.S Department of Energy, August 2015. Web. June 30, 2016. [http://apps1.eere.energy.gov/buildings/publications/pdfs/building\\_america/inverter-driven-heat-pumps-cold.pdf](http://apps1.eere.energy.gov/buildings/publications/pdfs/building_america/inverter-driven-heat-pumps-cold.pdf)

## Method

In designing a research approach, the evaluation team first identified industry metrics for assessing DMSHP performance and the fundamental equations required to calculate such performance. The team determined which data points to collect, as follows:

- Solving the equations in terms of practically measured quantities
- Considering the roles of participant intentions and baseline equipment in DMSHPs' performance

The team used primary data collected at participant homes as well as derived parameters and secondary sources, such as manufacturer specifications, to answer the study's questions.

### *Sample Design*

The evaluation team used several parameters to stratify program populations into key groups:

- Cold-climate or non-cold-climate unit sites<sup>13</sup>
- Single- or multi-head unit sites<sup>14</sup>
- Installed by the largest vendor or by all other contractors

In collaboration with the PAs and other evaluation stakeholders, the team identified these parameters at the study's outset, using them to inform sample targets during the participant recruiting process. Initially, the team designed sampling based on Massachusetts' 2012–2013 program population, but later expanded this to include Massachusetts' 2014 program population and Rhode Island's 2013 program population. Massachusetts participants from the 2014 program year did not receive an online survey due to timing considerations (i.e., they were added to the study after surveys had been completed). The team determined the sample size with a target of 90/20 confidence and precision for each stratum, assuming a coefficient of variation of 0.7. Table 3 presents details regarding these program populations, as measured by participant surveys and program tracking data. Figure 3 shows the locations of homes and systems studied in Massachusetts and Rhode Island.

---

<sup>13</sup> DMSHP manufacturers offer units with claimed high performance at very cold (below 0 °F) outdoor ambient temperatures. The evaluation team used the Efficiency Vermont TRM, current at the study's planning phase, to identify cold-climate units.


<sup>14</sup> DMSHPs consist of an outdoor unit that serves one or more indoor heads, which deliver heating and cooling. Single head units have one such head, and multi-head units have more than one head.

Table 3. Program Populations Strata

Sites	MA 2012–2013 Program Participant Share	MA 2014 Program Participant Share	RI 2013 Program Participant Share	Study Sample Participant Share	Study Sample Participant Planned Target	Study Sample Participant Count
Cold-climate unit sites	41%	15%	22%	51%	34	78
Non-cold-climate unit sites	59%	85%	78%	49%	34	74
Single-head unit sites (cold-climate units only)	48%	unknown <sup>(1)</sup>	73%	50%	34	107
Multiple-head unit sites	52%	unknown <sup>(1)</sup>	27%	50%	34	45
Installed by largest (MA) vendor sites	13%	7%	0%	28%	34	43
Installed by all other vendor sites	87%	93%	100%	72%	34	109
<b>Population Total</b>	<b>3,229</b>	<b>1,055</b>	<b>507</b>	<b>n/a</b>	<b>n/a</b>	<b>n/a</b>
<b>Sample Total</b>	<b>112</b>	<b>20</b>	<b>20</b>	<b>n/a</b>	<b>135</b>	<b>152</b>

<sup>(1)</sup> 2014 Massachusetts participants were not surveyed, so these data are not available for the total program population.

Figure 3. Locations of Sampled Residences

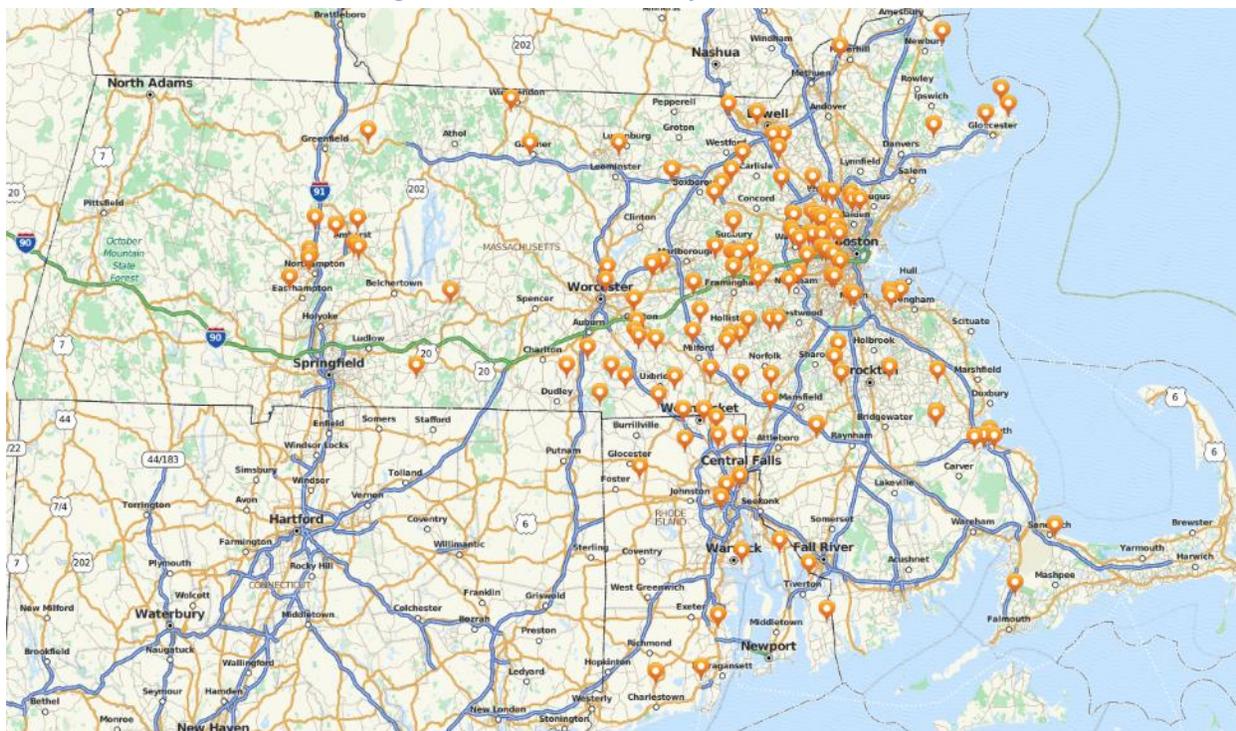

The team initially installed metering equipment at 30 sites during the pilot phase in summer 2014. The team then installed metering equipment at 102 sites during fall 2014, and the remaining 20 Rhode

Island sites in January 2015. During spring 2015, three homeowners sold their homes and meters were removed prior to closing. For the remaining Massachusetts sites, roughly 44 metering installations were removed in fall 2015, and the remaining 85 were removed in spring 2016. All Rhode Island sites were removed in late fall 2015.

Table 4 shows average attributes for the DMSHP metered at 152 sites. Units averaged about 1.3 tons, at just over 20 SEER and 10 HSPF.

**Table 4. Average Ratings for Measured Outdoor Units**

Category of System	Sample Size	Average Rated Cooling Capacity <sup>(1)</sup> (95°F) [Btu/h]	Average Rated Capacity at 47°F [Btu/h]	Average Rated Capacity at 17°F [Btu/h]	Average Rated EER <sup>(2)</sup> [Btu/Wh]	Average Rated SEER <sup>(3)</sup> [Btu/Wh]	Average Rated HSPF <sup>(4)</sup> [Btu/Wh]
All	152	16,435	19,491	11,426	13.2	20.6	10.3
Cold Climate Units (CC)	78	14,680	17,985	10,409	13.8	22.3	11.0
Non CC, multi	45	20,444	23,484	13,682	12.4	17.9	9.2
Non CC single	29	14,414	17,268	10,632	12.7	20.3	10.2

<sup>(1)</sup> The capacity is measured according to Air-Conditioning, Heating, and Refrigeration Institute (AHRI) guidelines for various outdoor temperatures: 95 °F, 47 °F, and 17 °F.

<sup>(2)</sup> The EER is the cooling provided in BTU, divided by the power consumption in watts—essentially the coefficient of performance (COP) times 3.412. It is tested at 95 °F outside and an indoor temperature of 80 °F.

<sup>(3)</sup> The seasonal energy efficiency ratio (SEER) is the cooling provided in BTU, divided by the power consumption in watts—essentially the COP times 3.412. It is tested at outside air temperatures ranging from 67 °F to 95 °F, with the lower temperatures weighted more heavily, and is meant to represent seasonal performance. The indoor temperature is set to 80 °F.

<sup>(4)</sup> The heating seasonal performance factor (HSPF) is the heating provided in BTU, divided by the power consumption in watts—essentially the COP times 3.412. It is tested at outside air temperatures ranging from 17 °F to 62 °F, and is meant to represent a seasonal performance. The indoor temperature is set to 70 °F.

### Engineering Background

Some metrics used to quantify heating and cooling system performance can be measured directly, but others must be derived from related measurements. This section provides much of the background necessary to understand what these metrics are, their derivation from data collected, and assumptions made in this process.

### Efficiency Metrics

Several commonly reported metrics serve to compare the performance of cooling and heating systems. Most of these metrics use point or spot measurements, evaluated at a specific set of conditions; for example, EER is calculated at 95 °F, and SEER is calculated from measured energy efficiency ratios (eer)<sup>15</sup>

<sup>15</sup> For clarity, the evaluation team uses EER to refer to an AHRI energy efficiency ratio rating at 95 °F, and eer to refer to energy efficiency ratios in general for other conditions.

at several temperature points and compressor speeds. As these values are calculated based on specific operating conditions, they cannot be directly translated to another set of conditions.

These metrics prove useful for comparing like systems under similar conditions, but they do not fully represent actual DMSHP performance, mostly due to the way systems actually operate. Multiple metrics, evaluated over time and on site (*in situ*) incorporate real-world operating practices and can provide insights into how systems are used and how they react to various conditions. Two standard metrics are used to compare heat pumps: the coefficient of performance (COP) and the eer. When used across a range of conditions, these offer insights into the way systems actually operate.

### **Coefficient of Performance**

A COP, defined at a given time for a given temperature, results from the following equation:

$$COP = \frac{\text{heat provided by DMSHP} \left(\frac{Btu}{h}\right)}{\text{equivalent electric power input} \left(\frac{Btu}{h}\right)} = \frac{\text{heat provided by DMSHP} \left(\frac{Btu}{h}\right)}{3.412 \frac{Btu}{h} * \text{electrical power input} (W)}$$

While the COP can be determined for a DMSHP in both heating and cooling modes, industry practice typically uses it to define the heating mode (as reflected in the formula). The following equation defines a COP’s theoretical upper bound (i.e., the Carnot Efficiency Limit) for a DMSHP operating in heating mode. Note that the equation evaluates temperatures in Rankine (an absolute temperature scale), equivalent to degrees Fahrenheit plus 459.67.

$$COP_{Carnot} = \frac{\text{temperature supplied (Rankine)}}{\text{temperature supplied (Rankine)} - \text{outdoor air temperature (Rankine)}}$$

An example of the theoretical maximum COP for 17 °F outside air and 120 °F discharge air is 5.62. At -10 °F, the theoretical maximum COP falls to 4.45. Actual systems never achieve these theoretical values, as they assume no losses and perfect efficiencies. Typical heat pump COP values in heating mode range from 2 to 4,<sup>16,17</sup> meaning a DMSHP produces two to four times more heat than the heat equivalent of the electricity it consumes. In comparison, electric resistance heating—which produces as much heat as electricity provided—maintains a 1.0 COP.

A DMSHP in heating mode also can produce a negative COP. Though infrequent, this occurs when a DMSHP in heating mode actually cools a space while defrosting an outdoor unit. Equipment only produces a negative COP when operating in the reverse of its intended purpose (e.g., heating in summer

<sup>16</sup> Princeton University. “Appendix 2-A Definitions of Energy and Energy Efficiency.” Last modified June 10, 1996. Accessed June 1, 2016. <https://www.princeton.edu/~ota/disk1/1992/9204/920409.PDF>

<sup>17</sup> Georgia State University. “Heat Pump, Air Conditioners and Heat Pumps, Coefficient of Performance, Energy Efficiency Ratio, Heat Pump Energy Flow.” Last modified April 29, 2007. Accessed June 1, 2016. <http://hyperphysics.phy-astr.gsu.edu/hbase/thermo/heatpump.html>

or cooling in winter). The above equation also applies for a cooling scenario, but the COP remains positive as the equation changes to reflect the heat quotient removed (or cooling provided), divided by the energy input.

## Energy Efficiency Ratio

Generally defined at a given temperature, an EER metric results from the following equation:

$$EER \left( \frac{Btu}{Wh} \right) = \frac{\text{heat removed by DMSHP} \left( \frac{Btu}{h} \right)}{\text{electrical energy consumed (W)}} \text{ OR } \frac{\text{cooling provided by DMSHP} \left( \frac{Btu}{h} \right)}{\text{electrical energy consumed (W)}}$$

This equation, which quantifies efficiency for a DMSHP in cooling mode, serves as the industry standard (as defined by the Air-Conditioning, Heating, and Refrigeration Institute [AHRI]). The most common test conditions are defined as 80 °F for an inside air temperature and 95 °F for an outdoor air temperature.<sup>18</sup>

Though very similar to a COP, EER generally is only used for cooling mode and, unlike the dimensionless COP, is expressed in BTU per watt-hour (although industry convention drops units from the EER metric)<sup>19,20</sup> Typical DMSHP rated EER values range from 8 to over 12. Many DMSHPs observed for this evaluation had published rated EERs between 12.9 and 15.5 (for an average of 13.1).<sup>21</sup>

## Seasonal Efficiency Metrics

Seasonal metrics account for natural weather variations occurring over the course of typical year that cannot be accounted for by measuring unit performance at a single point in time. Heat pump comparisons use two standard seasonal metrics: the seasonal energy efficiency ratio (SEER), and the heating seasonal performance factor (HSPF).

## Seasonal Energy Efficiency Ratio

SEER characterizes DMSHP performance during the cooling season. Although similar to EER, SEER captures the entire season rather than a single operating point. When using SEER to rate equipment for labeling purposes, it is calculated at several specific temperature points to simulate a cooling season. For

---

<sup>18</sup> Air-Conditioning, Heating, and Refrigeration Institute. *ANSI/ARI Standard 210/240 with Addenda 1 and 2: 2008 Standard for Performance Rating of Unitary Air-Conditioning and Air-Source Heat Pump Equipment*. December 2012. Available online: [http://www.ahrinet.org/App\\_Content/ahri/files/standards%20pdfs/ANSI%20standards%20pdfs/ANSI.AHRI%20Standard%20210.240%20with%20Addenda%201%20and%202.pdf](http://www.ahrinet.org/App_Content/ahri/files/standards%20pdfs/ANSI%20standards%20pdfs/ANSI.AHRI%20Standard%20210.240%20with%20Addenda%201%20and%202.pdf).

<sup>19</sup> Princeton University 1996.

<sup>20</sup> Russ Rowlett and the University of North Carolina at Chapel Hill. "How Many? A Dictionary of Units of Measurement." Last modified December 9, 2008. Accessed June 1, 2016. <https://www.unc.edu/~rowlett/units/dictE.html>.

<sup>21</sup> Mitsubishi Electric Corporation. *Outdoor Unit Service Manual No. OBH543-A*. September 2010. Available online: [http://www.mitsubishipro.com/media/214712/muz-fe09-18na\\_service\\_obh543a\\_9-10.pdf](http://www.mitsubishipro.com/media/214712/muz-fe09-18na_service_obh543a_9-10.pdf).

this study, the evaluation team calculated (field) SEER using heat removed from the conditioned space during the cooling season, divided by the total electrical energy consumed by the heat pump during the same time period:<sup>22</sup>

$$SEER \left( \frac{Btu}{Wh} \right) = \frac{\text{total heat removed (Btu)}}{\text{electrical energy consumed (Wh)}} = \frac{\text{total cooling provided (Btu)}}{\text{electrical energy consumed (Wh)}}$$

Typical SEER values range from 13 to 24, with the federal minimum for DMSHPs currently set at 14 (with an average published SEER of 20.6 in units observed for this evaluation).<sup>23</sup> Although a unit's actual SEER depends on the climate, the standard (laboratory) rating does not account for regional climate differences in summer<sup>24</sup>—one reason that field SEER and tested/stated SEER values differ. Variation also occurs due to use of a system in conditions other than those simulated during testing (e.g., a homeowner might operate the unit only during hot evenings).

### Heating Seasonal Performance Factor

HSPF applies to DMSHPs operating in heating mode. This uses the same units as those for SEER, but applies only to a heating scenario.<sup>25</sup> Typically, HSPF serves to compare air-source heat pumps (ASHP)—which include DMSHPs. The federal minimum HSPF value for an ASHP is 8.2,<sup>26</sup> and the U.S. Environmental Protection Agency requires an HSPF of 8.5 or more<sup>27</sup> to earn an ENERGY STAR rating. Rated HSPF values typically range from 7.5 to 13 (with an average published HSPF of 10.3 in units observed for this evaluation).<sup>28</sup> There is some concern in using the HSPF calculation for a variable speed

<sup>22</sup> AHRI 2012.

<sup>23</sup> AHRI. "Seasonal Energy Efficiency Ratio: What You Should Know about SEER." Last modified 2016. Accessed June 10, 2016 <http://www.ahrinet.org/Homeowners/Save-Energy/Seasonal-Energy-Efficiency-Ratio.aspx>

<sup>24</sup> Fairey, Philip, D. Parker, and M. Lombardi (Florida Solar Energy Center) and B. Wilcox (Berkeley Solar Group). "Climate Impacts on Heating Seasonal Performance Factor (HSPF) and Seasonal Energy Efficiency Ratio (SEER) for Air Source Heat Pumps." *ASHRAE Transactions*, American Society of Heating, Refrigerating and Air Conditioning Engineers, Inc., Atlanta, Georgia, June 29, 2004. Available online: <http://www.fsec.ucf.edu/en/publications/html/FSEC-PF-413-04/>

<sup>25</sup> The Air-Conditioning and Refrigeration Institute (ARI 2003) describes the standard method for determining the HSPF. It describes the range of conditions to be evaluated, including six different climate zones and several building loads. However, the official published HSPF rating is from a single climate zone (IV) and building load (minimum expected for the heat pump). [https://conduitnw.org/\\_layouts/Conduit/FileHandler.ashx?rid=184](https://conduitnw.org/_layouts/Conduit/FileHandler.ashx?rid=184)

<sup>26</sup> American Standard Heating and Air Conditioning. "2015 Federal Regional Standards for Heating and Cooling Products." eAPB1410. May 5, 2014. Available online: <http://www.sgtorrice.com/files/Pages/News/2015-Regional-Standards-Cooling-Heating%20Products-rev1.pdf>

<sup>27</sup> ENERGY STAR. "Air-Source Heat Pumps and Central Air Conditioners Key Product Criteria." Last Modified Wednesday, July 27, 2016. Accessed Wednesday, July 27, 2016. [https://www.energystar.gov/products/heating\\_cooling/heat\\_pumps\\_air\\_source/key\\_product\\_criteria](https://www.energystar.gov/products/heating_cooling/heat_pumps_air_source/key_product_criteria)

<sup>28</sup> "Best Heat Pump Reviews 2016." Accessed Wednesday, July 27, 2016. <http://heatpumpdigest.com/>

unit such as a DMSHP. Concerns include how the unit is rated in heating mode and whether that rating affects the building load used in rating equations.

## Energy

As the *Power* section outlines in greater detail, a watt-hour transducer directly measures electrical energy consumed by a DMSHP. Determining the energy output—or heating and cooling provided—requires making several indirect measurements and calculations. An energy balance, written in per-unit time, serves as the basis for this calculation:

$$\Delta \dot{E} = \dot{E}_2 - \dot{E}_1$$

In this equation, each term is a rate of energy with dimensions  $\left[\frac{Btu}{min}\right]$ , where the subscripts 1 and 2 correspond to the state of the system before and after contacting the indoor unit's heat exchanger (respectively), and  $\Delta \dot{E}$  is the heat provided or removed from a space served by the system. In all cases, the rate of energy change is calculated as the product of the mass flow,  $\dot{m}$ , and enthalpy,  $h$ , which quantifies the energy held within the mass of the air-water vapor mixture (written as follows):


$$\dot{E} = \dot{m}h$$

Evaluating this across the system yields:

$$\Delta \dot{E} = \dot{m}_2 h_2 - \dot{m}_1 h_1$$

Under most situations, the mass entering the unit as an air-water vapor mixture exactly matches the mass supplied to the space served. Under certain conditions, however, cooling moist air condenses water vapor (dehumidification), and the condensed water drains from the system through a dedicated hose (as shown in Figure 4).

**Figure 4. Indoor Unit Mass Flow**

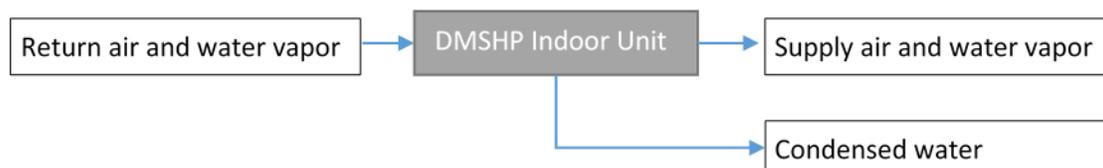

Considering this condensate's energy content versus ambient temperature to be negligible (as commonly done),<sup>29</sup> the mass balance simplifies to consider only entering and leaving air, as shown in the following equation:

$$\dot{m}_1 = \dot{m}_2 = \dot{m}$$

The energy balance then becomes:

$$\Delta \dot{E} = \dot{m}(h_2 - h_1)$$

Because the metered fan current supplied to the indoor head correlates with supply airflow, the evaluation team evaluated the mass of the supply air:

$$\Delta \dot{E} = \dot{m}_2(h_2 - h_1)$$

Where mass is the product of volume and density:

$$m = V\rho$$

Substitution yields:

$$\Delta \dot{E} = \dot{V}_2\rho_2(h_2 - h_1)$$

The above equation uses the following quantities and dimensions:

$$\dot{V} \left[ \frac{ft^3}{min} \right] = \text{volumetric flow rate}$$

$$\rho \left[ \frac{lbm}{ft^3} \right] = \text{density}$$

$$h \left[ \frac{Btu}{lbm} \right] = \text{enthalpy}$$

All variables on the equation's right-hand side are then calculated from other measured values, relying on the additional assumptions described below.

## Airflow

Calculating energy output requires continuous measurement of an indoor unit's volumetric flow rate, but devices capable of this prove ill-suited to remain in a residence for long periods, given their size and effect on a unit's operation (photos in Appendix A illustrate these limitations). Without the ability to measure airflow continuously, the evaluation team needed to meter another quantity and use those

---

<sup>29</sup> Mitchell, John W. and J. E. Braun. *Principles of Heating, Ventilation, and Air Conditioning in Buildings*. March 6, 2012. Available online: [http://higheredbcs.wiley.com/legacy/college/mitchell/0470624574/online\\_chap/ch02.doc](http://higheredbcs.wiley.com/legacy/college/mitchell/0470624574/online_chap/ch02.doc), the latent heat of the conditioned air is however fully calculated.

results to calculate airflow. Airflow results from operation of an indoor unit's fan, and equating the fan's electrical power with the mechanical power it supplies produces the following equation:

$$P = iv = \Delta p \dot{V}$$

Where  $P$  is power,  $i$  is current,  $v$  is voltage,  $\Delta p$  is differential pressure, and  $\dot{V}$  is the volumetric flow rate. Substituting in the approximation<sup>30</sup> for the behavior of fluid passing through a resistive system element:

$$\Delta p = k \dot{V}^2$$

where  $k$  is an unknown constant, results in the following equation:

$$\dot{V} = \left( \frac{iv}{k} \right)^{\frac{1}{3}}$$

This equation says volumetric airflow is proportional to the cube of electrical power consumed. The evaluation team determined this relationship between airflow and power through measurements (i.e., empirically), as shown in Appendix A, given the constant  $k$  remains unknown, and the exponent is an approximation that varies in actual systems. Appendix A provides a complete discussion of the team's considerations in estimating airflow from current.

### Data Collection

Using its understanding of measurements necessary to answer the study's essential questions, the evaluation team identified appropriate equipment, developed methods for metering these data points, and specified data to collect from on-site inspections.

### Power

To measure a DMSHP system's electrical consumption, the team installed a power metering setup. This involved installing a logger and sensors inside the outdoor unit, where a circuit from residential electrical power provided power for the entire DMSHP. Figure 5 shows a sample installation.


The team's power metering setup included the following:

- An alternating-current watt-hour transducer (circled in black)
- Two current transformers (CTs), sized for the DMSHP's full-load operating current (circled in yellow)
- Voltage leads (circled in green)
- A data logger with a pulse adaptor (not pictured)

---

<sup>30</sup> Dr. Charles Sullivan. *Lumped Fluid Systems*. Fluid Systems Analysis, Engs 22—Systems. Summer 2004. Available online: [http://www.dartmouth.edu/~sullivan/22files/Fluid\\_sys\\_anal\\_w\\_chart.pdf](http://www.dartmouth.edu/~sullivan/22files/Fluid_sys_anal_w_chart.pdf)


Figure 5. Power Metering Setup Installed on an Outdoor Unit

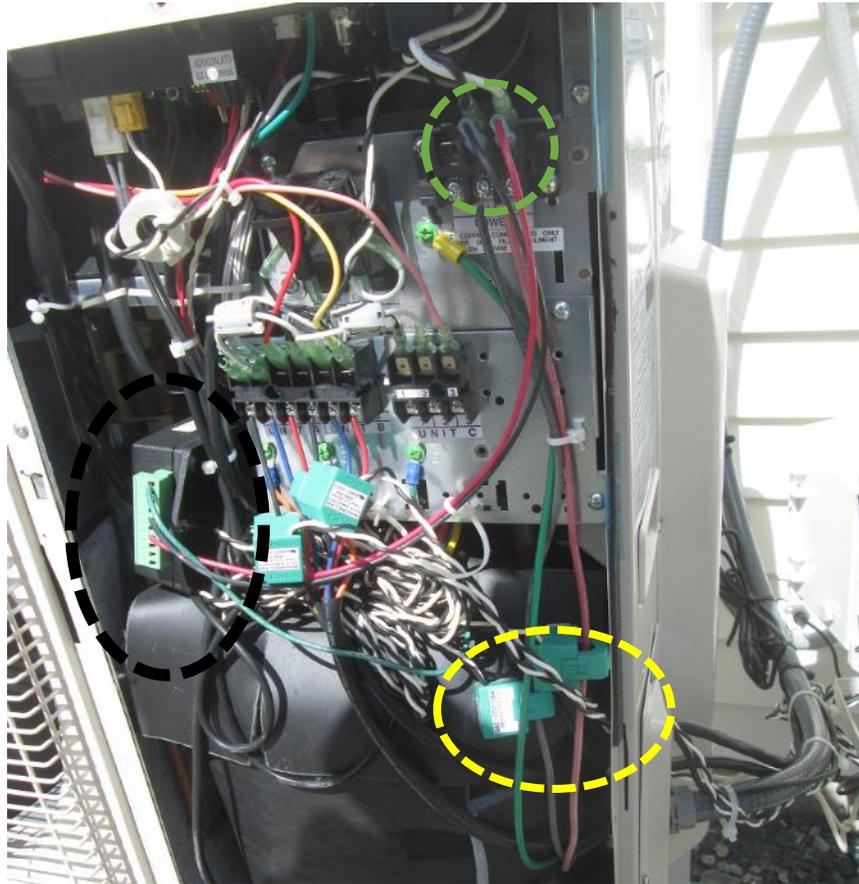

The watt-hour transducer measured voltage and current supplied to the DMSHP system and converted energy consumed during the time interval to a number of pulses. The team then used the number of pulses and the logging interval to derive average power and energy consumed over that time period.

### Fan Current

For each unit studied, the evaluation team installed CTs on the wire powering the indoor head. For the study's duration, these CTs sensed the indoor unit's current (amperage) draw at one-minute intervals. The team sized CTs to capture the range of a fan's current at different fan speeds. For the airflow spot measurement process (detailed in the Airflow section), the team increased the fan current measurement frequency to read every two seconds, thus increasing the resolution and expediting the procedure. After the spot test, the team returned the sampling frequency to one-minute intervals. Figure 6 shows an installation for a DMSHP system using three indoor heads.

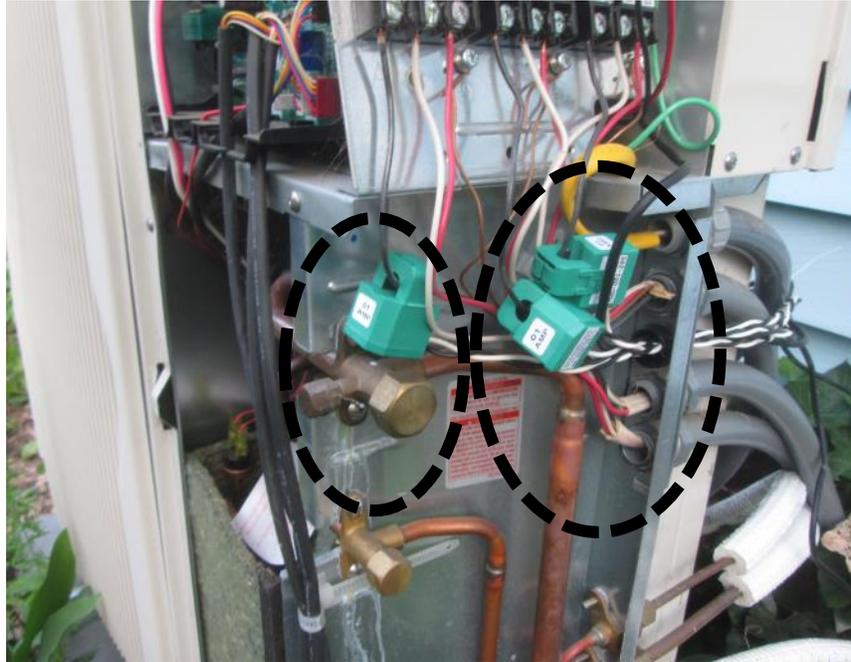**Figure 6. Current Transformers Installed on Fan Wires**

### Airflow

The evaluation team directly measured the airflow for each indoor unit while on site, using a calibrated flow hood (i.e., balometer) to capture spot measurements of delivered airflow at each corresponding fan setting. The team also used specialized frame kits for each balometer, with the instrument's geometry modified to better fit a typical DMSHP head. Figure 7 shows a typical flow hood with the specialized frame kit attached.

**Figure 7. Balometer**

The study population's various indoor unit models displayed great variability regarding louver settings and fan-speed options. To produce repeatable and standardized results, the team conducted airflow measurements with louvers fixed in place (i.e., not oscillating) and, wherever possible, in fan-only mode. The fan-only setting meant the mode's discharge conditions generally approximated standard conditions (i.e., 68 °F and 1 atmosphere). The issue with using other modes to measure airflow is that various units have algorithms that continuously change fan speeds as unit's approach temperature settings interfering with airflow measurement.

The team took airflow measurements at each speed setting on the indoor head's controller, while simultaneously collecting one minute of fan current readings at two-second logging intervals. This procedure collected a suitable number of current readings for each airflow reading to allow for correlating airflow and amperage. Logging began once the fan reached a steady state after ramping up or ramping down the fan motor.

### Temperature and Relative Humidity

To calculate heating and cooling loads, the evaluation team measured temperature and relative humidity across different system points. Using a range of temperature and relative humidity sensors, the team measured outdoor air, leaving or supply air from the indoor unit, and entering or return air at the indoor unit. To better understand customers' operating behaviors, measurements included the indoor ambient temperature and the relative humidity.

At the outdoor unit, the team installed a temperature and relative humidity sensor, logging values at one-minute intervals. Installing this sensor on the unit's entering air side best measured the environment in which the unit absorbed or rejected heat. The team also installed a solar shield on the sensor to prevent erroneous readings from solar heating. Figure 8 shows the installation, including the solar shield.

**Figure 8. Outdoor Entering Air Temperature and Relative Humidity Sensor**



At the indoor unit's center, the team installed a temperature and relative humidity sensor to measure leaving air. The team also installed two additional temperature sensors far left and far right at the supply grill to gather data used to calculate the average temperature across the supply coil. Figure 9 shows installation of these sensors.

**Figure 9. Leaving Air Sensors on a DMSHP Head**



The team also installed a temperature and humidity sensor on top of each indoor unit to measure entering air temperatures and relative humidity. Figure 10 shows the logger and its embedded sensor zip-tied on the return grill above the indoor unit.

Figure 10. Entering Air Sensors on a DMSHP Head



### Heating Systems

To measure other heating systems' operating times, the evaluation team used motor loggers, which either employ an internal AC magnetic field sensor or an external current switch. With both configurations, the team calibrated the sensors in their installed position, with the heating system metering point running and operability verified during the initial installation.

Figure 11 shows a motor logger placed on a boiler circulator pump (which also served the space served by the DMSHP). The image illustrates a similar logger on an oil burner. This same installation can be used to meter a gas valve. The team collected nameplate data from all relevant heating system equipment, and used these data for various baseline and coincident-heat calculations.

Figure 11. Boiler System Monitoring



Figure 12 shows the meter deployment for a gas-fired furnace. To monitor gas consumption, field technicians installed motor loggers with CTs on both stages of the gas valve. Technicians installed a similar logger on the blower motor's power wire. This logger provided backup data on the unit's run-time.

Figure 12. Furnace System Monitoring



### Site Attributes

To analyze DMSHP performance and to determine their interactions with other cooling or heating sources, field technicians collected numerous site attributes to calculate approximate heat gain and loss using the Manual J Residential Load Calculator.

The evaluation team sketched a floor plan for each house and measured each room's wall lengths and average ceiling heights to determine room volumes. The team noted general exterior wall construction as well as space separating the conditioned area (e.g., exterior, conditioned space, ground), including space above and below each ceiling and floor (e.g., attic, exterior, conditioned space, slab, basement). Floor plan drawings indicated wall orientations as well as door and window locations. Measurements included dimensions of all windows and doors, along with notes about their construction, orientation, and amount of shading.

At each site, the team recorded a DMSHP's make, model, and configuration as well as coincident heating or cooling sources (e.g., central heating or cooling, space heating, fireplaces). The team also collected other information, including system type, fuel source, heating or cooling capacity, unit make and model, control system, and space served. Floor plans showed locations of DMSHP units, space heating or cooling equipment, and zones served by central systems. This mapping helped in determining overlap between systems.

### **Analysis**

With data collected and a basis established for deriving further quantities from these data, the evaluation team developed additional methodologies and assumptions to conduct the analysis. Discussions of these follow.

#### **Airflow**

The Airflow section (above) described the relationship between current and airflow. The evaluation team mapped current to airflow by fitting a curve to spot measurements recorded on site, thus determining the coefficient and exponent. The team installed metering equipment at 132 sites during fall 2014, with the remaining 20 Rhode Island sites installed in January 2015. In fall 2015, the team removed roughly 65 metering installations, and removed the remaining 85 in spring 2016. For sites removed in spring 2016, the team used two sets of spot measurements—recorded during fall 2015 and spring 2016—for these calculations. Sites removed in fall 2015 used a single set of airflow mapping data, recorded during meter removal.

This approach captured system behaviors at given times and under certain conditions, but the team also considered variables influencing airflow in addition to fan speeds, such as the amount of material present on an indoor unit's air filter, condensed water that can collect on heat exchangers during cooling, and the position of vanes used to direct conditioned air. Via testing, the team found these restrictions induced current drops proportional to the drops in volumetric airflow; metering current suitably accounted for these restrictions. Appendix A fully discusses testing methods, equipment, and results.

#### **Weather Normalization**

The evaluation team weather-normalized the study results to account for variability between weather conditions present during the study and during a typical year. The team metered air temperatures and relative humidity levels adjacent to each DMSHP outdoor unit on site. As sun, wind, snow, and other variables affected these measurements, the team also collected historical National Oceanic and Atmospheric Administration data, recorded during the study period by the nearest U.S. Weather Bureau Army Navy weather station. The team then aligned these data with each site's meter data, and calculated average values in 1-degree temperature bins.

This technique served to illustrate how, on average, participants operated their DMSHPs in various weather conditions. To normalize data to a typical year, the team gathered National Renewable Energy Laboratory (NREL) typical meteorological year (TMY3) data from the nearest U.S. Air Force weather

station, binned these data by temperature, and multiplied the averages of the study’s value of interest by the time spent in each bin during a typical year. Where the study found the highest or lowest temperature observed less extreme than a typical year, the team used data from the nearest observed temperature bin.

### Climate During the Study

As shown in Table 5, summer 2015 experienced a larger number of cooling degree-days (CDD) than 2014. With the exception of the Norwood, Massachusetts, location, all CDD values from 2015 exceeded the 10-year average: winter 2015 was colder than the 10-year average for all stations, and winter 2016 was milder than the 10-year average for all stations.


**Table 5. Observed Weather During the Study**

Station	10 year CDD <sup>(1)</sup> Average	2014 CDD	2015 CDD	10 year HDD Average	2014/15 HDD	2015/16 HDD
Norwood Memorial Airport (54704)	641	474	625	5,563	6,685	5,379
Worcester Regional Airport (94746)	569	412	637	6,400	7,050	5,824
Gen E L Logan International Airport (14739)	858	769	921	5,369	6,029	4,804
Lawrence Municipal Airport (94723)	765	609	839	6,462	6,661	5,264
Westover Afb/Metropolitan Airport (14703)	650	483	673	6,270	7,084	5,577
Dillant-Hopkins Airport (94721)	464	358	490	6,959	7,523	6,143
Brnsbl Muni-Bman/Pol Fd Ap (94720)	592	488	677	5,569	5,984	5,059
Marthas Vineyard Airport (94724)	528	275	554	5,547	6,208	5,052
North Central State Arpt (64710)	579	423	615	5,945	6,622	4,627
Plymouth Municipal Airport (54769)	667	481	696	5,795	6,433	5,227
Beverly Municipal Airport (54733)	606	532	702	6,068	6,663	5,378
New Bedford Rgnl Airport (94726)	643	471	706	5,671	6,227	5,034
Theodore F Green State Airport (14765)	845	699	945	5,346	6,047	4,778
Block Island State Airport (94793)	623	504	725	5,071	5,609	4,531

<sup>(1)</sup> CDDs were base 65 and based on average daily temperature.


Taking a closer look at temperatures during winter 2015 and 2016, Figure 13 shows the cumulative distribution of hours spent at various temperatures for the two winters. Winter 2015 had a similarly shaped distribution of hours, but shifted left by about 8 °F. For both winters, very few hours fell below 0°F. The midpoint of distribution (i.e., half of the hours) was about 30°F during winter 2015 and about 38°F during winter 2016.

Figure 13. Cumulative Distribution of Winter Hours Versus Temperature Bin

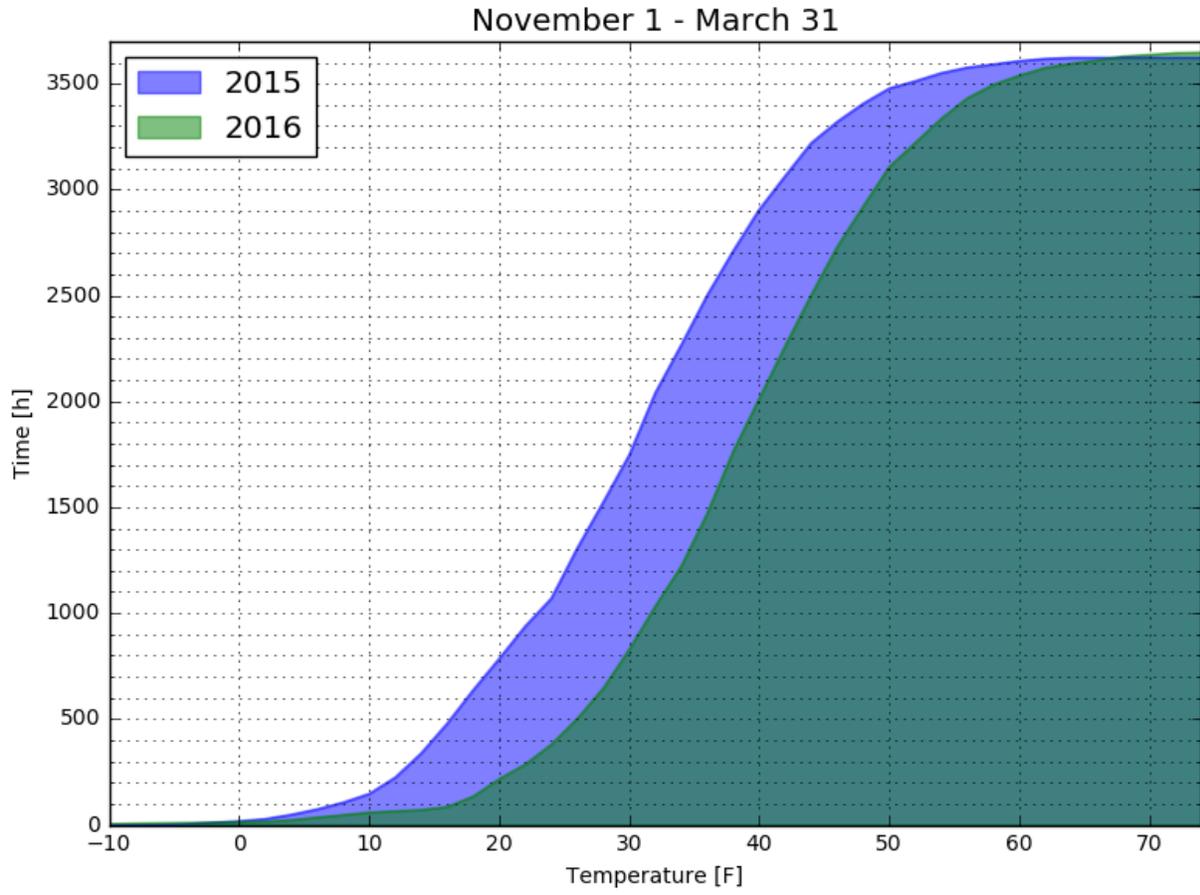

Error! Not a valid bookmark self-reference. shows the distribution of summer hours at various temperatures, with very few hours at 90°F or greater.

Figure 14. Cumulative Distribution of Summer Hours Versus Temperature Bin

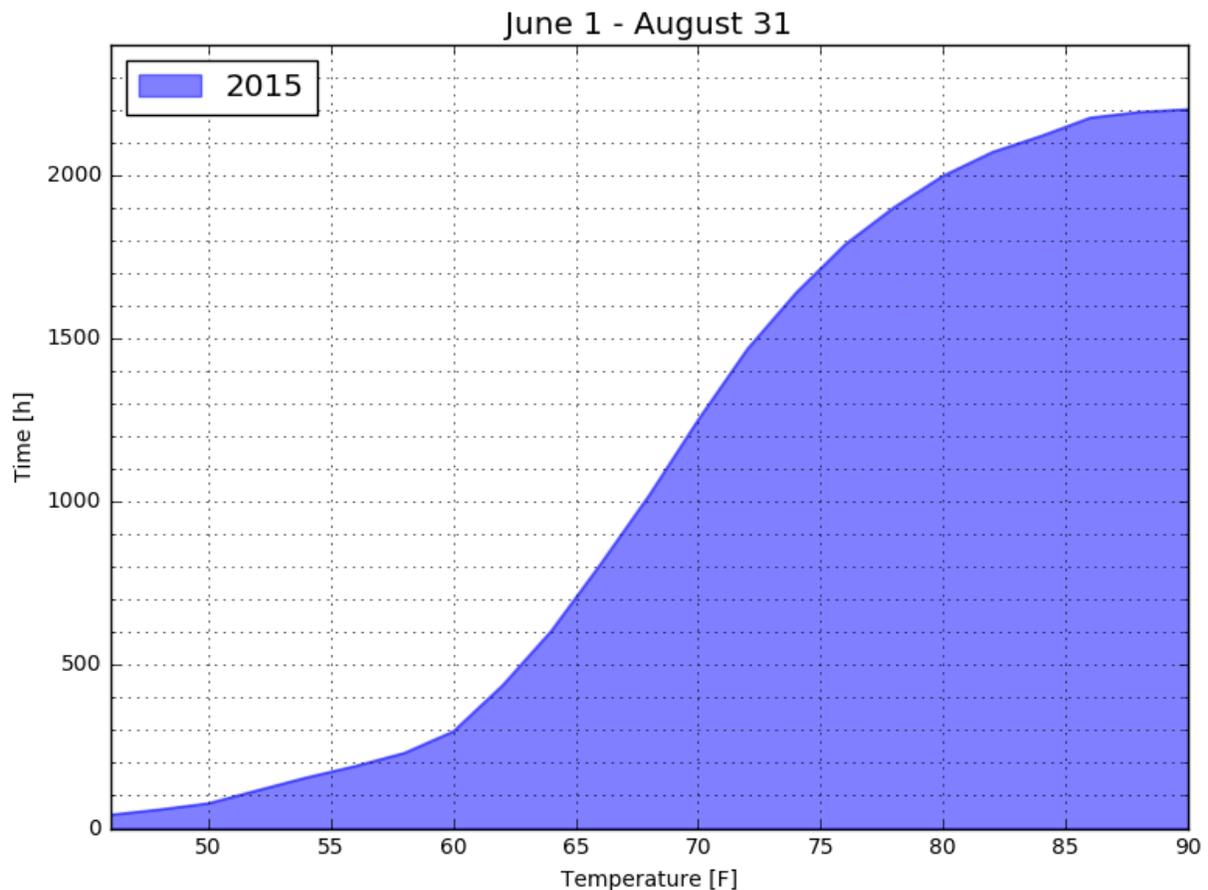

## Manual J: Residential Load Calculation

The evaluation team examined how contractors sized DMSHPs and whether the units could meet the heating and cooling requirements for the spaces they served. To answer this, the team calculated thermal loads using an abridged Manual J<sup>31</sup> calculator, in conjunction with the *Manual J: Residential*

<sup>31</sup> Air Conditioning Contractors of America. *ACCA Speed-Sheet for Manual J (Abridged Edition)*. PowerPoint presentation and corresponding Microsoft Excel workbook. June 22, 2015. Available online: <http://www.acca.org/communities/community-home/librarydocuments/viewdocument?DocumentKey=0bc73e80-6c3c-43cb-bdb2-43316a380fa4>  
<http://www.acca.org/HigherLogic/System/DownloadDocumentFile.ashx?DocumentFileKey=b77bcc44-be9c-45d5-b23f-6774e5663ed2&forceDialog=1>

*Load Calculation* textbook published by the American National Standards Institute/Air Conditioning Contractors of America (ANSI/ACCA, Version 2, Eighth Edition). These calculations estimated the highest steady state heating and cooling loads that DMSHPs would experience at design conditions.

An industry-approved method for establishing the sizing of heating and cooling systems, Manual J provides a recommended resource for contractors' use (either directly by using an abridged spreadsheet or indirectly by using the plethora of available third-party software). For this study, the team used the ANSI/ACCA Manual J's electronic spreadsheet.

Through discussions with homeowners, the team established boundaries on spaces served by DMSHP units. These boundaries, varying from large rooms to regions of a house to an entire house, proved crucial for gathering an appropriate amount of data from each house. During these discussions, the team focused on homeowners' requests to installing contractors rather than *in situ* performance to draw appropriate comparisons.

Practical limitations on data collected on site dictated the analysis detail level. For example, thicknesses and types of wall insulation often cannot be determined without opening holes in a wall. Given such limitations, the team assessed the type and quantity of insulation present in basements and attics, and consulted homeowners for further information. When the former proved difficult, the team used applicable building codes and typical construction practices.

To establish outdoor design conditions for Manual J, the team used the arithmetic mean of the geographic latitude and longitude of the entire sample population, and then selected the ACCA Manual J location closest to this point. This method provided an average condition, but gave a good indication of the unit's relative capacity to the space it served. The resulting location (i.e., Framingham, Massachusetts) had a summer 1% dry bulb temperature of 88°F and a winter 99% dry bulb temperature of 6 °F. The team used these values to calculate heat gain and heat loss in spaces served by DMSHPs.

## Savings

To answer a key research question ("*How much energy is being saved with the average installation of a DMSHP through the programs?*"), the evaluation team developed a methodology to estimate savings for numerous heating and cooling baseline equipment options. Alternative equipment options for heating included the following:

- Furnace (assuming 85% and 90% AFUE, MA 2013–2015 TRM)
- Boiler (assuming 82% AFUE, MA 2013–2015 TRM)
- HSPF 7.7 DMSHP (federal minimum efficiency standard for central ASHPs prior to January 1, 2015)
- HSPF 8.2 DMSHP (current federal minimum efficiency standard for central ASHPs, effective January 1, 2016)
- Electric resistance baseboard heat or furnace (COP=1.0)

For cooling, alternative equipment options included the following:

- EER 9.8 Window AC (current federal standard)
- SEER 13.0 Central AC with duct losses of 15% (current federal minimum efficiency standard for central ACs and duct-loss estimate based on the MA 2013–2015 TRM)
- SEER 13.0 DMSHP (federal minimum efficiency standard for central ACs and for central ASHPs prior to January 1, 2015)
- SEER 14.5 DMSHP (from a team estimate from market research for lowest-cost DMSHP options available, reflecting an increase from the current federal minimum efficiency standard of SEER 14.0, effective January 1, 2016)

To develop the savings methodology, the team assumed that the DMSHP heating and cooling capacity remained constant in each baseline scenario. The numerator of SEER or HSPF value (per the Seasonal Efficiency Metrics section) represented the capacity—a metered and quantifiable parameter. To estimate savings for the most common baseline scenario (i.e., a lower-efficiency DMSHP), the team used metered energy consumption. The following equations show the savings calculation approach.

Cooling savings equation for electric baseline system:

$$\Delta kWh_{COOL} = \sum_{i=T_L}^{T_H} \left( kWh_{METERED} \times \frac{EER_{EE}}{EER_{BASE}} - kWh_{METERED} \right) \times \frac{Hours_{TMY}}{Hours_{ACTUAL}}$$

Heating savings equation for electric baseline system:

$$\Delta kWh_{HEAT} = \sum_{i=T_L}^{T_H} \left( kWh_{METERED} \times \frac{EER_{EE}}{EER_{BASE}} - kWh_{METERED} \right) \times \frac{Hours_{TMY}}{Hours_{ACTUAL}}$$

Where:

- $\Delta kWh_{COOL}$  = Reduction in annual kWh cooling consumption of heat pump equipment
- $\Delta kWh_{HEAT}$  = Reduction in annual kWh heating consumption of heat pump equipment
- $T_H$  = Highest observed outdoor dry bulb temperature with cooling during cooling season; heating during heating season from a local weather station
- $T_L$  = Lowest observed outdoor dry bulb temperature with cooling during cooling season; heating during heating season from a local weather station
- $kWh_{METERED}$  = Logged energy consumption
- $EER_{BASE}$  = Instantaneous efficiency of baseline equipment (varies with outdoor conditions)
- $EER_{EE}$  = Instantaneous efficiency of installed equipment (varies with outdoor conditions)
- $Hours_{TMY}$  = Total count of TMY hours in each temperature bin from a local weather station
- $Hours_{ACTUAL}$  = Total count of observed hours in each temperature bin from a local weather station

This study directly measured instantaneous efficiency to evaluate DMSHP performance. The team initially used metered efficiency and then decremented the baseline unit’s efficiency by a proportional amount. This proved mathematically equivalent to the method described below.

The team reviewed manufacturers’ specification data to determine baseline DMSHP performance (e.g., 13.0 or 14.5 SEER) versus temperature, and developed heating and cooling performance curves (eer versus temperature). In many cases, manufacturer-rated SEER and HSPF values differed from DMSHPs’ actual seasonal operations (see Figure 50 and Figure 51). The team assumed, however, that the energy-consumption *difference* between a baseline DMSHP and efficiency DMSHP correlated to the ratio of AHRI-rated SEER and HSPF values.

In other words, if a 20.0 SEER DMSHP had an actual operating efficiency of 15.0 SEER, the team did not calculate savings relative to a 13.0- or 14.5-SEER baseline DMSHP. Rather, the team assumed the baseline DMSHP would have operated less efficiently, maintaining the following relationship as a function of temperature (T):

$$\frac{SEER_{EE}}{SEER_{base}} = \frac{\frac{total\ heat\ removed}{efficient\ kWh\ consumption}}{\frac{total\ heat\ removed}{baseline\ kWh\ consumption}} = \frac{baseline\ kWh\ consumption(T)}{efficient\ kWh\ consumption(T)}$$

To estimate savings from energy consumption, the evaluation team only used energy consumed when the DMSHP actually provided heating or cooling. This effectively removed energy consumed due to various operation types that would not generate savings (e.g., fan-only operation).

The team assumed a baseline efficiency DMSHP would have consumed energy in the same way when operating in a mode that would not provide heating or cooling. The possibility certainly exists that a baseline DMSHP could use more energy (e.g., through less efficient defrost control sequencing or less-efficient dehumidification), but the team did not have operational data of baseline DMSHPs to estimate savings. Thus, the final DMSHP savings estimates could be conservative.

The team identified heating and cooling mode operations through site-by-site review of raw meter data. Primarily, the review determined the indoor unit airflow (i.e., in some modes, indoor fans did not run) and the enthalpy differential from supply and return air sensors to identify operation for every metered interval.

To estimate savings for other system types, the team followed a similar approach, assuming that alternative equipment would have provided capacity equivalent to that provided by the DMSHP. Table 6 summarizes the savings methodologies used for the most common baseline options and describes additional adjustments to the final savings estimate for each scenario (e.g., a DMSHP that offsets heat delivered by a fossil fuel system provides positive fuel savings but negative kWh savings). Additional zonal savings could be available from only heating occupied spaces, particularly during shoulder months with low heating loads and homeowners possibly heating only with the DMSHP. This study did not directly capture such savings.

**Table 6. Savings Calculation Methodology for Alternative Heating/Cooling Equipment**

Baseline	Savings Methodology	Savings Adjustments
Electric Resistance	Heating savings based on total heating capacity provided by DMSHPs in winter and a difference in efficiency (1.0 COP = 3.412 HSPF)	Subtract energy use from savings estimate if use did not provide heat (e.g., defrost, standby power)
Furnace	Heating savings based on total heating capacity provided by DMSHPs in winter, converted to MMBTUs and adjusted by furnace efficiency	Subtract total electrical energy use of DMSHP from estimated fan energy use of associated furnace runtime reductions from central furnace fan
Boiler	Heating savings based on total heating capacity provided by DMSHP in winter, converted to MMBTUs and adjusted by boiler efficiency	Subtract total electrical energy use of DMSHP; assume no benefit (reduction) in boiler circulation-pump energy use.
Window AC	Same methodology used for DMSHPs (ratio of window AC AHRI EER rating to DMSHP SEER rating)	None
Central AC	Same methodology used for DMSHP (ratio of window AC AHRI EER rating to DMSHP SEER rating) with additional 15% duct losses	None

To estimate summer peak demand savings, the team determined total weather-normalized energy consumption (kWh) and savings from all meter data during the demand period and kWh by the total number of hours during the demand period. The four-hour summer demand period begins at 1:00 PM, June through August, on non-holiday weekdays. The two-hour winter demand period begins at 5:00 PM, December through January, on non-holiday weekdays. To calculate savings, the team followed the energy-savings methodology.


## Results

This section presents the evaluation’s general findings and summarizes data in the context of each research objective. The graphs and tables show results across the population of DMSHPs studied. The data underlying the graphs was derived from detailed analysis of time series of data for each system including power consumed and cooling and heating provided. Appendix D shows an example of a time series of a DMSHP.

### Load Shapes

Figure 15, Figure 16, and Figure 17 show metered units’ average power usage of for winter 2015,<sup>32</sup> summer 2015,<sup>33</sup> and winter 2016, respectively, by time of day. Average heating demand ranges from 150 to 300 watts, with a slight shape to the curve, a peak at 8:00 AM, and a small relative peak at 8:00 PM. The cooling curve shows much more shape and variation, with a relative minimum at 4:00 AM and a relative maximum at 4:00 PM. The cooling load shape displays a peak of approximately 160 watts.

Figure 15. Winter 2015 Average Power Consumption vs. Time of Day, N=99

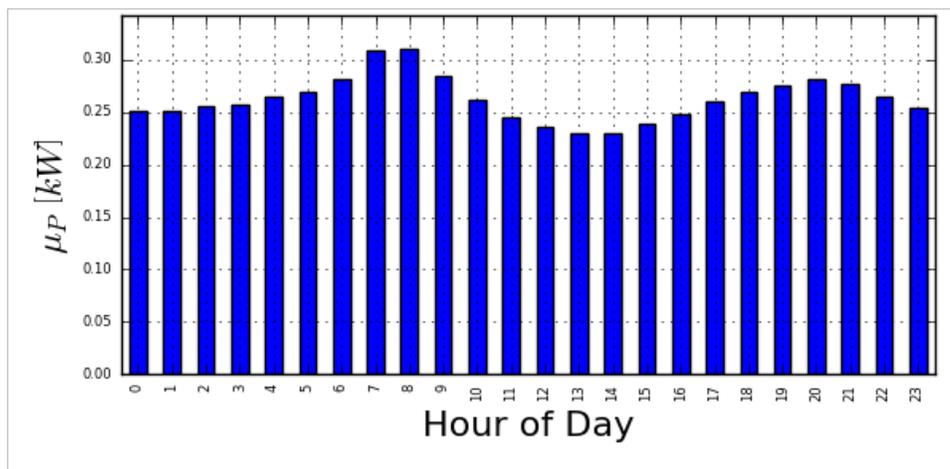

<sup>32</sup> October 15 to April 15.

<sup>33</sup> May 15 to September 30.

Figure 16. Summer 2015 Average Power Consumption vs. Time of Day, N=115

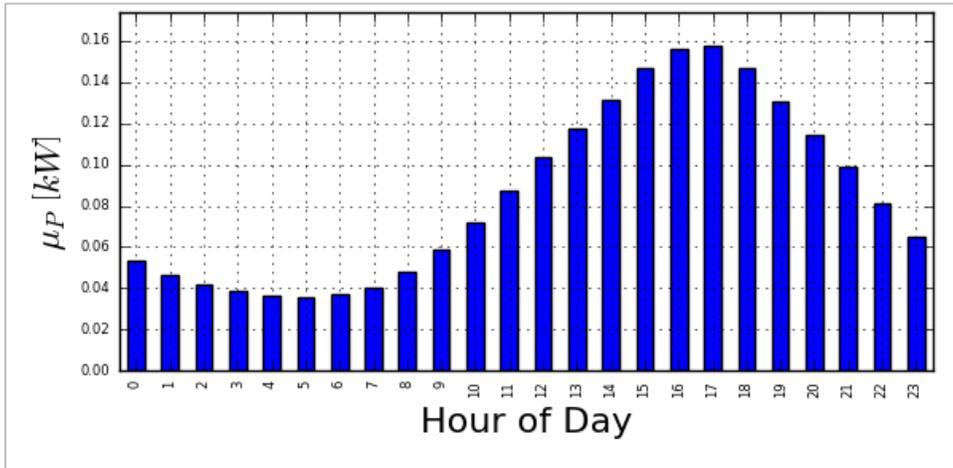


Figure 17. Winter 2016 Average Power Consumption vs. Time of Day, N=60

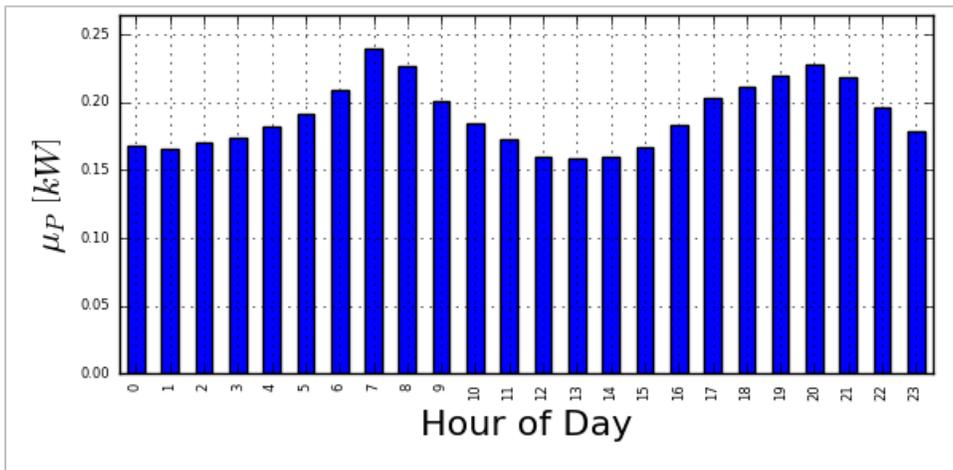


Figure 18, Figure 19, and Figure 20 present average power usage of metered units versus outdoor air temperatures for winter 2015, summer 2015, and winter 2016, respectively. This relationship proved important as efficiency (COP) and capacity of DMSHPs varied with temperatures.

Peak heating demand varied somewhat between consecutive winters. Heating demand peaked during winter 2015 at 1,500 watts, with an approximately -7 °F outside ambient temperature. The following winter, heating demand peaked at about 1,300 watts, with an approximately -5 °F outside temperature. Notably, some heating continued well below 0 °F, while some heating occurred at outdoor temperatures up to 68 °F. This behavior could result from thermal mass effects, where a house remains cool in the morning even as outdoor ambient temperatures rapidly climb.

Figure 18 and Figure 20 also show the subset of cold-climate units, which display a power-use pattern similar to the larger set of units but slightly lower for most temperature bins. This occurs for two reasons:

1. Cold climate units, with only single heads, have lower capacity, and are rated at higher efficiencies (see Table 4).
2. Cooling demand (Figure 19) increased with outside air temperatures until peaking at about 760 watts at 93 °F.

Particularly, cooling occurred down to outdoor temperatures in the 60s, which could result from thermal mass effects, where a house stays warm in the evening when outdoor temperatures rapidly drop, or from internal loads (e.g., solar).

**Figure 18. Winter 2015 Average Power Consumption While Heating vs. Outdoor Air Temperature**

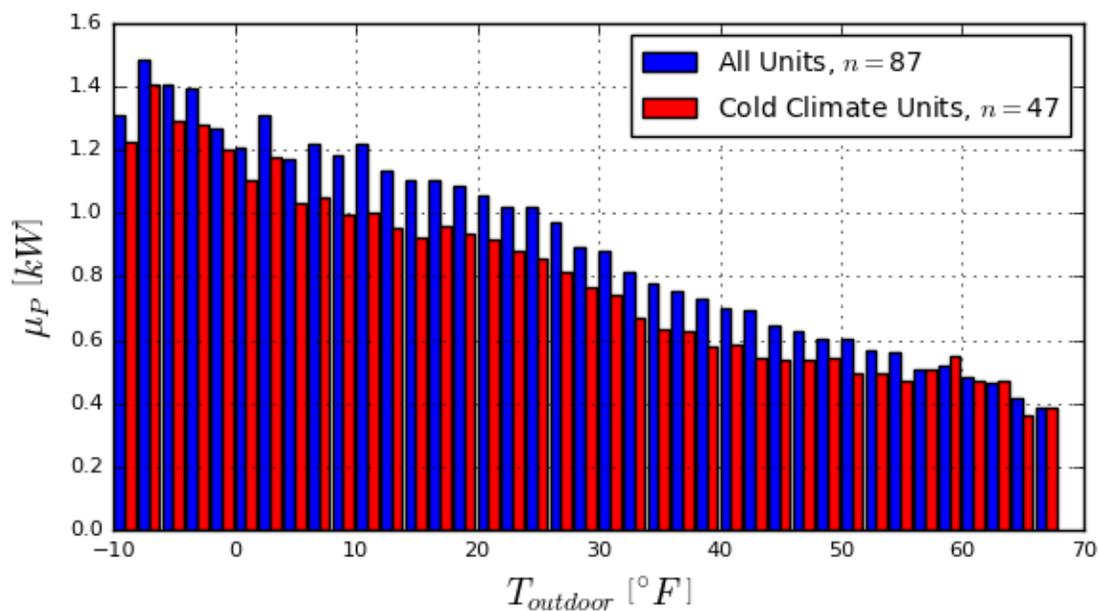


Figure 19. Summer 2015 Average Power Consumption While Cooling vs. Outdoor Air Temperature, N=114

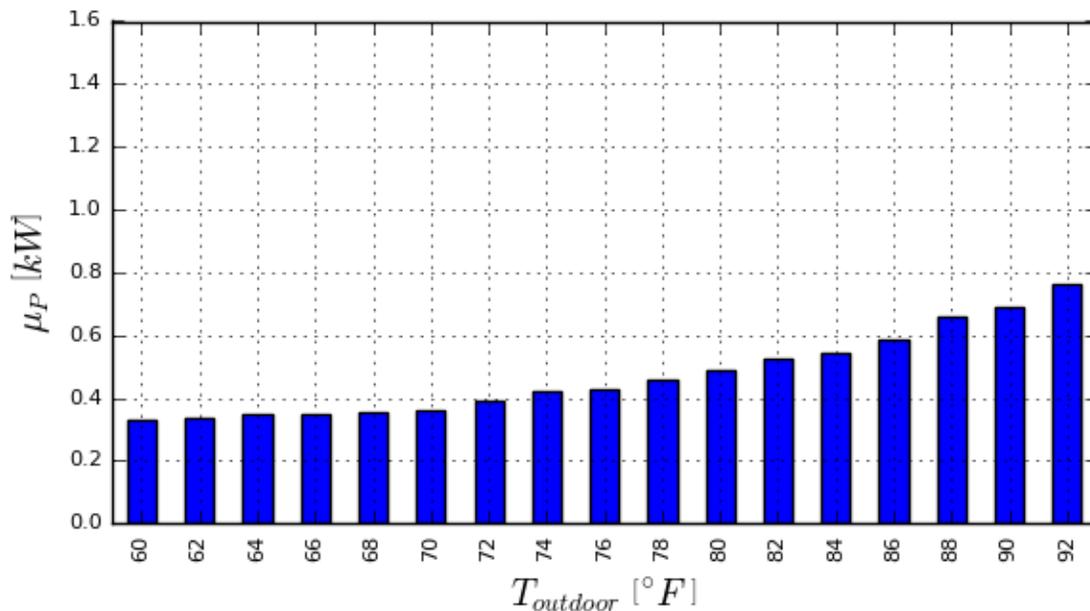


Figure 20. Winter 2016 Average Power Consumption While Heating vs. Outdoor Air Temperature, N=57

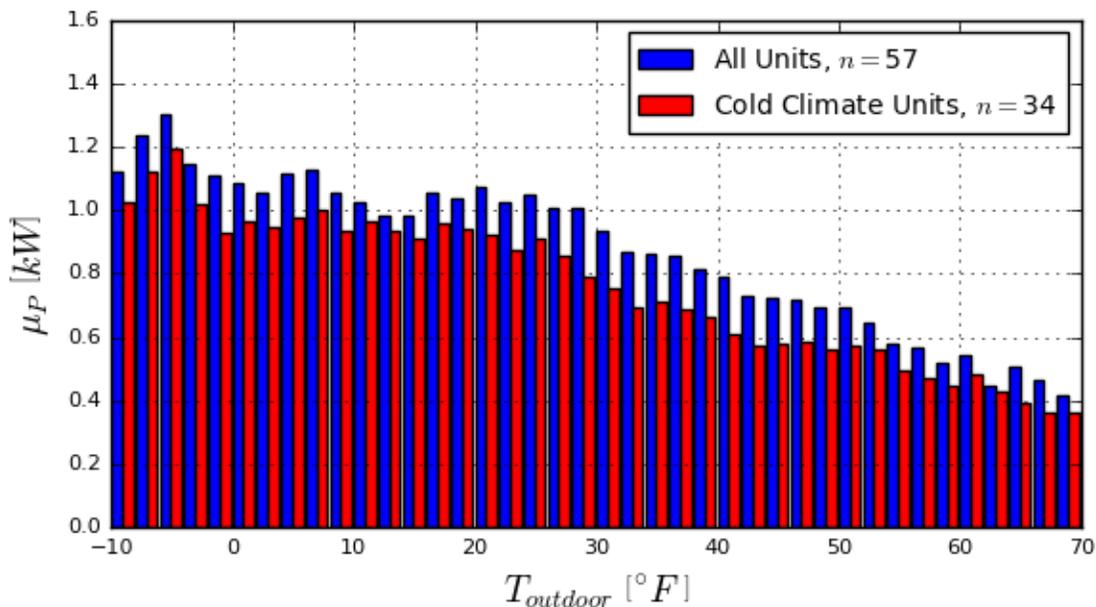


Figure 21, Figure 22, Figure 23, Figure 24, and Figure 25 show a seasonal time series of average power demand for winter 2015, summer 2015, and winter 2016 for all units and, separately, for cold climate

units. Seasonal DMSHP heating use widely varies, but not nearly as much as summer usage. During summer periods with milder outdoor temperatures, DMSHP units largely remain off. The time series graphs for all units and for cold climate units produced similar results.

Figure 21. Winter 2015 Average Power Consumption vs. Time, N=99

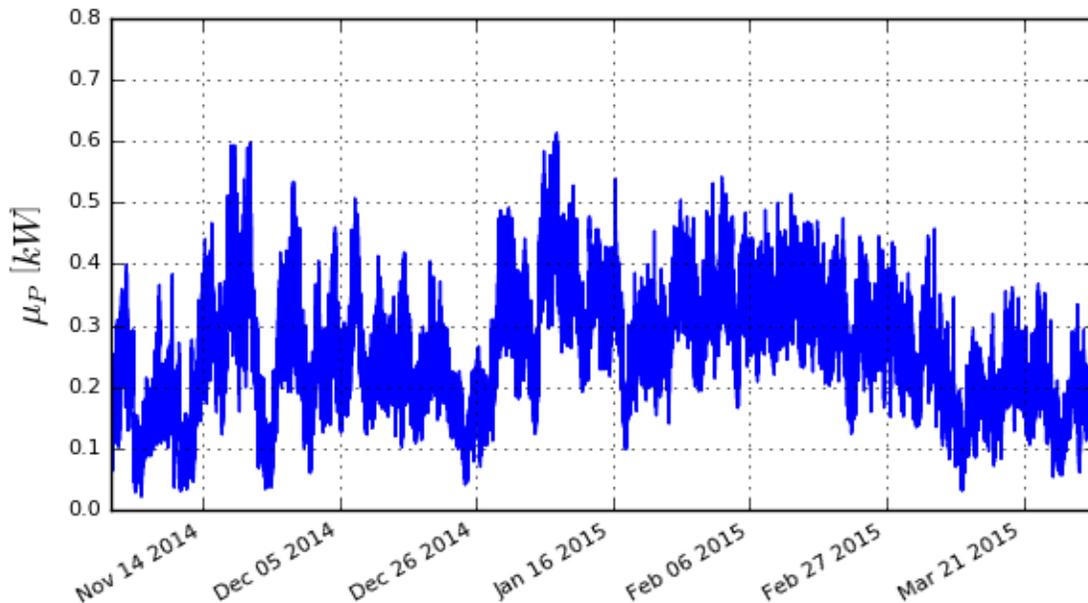


Figure 22. Winter 2015 Average Power Consumption vs. Time, N=51, Cold Climate Units

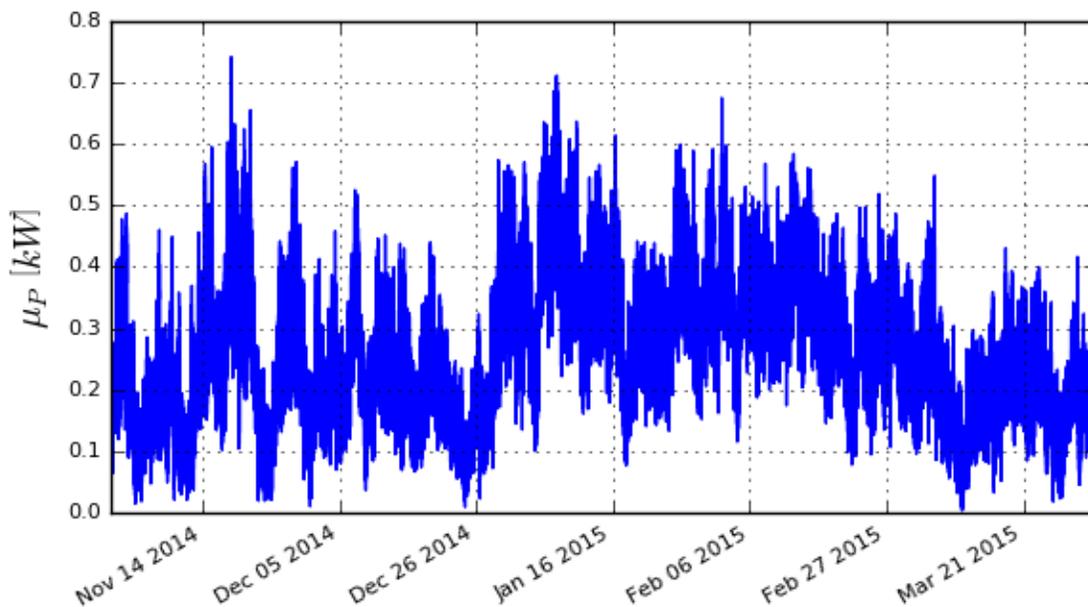


Figure 23. Summer 2015 Average Power Consumption vs. Time, N=115

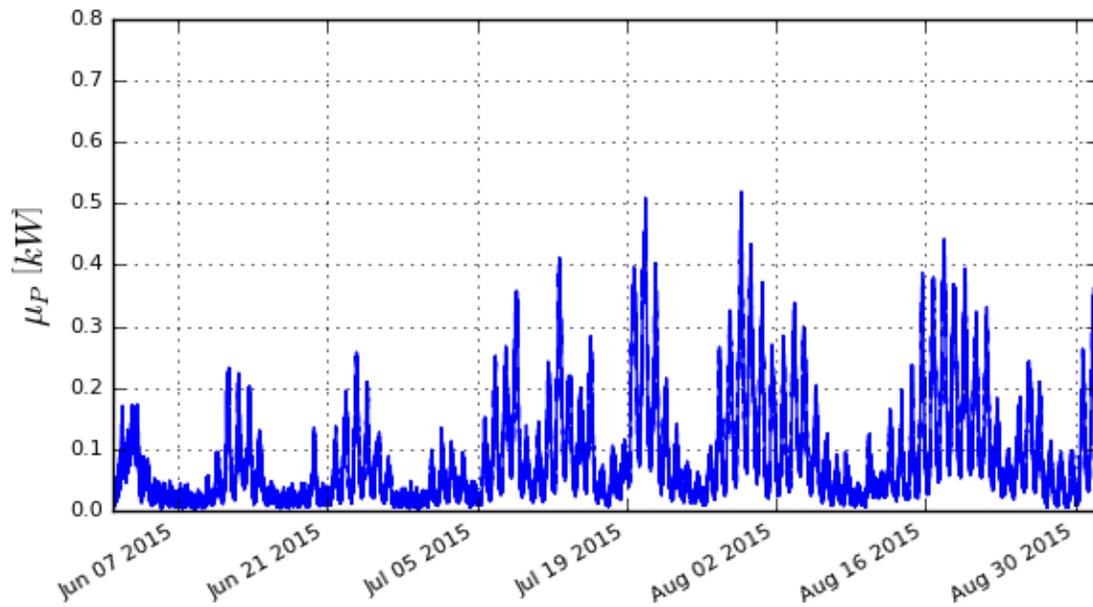


Figure 24. Winter 2016 Average Power Consumption vs. Time, N=60

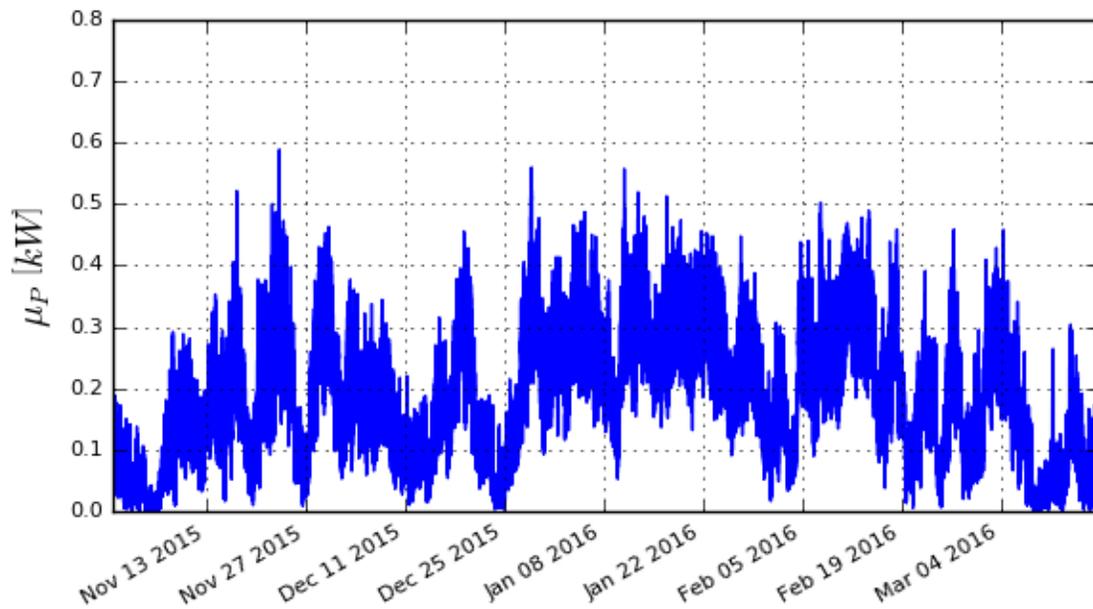


Figure 25. Winter 2016 Average Power Consumption vs. Time, N=35, Cold Climate Units

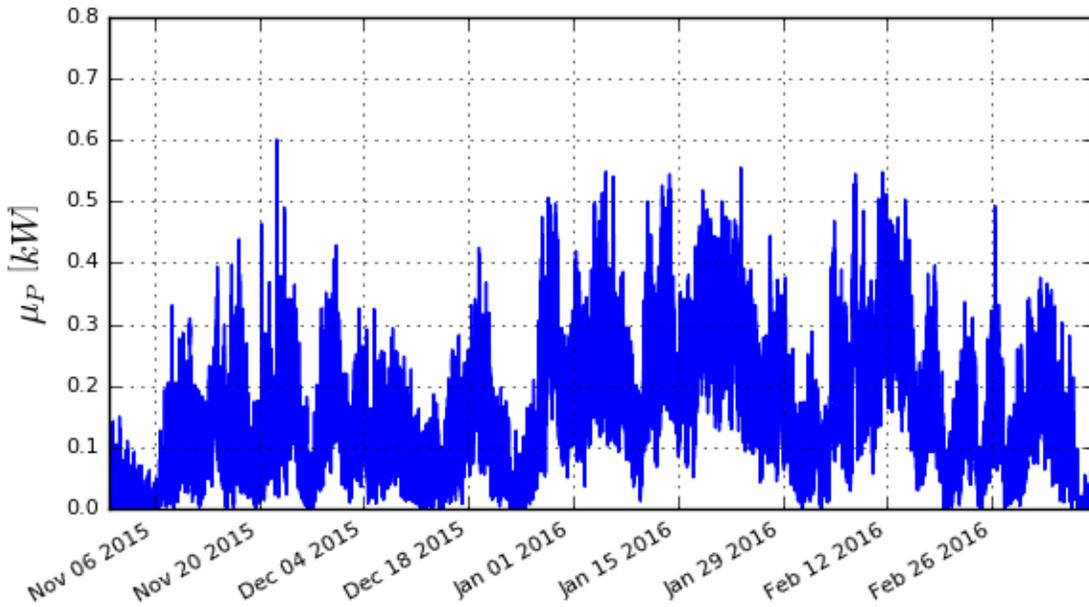


Table 7 shows units’ low coincidence factors (CF) for both summer and winter peak periods, at precisions less than 1%. Essentially, many units remained off, and those running did not operate at full capacity, resulting in low CFs.

Table 7. CFs for Peak Winter and Summer Periods

Season	Mean CF	Precision [%]
Winter 2015	0.130	0.71
Summer 2015	0.181	0.99
Winter 2016	0.120	0.94

**Operating Hours**

Table 8 shows simple run-time hours for metered DMSHPs, with a unit logged as running if its power draw exceeded a threshold standby power of 60W. Looking at the nominal heating season, the average unit ran about 27% of the time (793 hours) during 2015, and about 24% of the time (703 hours) during 2016. Note that an operating hour differs from a full-load hour in that an operating hour simply means that the unit remained on at some capacity, whereas a full-load hour indicates the unit ran at full capacity.

Table 8. Observed Run Hours for Nominal Heating and Cooling Seasons\*

Season	Example Period of Operation	Season (Days)	Season (Hours)	Mean Percent Runtime	Hours of Operation
Winter 2015	December-March	121	2,904	27.3%	793
Summer 2015	June-August	92	2,208	19.4%	428
Winter 2016	December-March	121	2,904	24.2%	703

\*The observed run times were for periods where the unit drew more than 60W (non-standby) during the stated periods.

### Equivalent Full Load Hours

EFLH—is a metric describing how long a piece of equipment operates at full capacity. For variable speed systems, such as DMSHPs, EFLH are usually much lower than actual operating hours because DMSHP run at less than full capacity much of the time. Calculated as the product of a DHMSHP’s consumption, divided by its output capacity, times its seasonal efficiency, EFLHs are much lower than values indicated in applicable Massachusetts and Rhode Island TRMs for conventional heating and cooling systems.

Several plausible reasons account for these variances:

- Not all units were used routinely or even at all for each season. Many units were lightly used or not used at all for heating or for cooling. The plots in Figure 26 illustrate this behavior, where the bottom of the box indicating the 25<sup>th</sup> percentile of the range of hours is at or very near zero for the two winters.
- Many units remain off during cooler periods in summer.
- Some units in heating mode operate coincidentally with primary systems, many of which are fossil fuel-based.
- Systems were sized much larger than cooling needs of the immediate space they served (discussed later in this report).
- TRM sources for the legacy EFLH values may be inappropriate for DMSHPs. The cooling EFLH value (360) is based on a 2009 study of central air conditioners. The heating EFLH value (1,200) is sourced from a “Massachusetts Common Assumption,” which is also used for other types of heating equipment. Both of these legacy values appear high relative to this study’s findings, supporting the theory that DMSHPs are used in different ways than conventional heating or cooling equipment

Table 9 shows the average EFLH across all units for the two heating seasons and one cooling season investigated, and compares these values with those prescribed in the Massachusetts and Rhode Island TRMs. The two heating seasons’ values (442 and 451) remain consistent with the value (447) presented in the heating memorandum from this study (October 12, 2015). The summer value (218) was roughly 15% lower than the value (259) shown in the cooling memorandum (distributed February 2016, and finalized on May 2, 2016). This reduction in the average cooling EFLH resulted from two elements:

- Use of local TMY data for this report, in contrast with statewide TMY data used in the memo
- The evaluation team removed standby power usage and off-season conditioning from this report's analysis

The right column of shows the EFLH for the top 25% of units for each seasons. These heating season values average close the TRM value and the cooling value exceeds the TRM value.

**Table 9. Average EFLH**

Season	2013-2015 MA TRM	2014 RI TRM	Average Study EFLH	Average of Top 25% of Measured EFLH
Winter 2015	1,200	1,200	442	1,275
Summer 2015	360	360	218	499
Winter 2016	1,200	1,200	451	1,117

Figure 26 presents DMSHP usage by season, shows a wide variation in units' EFLH, particularly for heating. Figure 27 shows a similar pattern for cold climate units.

**Figure 26. DMSHP EFLH vs. Season**

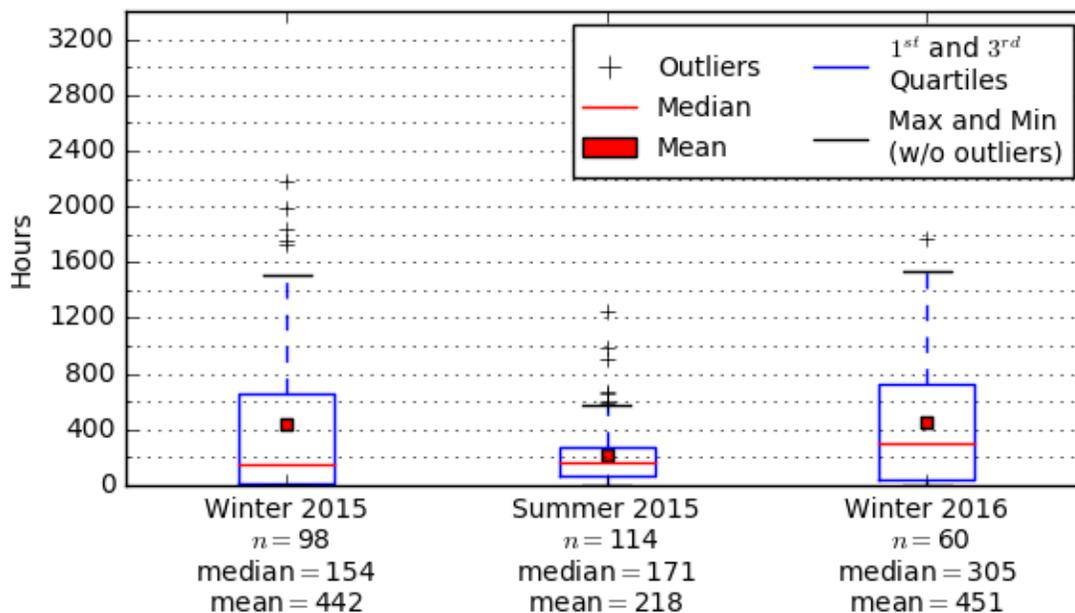


Figure 27. DMSHP EFLH vs. Season, Cold Climate Units

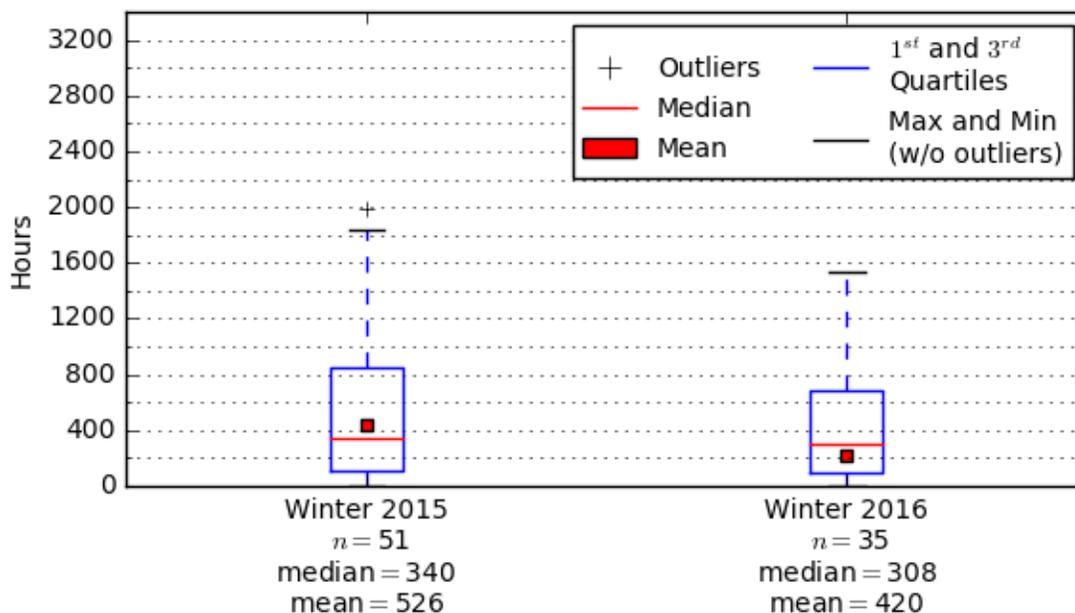


Figure 28 examines this variation more closely and shows that units purchased for “both heating and cooling” were used much more for heating than units purchased as “cooling only.” Winter 2016 was milder than winter 2015, and winter 2015 had very deep snow falls that buried units for part of the winter. Units operated more efficiently during 2016 (see Figure 52). This resulted in lower EFLH for users intending “both heating and cooling” in Winter 2016. During winter 2016, units purchased for “cooling only” saw some heating usage.

Figure 28. DMSHP EFLH vs. Purchase Intent and Season


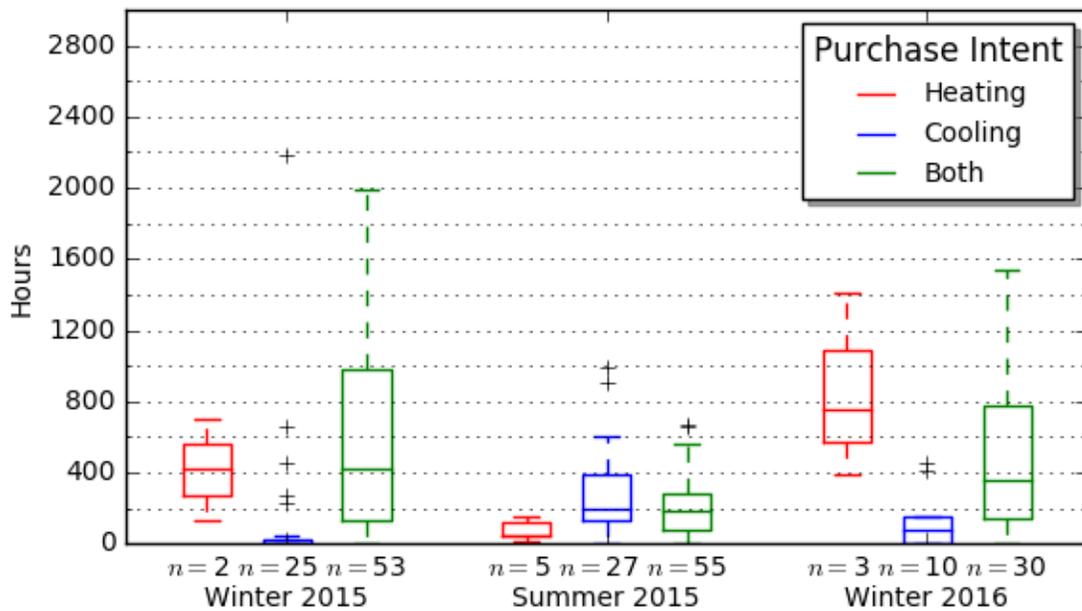


Figure 29. DMSHP EFLH vs. Purchase Intent and Season, Cold Climate Units

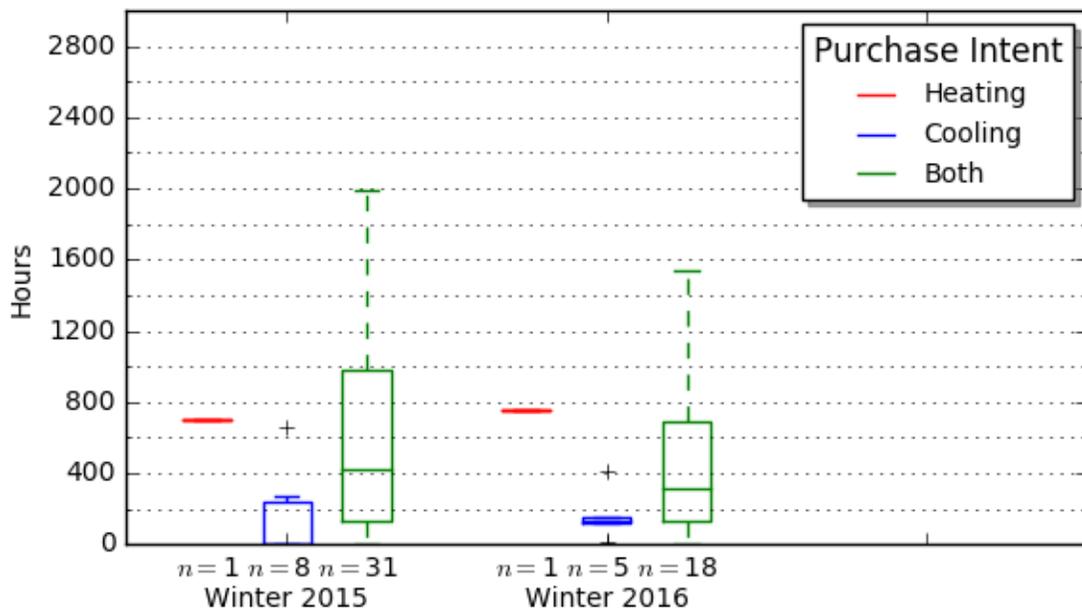

For electric savings, actual DMSHP performance was used, with the baseline unit's efficiency decremented from its nameplate rating by the same proportion that the efficient unit's performance differed from its rating. Cooling savings increased with lower-efficiency baselines. Calculation for savings

relative to a central air conditioner baseline included a 15% duct loss, which decreases net efficiency. As discussed, these savings values were based on the baseline and on the DMSHP providing the same amount of heating (and cooling); they did not include zonal savings gained in some homes.

**Table 10. Energy Savings, Each Baseline Applied to All Sites**

Season	Baseline System	Sample Size	Electric Usage of DMSHP [kWh]	Baseline Energy Reduction	Net Energy Savings	Precision at 90% Confidence [%]
Winter 2015	90% AFUE Furnace <sup>(1)</sup>	98	683	4.87 MMBtu	2.54 MMBtu	37
	85% AFUE Furnace <sup>(2)</sup>		683	5.16 MMBtu	2.83 MMBtu	36
	82% AFUE Boiler		683	4.54 MMBtu	2.21 MMBtu	39
	HSPF 7.7 DMSHP		683	907 kWh	224 kWh	21
	HSPF 8.2 DMSHP		683	851 kWh	168 kWh	21
	Electric Resistance		683	1,092 kWh	409 kWh	48
Summer 2015	EER 9.8 Window AC	114	159	213 kWh	54 kWh	15
	SEER 13.0 Central AC		159	288 kWh	129 kWh	14
	SEER 13.0 DMSHP		159	245 kWh	86 kWh	14
	SEER 14.5 DMSHP		159	220 kWh	61 kWh	15
Winter 2016	90% AFUE Furnace	60	763	6.9 MMBtu	4.3 MMBtu	37
	85% AFUE Furnace <sup>(2)</sup>		763	7.31 MMBtu	4.7 MMBtu	36
	82% AFUE Boiler		763	6.44 MMBtu	3.83 MMBtu	37
	HSPF 7.7 DMSHP		763	989 kWh	226 kWh	22
	HSPF 8.2 DMSHP		763	929 kWh	166 kWh	23
	Electric Resistance		763	1,547 kWh	784 kWh	42

<sup>(1)</sup> Duct losses were assumed as 15%.

<sup>(2)</sup> Baseline efficiency prescribed by relevant Massachusetts (2013–2015) and Rhode Island (2015) TRMs applicable when beginning this study.

Table 11 shows average winter<sup>34</sup> and summer<sup>35</sup> peak demand savings. The evaluation team calculated peak savings as follows:

- Calculating energy savings during respective summer and winter peak periods.
- Dividing savings by peak hours to yield average peak demand savings.

As with consumption savings, electrical resistance heating provided the highest savings; these declined with the baseline unit's increasing efficiency.

<sup>34</sup> The MA (2016–2018) and RI (2016) TRMs defined winter peak as 5:00 PM to 7:00 PM on non-holiday weekdays in December and January.

<sup>35</sup> The MA (2016–2018) and RI (2016) TRMs defined summer peak as 1:00 PM to 5:00 PM on non-holiday weekdays in June, July, and August.

**Table 11. Peak Demand Savings, Each Baseline Applied to All Sites**

Season	Baseline System	Sample Size	Electric Usage of DMSHP [kW]	Baseline Power Reduction [kW]	Average Peak Period Demand Savings [kW]	Precision at 90% Confidence [%]
Winter 2015	90% AFUE Furnace	98	0.21	0	-0.21	33
	85% AFUE Furnace		0.21	0	-0.21	33
	82% AFUE Boiler		0.21	0	-0.21	33
	HSPF 7.7 DMSHP		0.21	0.28	0.07	22
	HSPF 8.2 DMSHP		0.21	0.26	0.05	22
	Electric Resistance		0.21	0.33	0.12	43
Summer 2015	EER 9.8 Window AC	114	0.11	0.15	0.04	16
	SEER 13.0 Central AC		0.11	0.20	0.09	15
	SEER 13.0 DMSHP		0.11	0.05	0.06	15
	SEER 14.5 DMSHP		0.11	0.07	0.04	15
Winter 2016	90% AFUE Furnace	60	0.25	0	-0.25	34
	85% AFUE Furnace		0.25	0	-0.25	34
	82% AFUE Boiler		0.25	0	-0.25	34
	HSPF 7.7 DMSHP		0.25	0.33	0.08	24
	HSPF 8.2 DMSHP		0.25	0.31	0.06	25
	Electric Resistance		0.25	0.58	0.33	38

We did not assume electricity credit for reducing the operation of a baseline furnace fan or boiler pump. This results in a conservative assumption as some reduction in fan and pump use likely occurred. Without conducting a pre-post DMSHP study, identifying the timing and amount of that reduction proves difficult. On average, a standard boiler pump uses about 120 kWh per year,<sup>36</sup> and a fan uses about 440 kWh<sup>37</sup> per year for heating. Where a DMSHP can be used as the primary heating source, this electricity use could be substantially reduced, increasing consumption and demand savings, and decreasing DMSHP net electricity use.

As in Table 10, Table 12 shows savings for each baseline, but it applies the baseline only to homes that indicated that specific baseline, based on survey responses. Sample sizes were much smaller than those used in Table 10, and relative precisions were much larger (worse). Calculating the savings this way drew upon several stakeholder’s hypotheses that users would behave differently due to different survey responses. The evaluation team suggests variability in usage is already very high, and that dividing the population into small subpopulations based on these survey responses does not yield meaningful information. Savings were generally lower, though much higher for electrical resistance heat.

<sup>36</sup> Boiler pump study

<sup>37</sup> AHRI average = 365W/ 1,000 CFM. At 1,200 CFM and 1,000 run time hours, this is 438 kWh.

**Table 12. Energy Savings, Baseline Applied Based on Survey Responses and Existing Systems**

Season	Baseline System	Sample Size	Electric Usage of DMSHP [kWh]	Baseline Energy Reduction	Average Energy Savings	Precision at 90% Confidence [%]
Winter 2015	90% AFUE Furnace	10	702	3.79 MMBtu	1.39 MMBtu	120
	85% AFUE Furnace	10	702	4.01 MMBtu	1.62 MMBtu	109
	82% AFUE Boiler	27	786	5.51 MMBtu	2.83 MMBtu	68
	HSPF 7.7 DMSHP	37	425	588 kWh	163 kWh	41
	HSPF 8.2 DMSHP	37	425	552 kWh	127 kWh	42
	Electric Resistance	3	732	1,130 kWh	398 kWh	334
Summer 2015	EER 9.8 Window AC	9	306	399 kWh	93 kWh	33
	SEER 13.0 Central AC	7	103	198 kWh	95 kWh	50
	SEER 13.0 DMSHP	38	189	292 kWh	103 kWh	26
	SEER 14.5 DMSHP	38	189	262 kWh	73 kWh	27
Winter 2016	90% AFUE Furnace	6	306	3.86 MMBtu	2.82 MMBtu	104
	85% AFUE Furnace	6	306	4.09 MMBtu	3.05 MMBtu	104
	82% AFUE Boiler	14	1,056	9.78 MMBtu	6.17 MMBtu	82
	HSPF 7.7 DMSHP	16	511	687 kWh	176 kWh	55
	HSPF 8.2 DMSHP	16	511	645 kWh	134 kWh	58
	Electric Resistance	2	1,202	2,980 kWh	1,778 kWh	35

Table 13 shows the average winter<sup>38</sup> and summer<sup>39</sup> peak demand savings for the same survey-based baseline. The demand savings generally were lower than in Table 11, but relative precision values were much higher (worse).

**Table 13. Peak Demand Savings, Baseline Applied Based on Survey Responses and Existing Systems**

Season	Baseline System	Sample Size	Electric Usage of DMSHP [kW]	Baseline Power Reduction [kW]	Average Peak Period Demand Savings [kW]	Precision at 90% Confidence [%]
Winter 2015	90% AFUE Furnace	10	0.28	0	-0.28	53
	85% AFUE Furnace	10	0.28	0	-0.28	53
	82% AFUE Boiler	27	0.25	0	-0.25	38
	HSPF 7.7 DMSHP	37	0.12	0.16	0.04 kW	48
	HSPF 8.2 DMSHP	37	0.12	0.15	0.03 kW	48
	Electric Resistance	3	0.16	0.31	0.15 kW	208

<sup>38</sup> The Massachusetts (2016–2018) and Rhode Island (2016) TRMs defined winter peak as 5:00 PM to 7:00 PM on non-holiday weekdays in December and January.

<sup>39</sup> The Massachusetts (2016–2018) and Rhode Island (2016) 2016–2018 TRMs defined summer peak as 1:00 PM to 5:00 PM on non-holiday weekdays in June, July, and August.

Season	Baseline System	Sample Size	Electric Usage of DMSHP [kW]	Baseline Power Reduction [kW]	Average Peak Period Demand Savings [kW]	Precision at 90% Confidence [%]
Summer 2015	EER 9.8 Window AC	9	0.18	0.23	0.05 kW	40
	SEER 13.0 Central AC	7	0.09	0.17	0.08 kW	58
	SEER 13.0 DMSHP	38	0.13	0.20	0.07 kW	27
	SEER 14.5 DMSHP	38	0.13	0.18	0.05 kW	28
Winter 2016	90% AFUE Furnace	6	0.16	0	-0.16	100
	85% AFUE Furnace	6	0.16	0	-0.16	100
	82% AFUE Boiler	14	0.31	0	-0.31	49
	HSPF 7.7 DMSHP	16	0.17	0.23	0.06 kW	52
	HSPF 8.2 DMSHP	16	0.17	0.21	0.04 kW	53
	Electric Resistance	2	0.46	1.13	0.67 kW	69

To examine the practical potential savings achievable by DMSHPs used more frequently, the evaluation team examined sites in the top 25%, based on savings (which in turn were correlated with higher usage). Table 14 shows savings for this subpopulation, indicating savings were much higher than the mean, as expected mathematically, but in practical terms, these savings would be expected upon removing units lightly used or not used. Relative precision rates were relatively high, given the small sample size.

**Table 14. Energy Savings, Each Baseline Applied to All Sites, Top 25%**

Season	Baseline System	Sample Size	Electric Usage of DMSHP [kWh]	Baseline Energy Reduction	Average Energy Savings	Precision at 90% Confidence [%]
Winter 2015	90% AFUE Furnace	25	1,414	14.7 MMBtu	9.84 MMBtu	22
	85% AFUE Furnace		1,414	15.5 MMBtu	10.70 MMBtu	22
	82% AFUE Boiler		1,414	13.1 MMBtu	8.86 MMBtu	22
	HSPF 7.7 DMSHP		1,894	2,536 kWh	642 kWh	10
	HSPF 8.2 DMSHP		1,894	2,382 kWh	488 kWh	11
	Electric Resistance		1,414	3,287 kWh	1,873 kWh	24
Summer 2015	EER 9.8 Window AC	29	358	484 kWh	126 kWh	12
	SEER 13.0 Central AC		371	663 kWh	292 kWh	11
	SEER 13.0 DMSHP		363	556 kWh	193 kWh	12
	SEER 14.5 DMSHP		332	468 kWh	136 kWh	14
Winter 2016	90% AFUE Furnace	15	1,566	18.68 MMBtu	13.34 MMBtu	30
	85% AFUE Furnace		1,566	19.78 MMBtu	14.44 MMBtu	30
	82% AFUE Boiler		1,566	17.43 MMBtu	12.09 MMBtu	31
	HSPF 7.7 DMSHP		1,862	2,433 kWh	571 kWh	13
	HSPF 8.2 DMSHP		1,761	2,184 kWh	423 kWh	15
	Electric Resistance		1,566	4,188	2,622 kWh	33

Similarly, Table 15 shows demand savings for the top 25% of sites.

**Table 15. Peak Demand Savings, Each Baseline Applied to All Sites, Top 25%**

Season	Baseline System	Sample Size	Electric Usage of DMSHP [kW]	Baseline Power Reduction [kW]	Average Peak Period Demand Savings [kW]	Precision at 90% Confidence [%]
Winter 2015	HSPF 7.7 DMSHP	25	0.62	0.82	0.20 kW	13
	HSPF 8.2 DMSHP		0.56	0.70	0.14 kW	14
	Electric Resistance		0.47	1.02	0.55 kW	19
Summer 2015	EER 9.8 Window AC	29	0.24	0.33	0.09 kW	13
	SEER 13.0 Central AC		0.25	0.45	0.20 kW	11
	SEER 13.0 DMSHP		0.23	0.36	0.13 kW	12
	SEER 14.5 DMSHP		0.22	0.31	0.09 kW	13
Winter 2016	HSPF 7.7 DMSHP	15	0.61	0.80	0.19 kW	12
	HSPF 8.2 DMSHP		0.61	0.76	0.15 kW	15
	Electric Resistance		0.54	1.64	1.1 kW	26

Using baselines weighted from the previously published baseline memorandum, the evaluation team calculated average weighted savings for each of the three studied seasons, calculated for a single and a weighted baseline (as shown in Table 16). In general, winter 2016, with data unaffected by 2015's large

snowfalls, realized higher savings. The specific baselines show savings similar to or somewhat higher than the single baselines. Table 17 shows the non-fuel switching savings, which were far lower than fuel switching because baseline DMSHP savings are lower than those from fuel heating.

Table 16. Weighted Average Savings, Fuel Switching

Fuel Switching					Single baseline						Specific baseline					
Season	Baseline System	Base Eff.	Efficiency Metric	Savings Units	n	Mean Savings	Mean Savings [kWh]	Population with Baseline [%]	Expected Baseline Savings [kWh]	Precision [%]	Sample Size	Mean Savings	Mean Savings [kWh]	Pop. with Baseline [%]	Expected Baseline Savings [kWh]	Precision [%]
Winter 2015	Furnace	0.85	AFUE	MMBtu	98	2.83	829	13%	108	36	10	1.62	475	13%	62	109
	Boiler	0.82	AFUE	MMBtu		2.21	648	35%	227	39	27	2.83	829	35%	291	68
	ER	1	COP	kWh		409	409	4%	16	48	3	398	398	4%	15	334
	DHP	7.7	HSPF	kWh		224	224	48%	108	21	37	163	163	48%	78	41
	Weighted Total							100%	458	31				100%	446	71
Summer 2015	Window AC	9.8	EER	kWh	114	54	54	17%	9	15	9	93	93	17%	16	33
	CAC	13	SEER	kWh		129	129	13%	17	14	7	95	95	13%	12	50
	DHP	13	SEER	kWh		86	86	70%	61	14	38	103	103	70%	72	26
	Weighted Total							100%	86	14				100%	100	30
Winter 2016	Furnace	0.85	AFUE	MMBtu	60	4.70	1378	16%	218	36	6	3.05	894	16%	141	103
	Boiler	0.82	AFUE	MMBtu		3.83	1123	37%	414	37	14	6.17	1808	37%	666	82
	ER	1	COP	kWh		784	784	5%	41	42	2	1778	1778	5%	94	35
	DHP	7.7	HSPF	kWh		226	226	42%	95	22	16	176	176	42%	74	55
	Weighted Total							100%	768	31				100%	975	71

Table 17. Weighted Average Savings, Non-Fuel Switching

Non Fuel Switching					Single Baseline						Specific Baseline					
Season	Baseline System	Base Eff.	Efficiency Metric	Savings Units	n	Mean Savings	Mean Savings [kWh]	Pop. with Baseline [%]	Expected Baseline Savings [kWh]	Precision [%]	Sample Size	Mean Savings	Mean Savings [kWh]	Pop. with Baseline [%]	Expected Baseline Savings [kWh]	Precision [%]
Winter	ER	1	COP	kWh	98	409	409	8%	31	48	3	398	398	8%	30	334
	DHP	7.7	HSPF	kWh		224	224	93%	207	21	37	163	163	93%	150	41
	Weighted Total							100%	238	23					100%	180
Summer 2015	Window AC	9.8	EER	kWh	114	54	54	17%	9	15	9	93	93	17%	16	33
	CAC	13	SEER	kWh		129	129	13%	17	14	7	95	95	13%	12	50
	DHP	13	SEER	kWh		86	86	70%	61	14	38	103	103	70%	72	26
	Weighted Total							100%	86	14					100%	100
Winter	ER	1	COP	kWh	60	784	784	11%	87	42	2	1778	1778	11%	198	35
	DHP	7.7	HSPF	kWh		226	226	89%	201	22	16	176	176	89%	156	55
	Weighted Total							100%	288	25					100%	354

## Performance

Figure 30 and Figure 31 show measured or “field” HSPFs and SEERs for the two observed winters and one summer, for all units and for cold-climate units. The evaluation team based these values on metered heating and cooling provided, divided by power consumed. The values widely varied, but generally fell below the nameplate rating. This variation occurred for several reasons:

- In contrast to central systems, which operate throughout a season, homeowners use DMSHPs in highly variable ways, which affects efficiency. For example, if homeowner only used a DMSHP to cool on the hottest days, its cooling efficiency would be closer to its rated EER value (i.e., the efficiency rating at 95 °F outside ambient temperature) rather than its SEER value.
- SEER and EER tests run at specific conditions that may not fully represent actual operating behaviors or conditions. For example, the SEER rating test stipulates return air at 80 °F—a temperature much warmer than most homeowners would generally keep their spaces. This test’s original intent might have been to simulate heat gain in return ducts, which obviously does not apply for DMSHP units.
- Units used for other functions can reduce rated performance. These functions may include the following:
  - Fan-only mode
  - Dry or dehumidification mode—dehumidification may actually help displace cooling, but the team did not estimate savings for this mode (see Savings section)
  - Standby power
  - Defrost mode
  - Drip-pan heat use

These values could not be directly compared with the nameplate ratings of central systems (e.g., a SEER 14.0 central air conditioner) as central units would experience lower-than-rated performance for some of the reasons stated above (as well as for other reasons such as unwanted heat loss or gain through duct distribution systems). The team directly measured DMSHP efficiencies at rates lower than their ratings, and decremented the efficiencies of AC and HP systems’ baseline efficiencies a similar amount below the rating.

Figure 30. Measured Seasonal Efficiencies

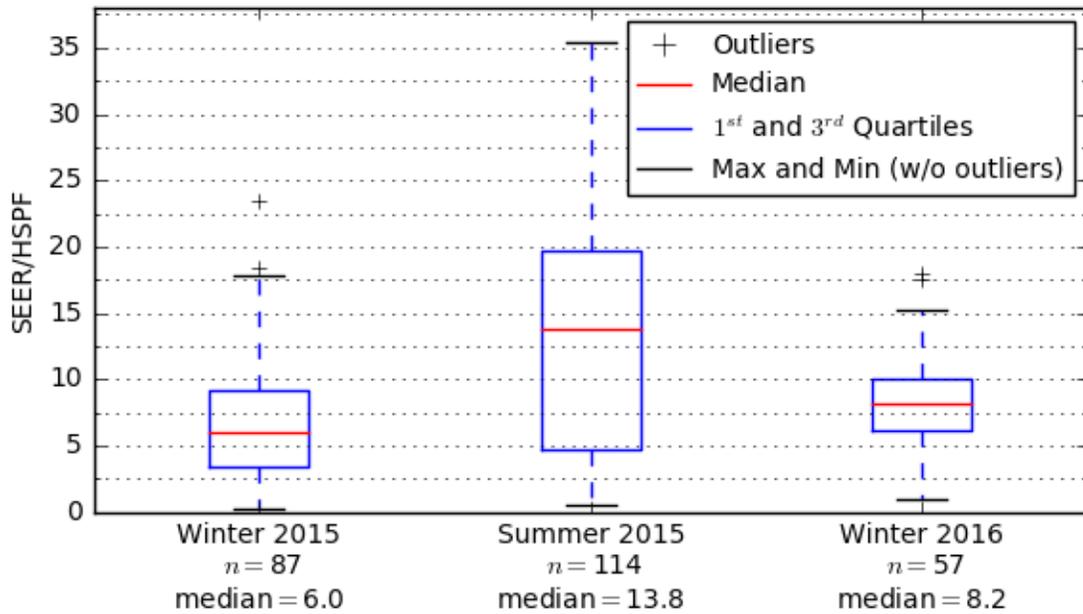


Figure 31. Measured Seasonal Efficiencies, Cold Climate Units

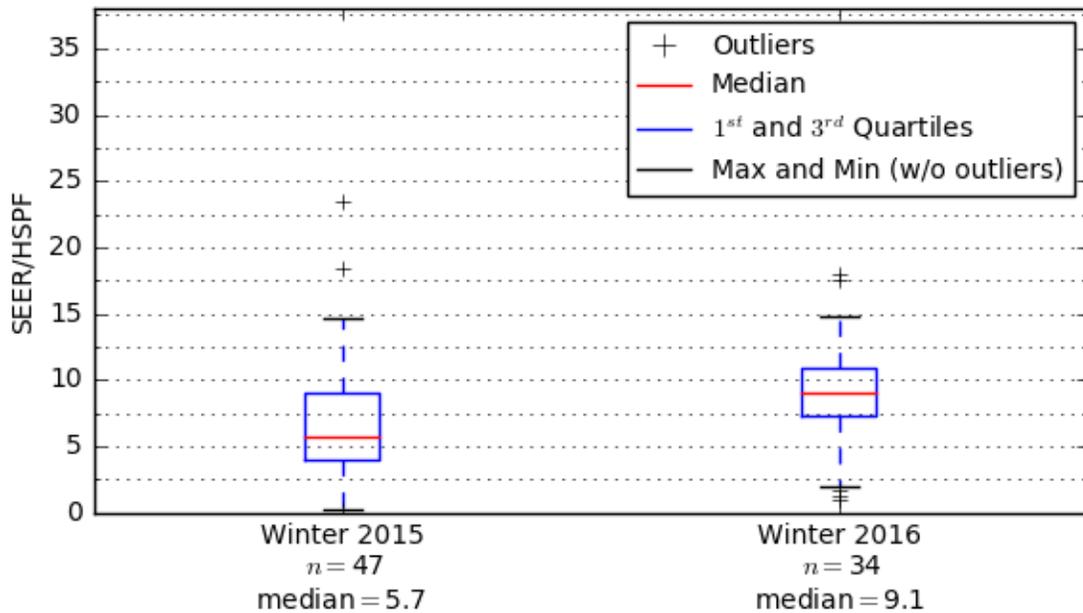


Figure 32. Winter 2015 Measured HSPF vs. EFLH, N=86

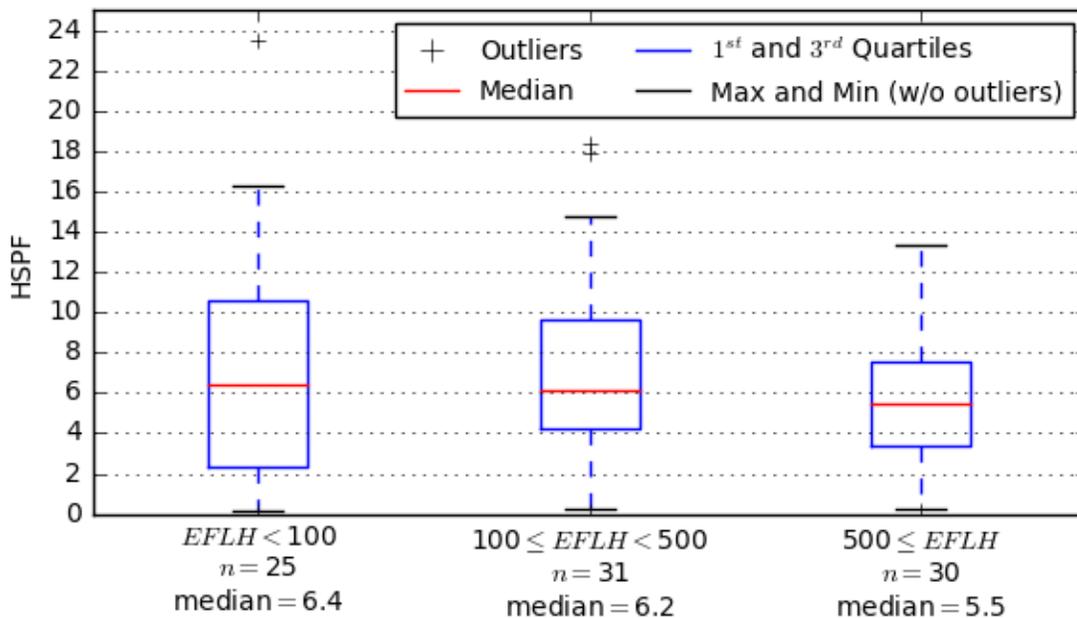


Figure 33. Summer 2015 Measured SEER vs. EFLH, N=113

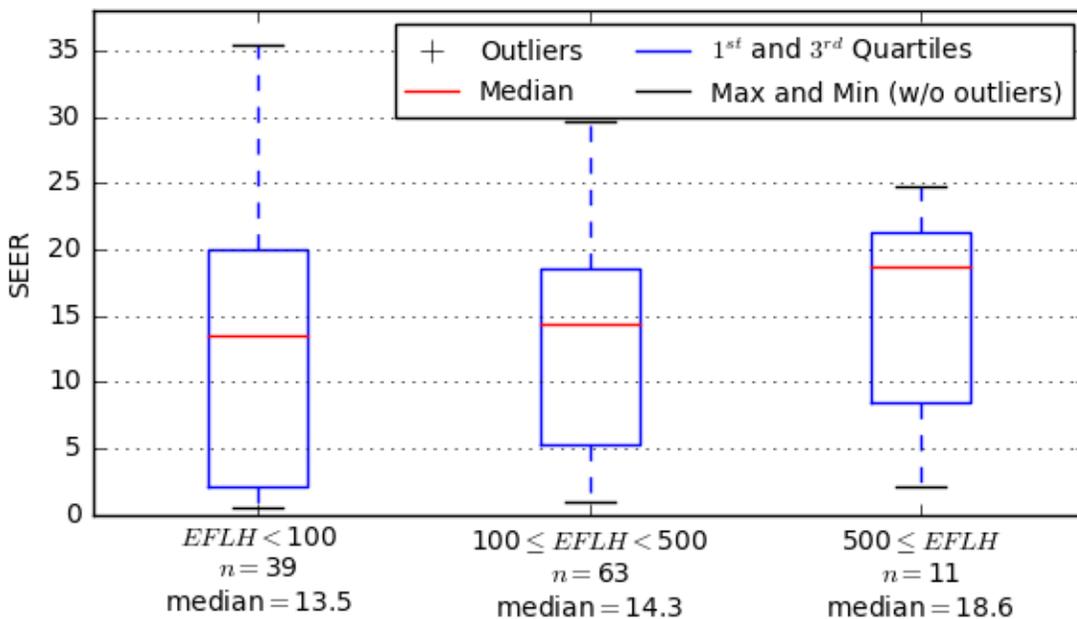


Figure 320 and Figure 341 show a substantial increase in HSPF from winter 2015 to winter 2016. This increase could result from variations in snowfall between the two winters; these can obstruct the

outdoor unit’s airflow. The top 25% of the units used lightly (<100 EFLH) and heavily (>500 EFLH) both approached or exceeded a 10.0 HSPF—the average rating of metered units.

**Figure 34. Winter 2016 Measured HSPF vs. EFLH, N=57**

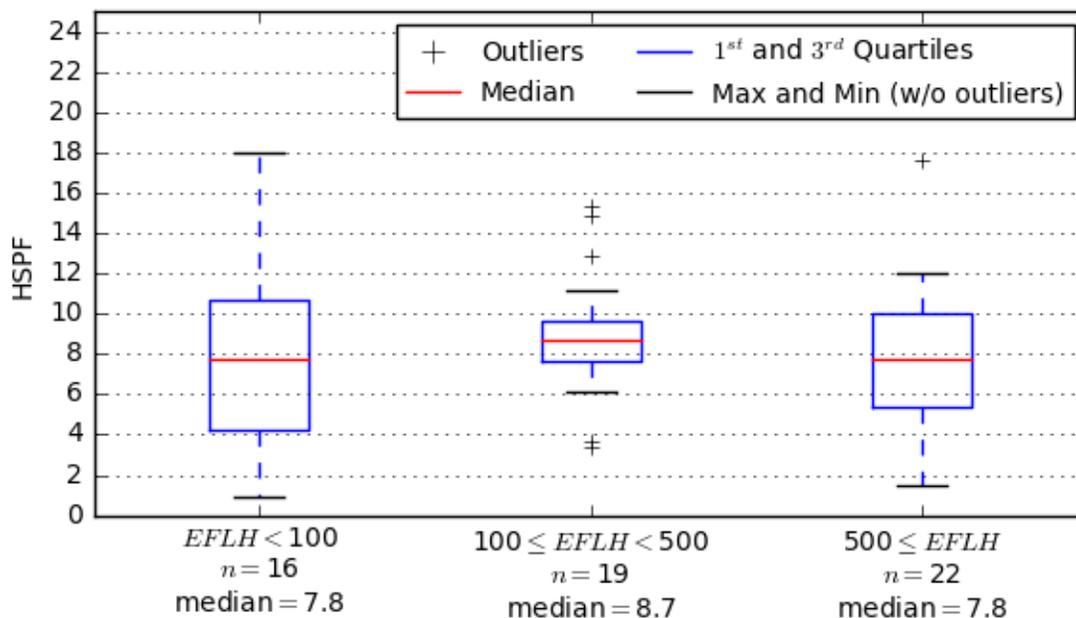


Figure 352 through Figure 40 present DMSHP efficiency plots by the number of indoor heads per outdoor unit and by EFLH. The efficiency range in these plots tightened when moving from one head to three heads, but this likely resulted from the decreasing sample size with an increasing number of heads. Efficiency appeared to decrease somewhat with an increasing number of heads, but partly resulted from the lower ratings of these multi-head systems. For single-head units, the 75<sup>th</sup> percentile of SEER (20.0) was near the average rated value. For winter 2016, the 75<sup>th</sup> percentile of HSPF was well above 10.0 for single-head units.

Figure 35. Winter 2015 HSPF vs. System Configuration, N=87

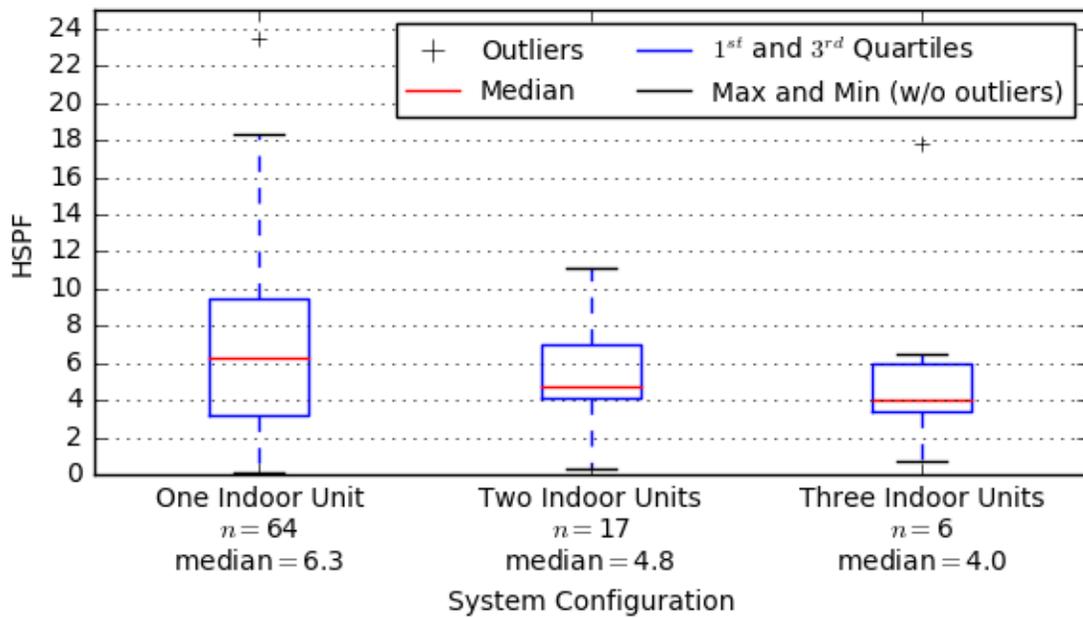


Figure 36. Summer 2015 SEER vs. System Configuration, N=114

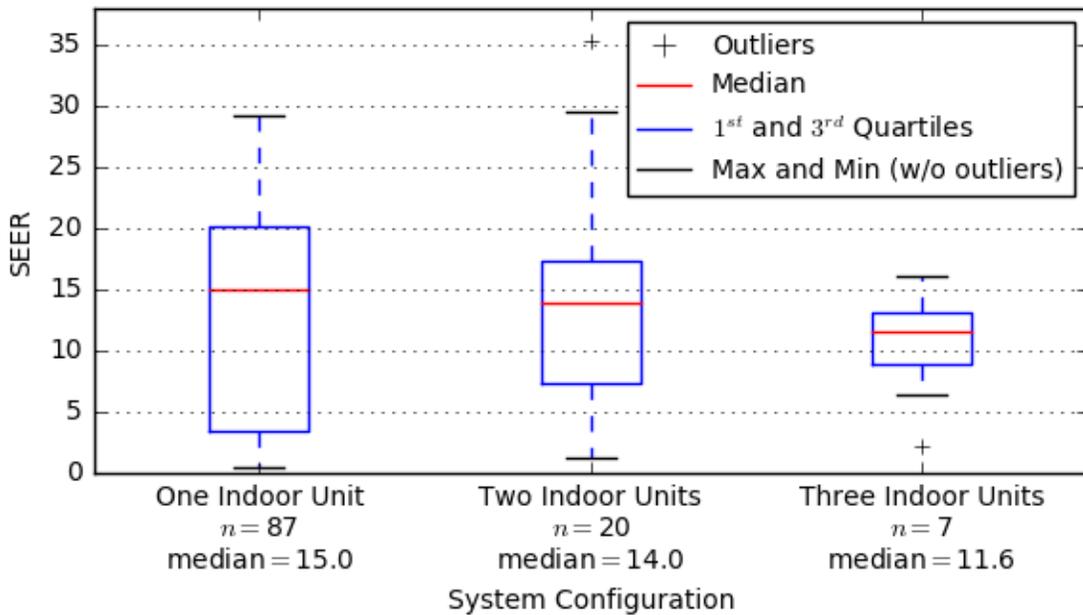


Figure 37. Winter 2016 HSPF vs. System Configuration, N=57

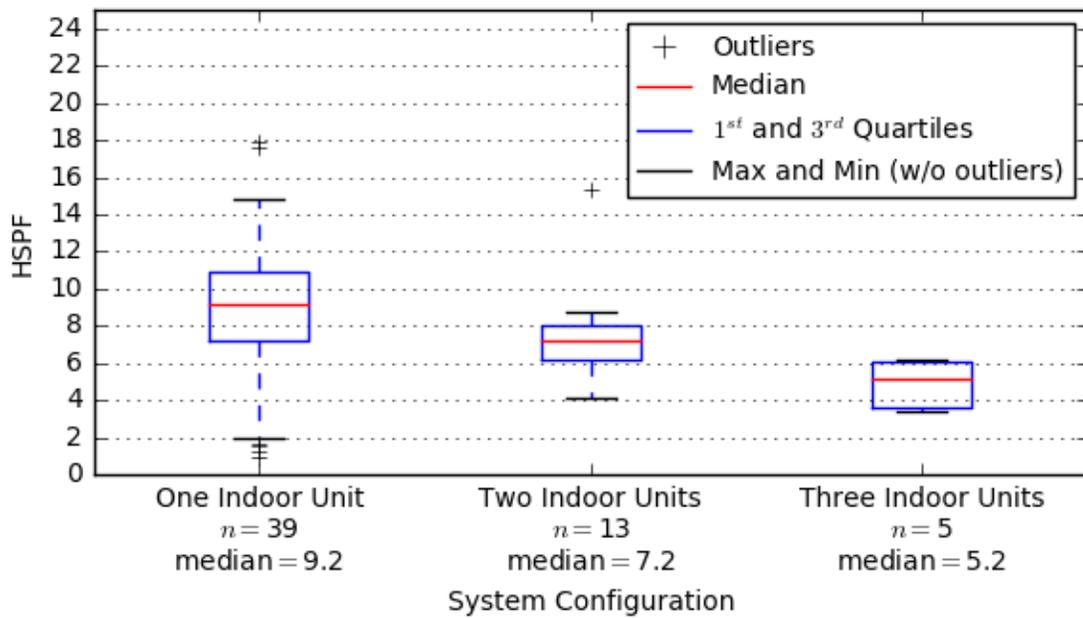


Figure 38. Winter 2015 HSPF vs. System Configuration and Usage, N=86

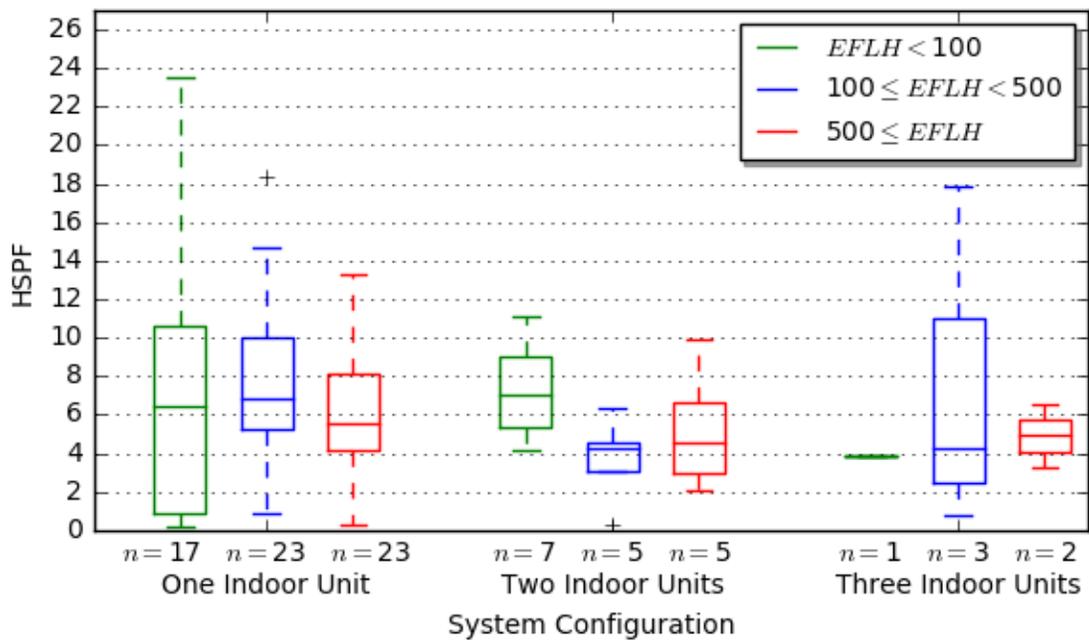


Figure 39. Summer 2015 SEER vs. System Configuration and Usage, N=113


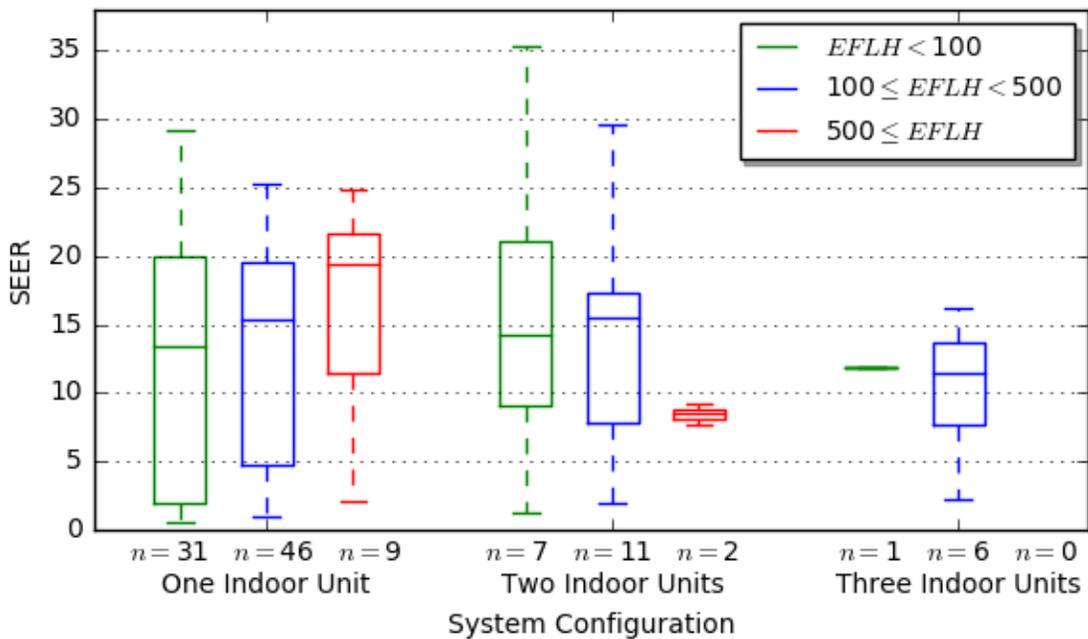


Figure 40. Winter 2016 HSPF vs. System Configuration and Usage, N=57

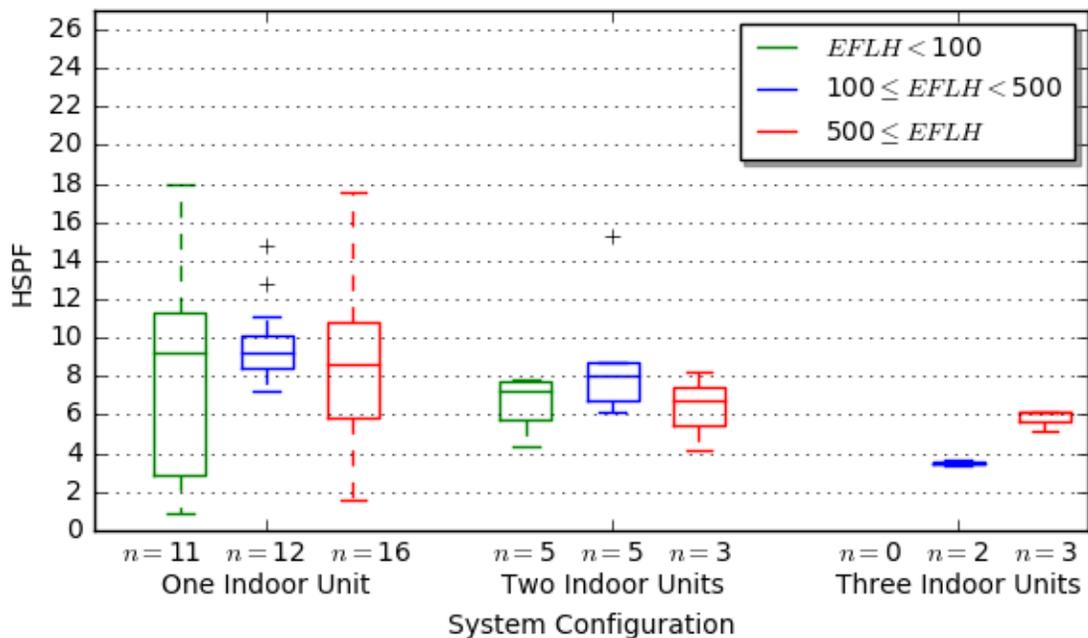

Units purchased for “cooling only” exhibited the highest measured SEER values, with the 75<sup>th</sup> percentile well above 20.0. A similar link did not become apparent between purchase intent and measured HSPF (see Figure 41). The same held true for cold climate units (see Figure 42).

Figure 41. Seasonal Efficiencies vs. Purchase Intent

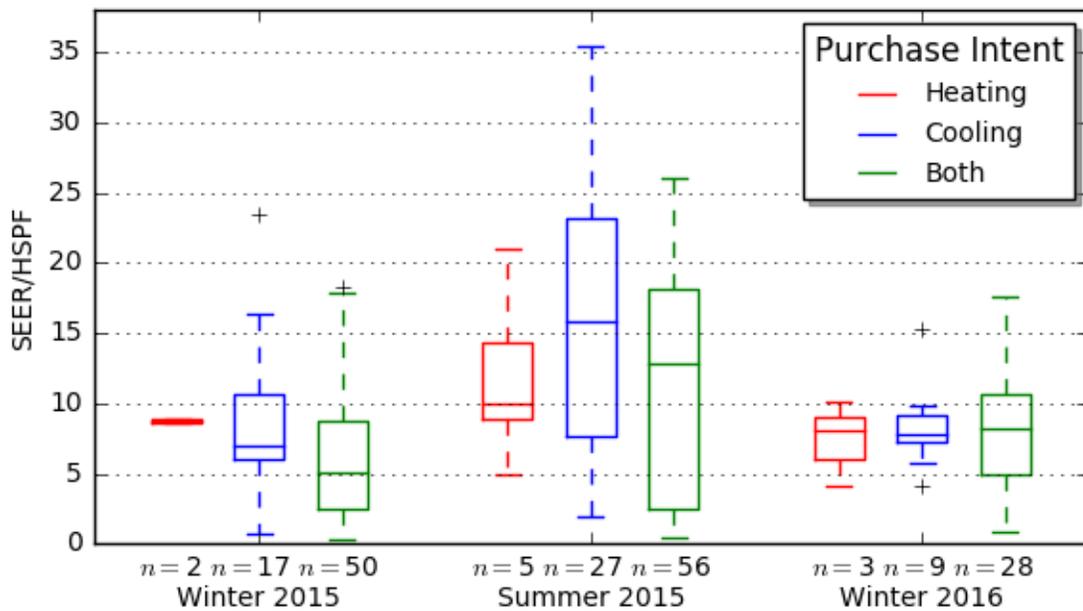


Figure 42. Seasonal Efficiencies vs. Purchase Intent, Cold Climate Units

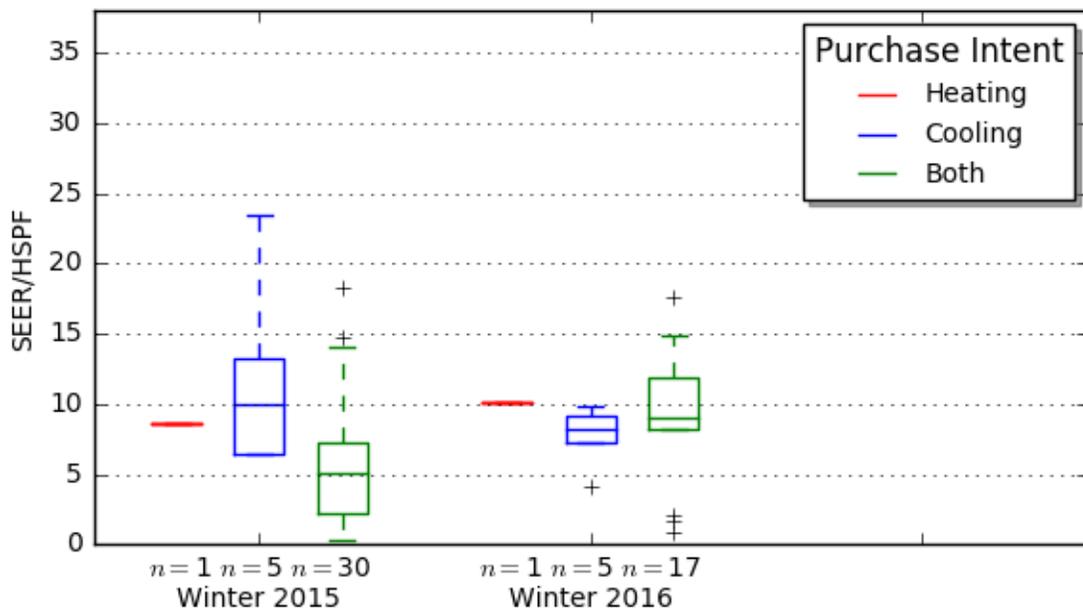


Figure 43 and Figure 45 illustrate the observed maximum capacity delivered by a unit for a season, graphed against the DMSHP's rated capacity. Each dot represents a unit for that season. The figures

display a rough correlation between observed capacity and rated capacity, with the best-fit line showing observed capacity lagged rated values in winter 2015, but exceeded the rated capacity in winter 2016.

These figures show a wide range of observed maximum capacities, which, for many units, were very low. In most cases, the evaluation team considers this a product of how the units were operated, with units often used at low speed or as supplemental heat. Manufacturers use varying rating methods for heating, and units can exceed their rated heating capacity by a large amount, depending on conditions (i.e., hence many units produce much more than their rated heating capacity for short periods). During winter 2016, fewer units operated at very low capacity than they did in winter 2015. In winter 2016, most units delivered over 10,000 BTU/h at maximum, and many delivered over 20,000 BTU/h.

Figure 44 illustrates a similar, wide range of observed cooling capacities, with the best-fit line marginally higher than the rated capacity. Because the unit capacity was rated at a 95°F outside ambient temperature, one would expect units operated at cooler outdoor temperatures to exceed the rated capacity: the figure supports this expectation.

**Figure 43. Winter 2015 Maximum Observed Capacity vs. Rated Capacity, N=98**

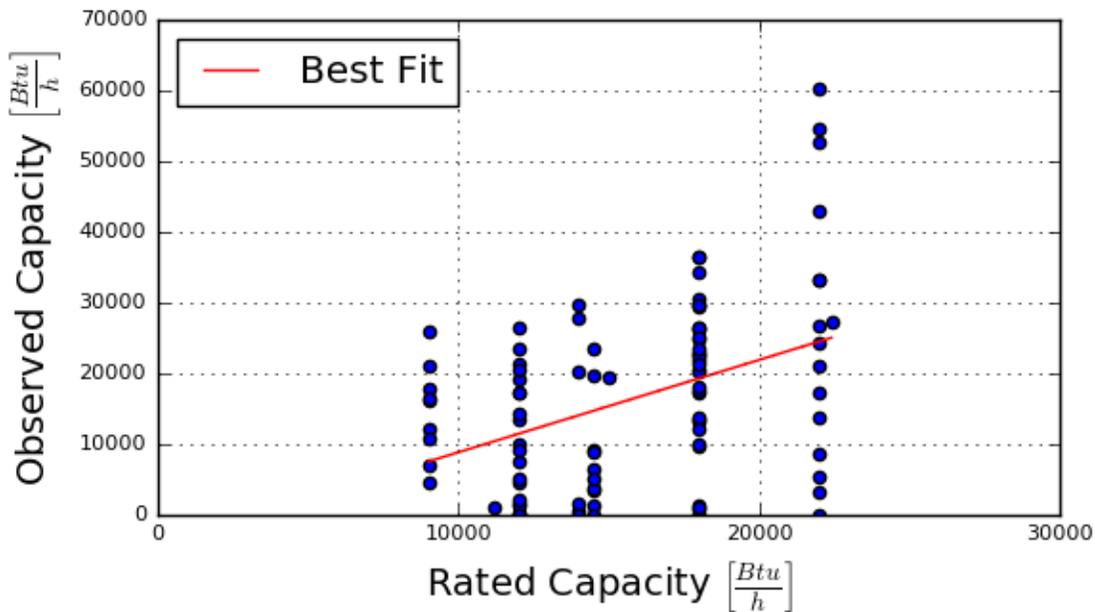


Figure 44. Summer 2015 Maximum Observed Capacity vs. Rated Capacity, N=114

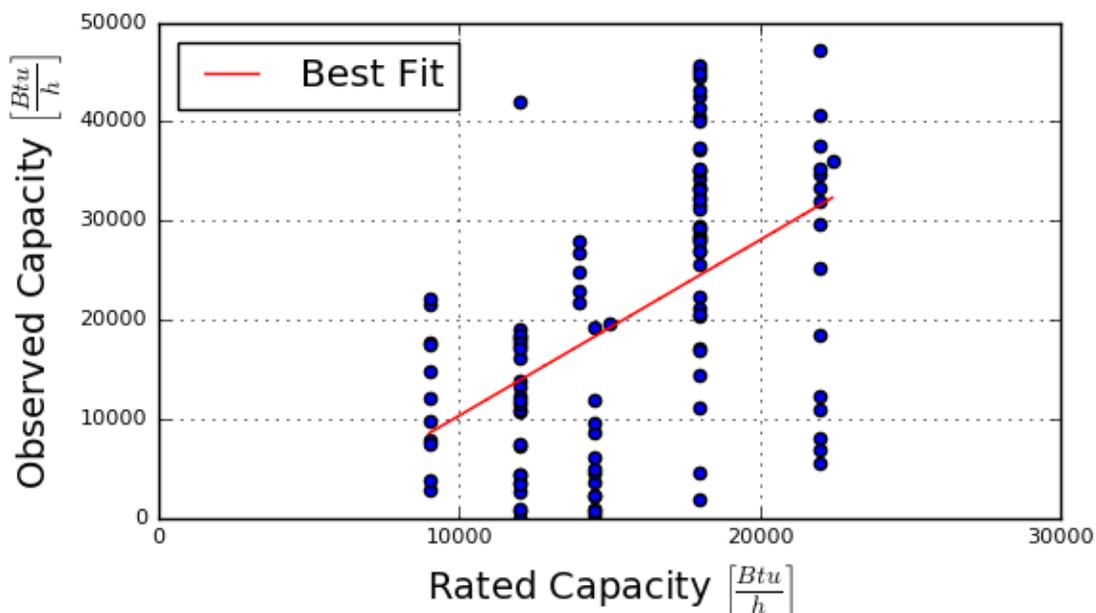


Figure 45. Winter 2016 Maximum Observed Capacity vs. Rated Capacity, N=60

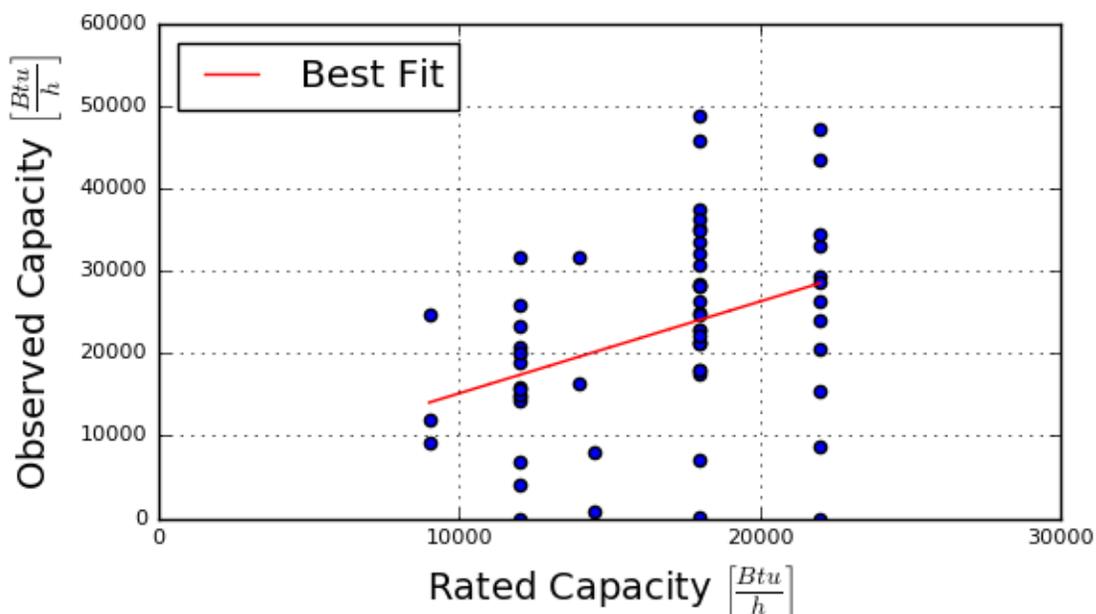


Figure 46, Figure 47, and Figure 48 present rated seasonal efficiencies against rated capacities for units metered in the study. As size increased, both a narrowing and a downward trend in rated efficiency became apparent, and the largest units (~24,000 Btu/h or ~2 Tons) had among the lowest-rated

efficiencies. This should be considered an observational trend and not a strong correlation. This trend may be different today, with multiple units offered in the HSPF 14 range.

Figure 46. Winter 2015 Rated HSPF vs. Rated Capacity, N=98

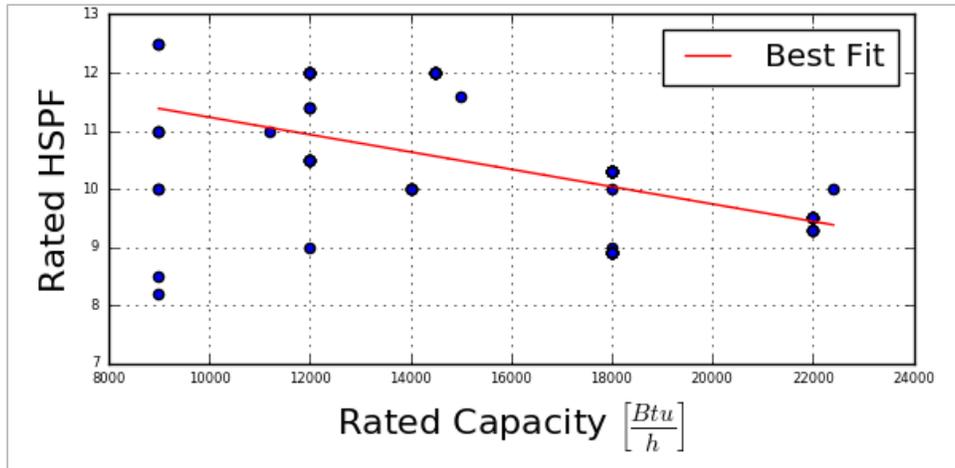


Figure 47. Summer 2015 Rated SEER vs. Rated Capacity, N=114

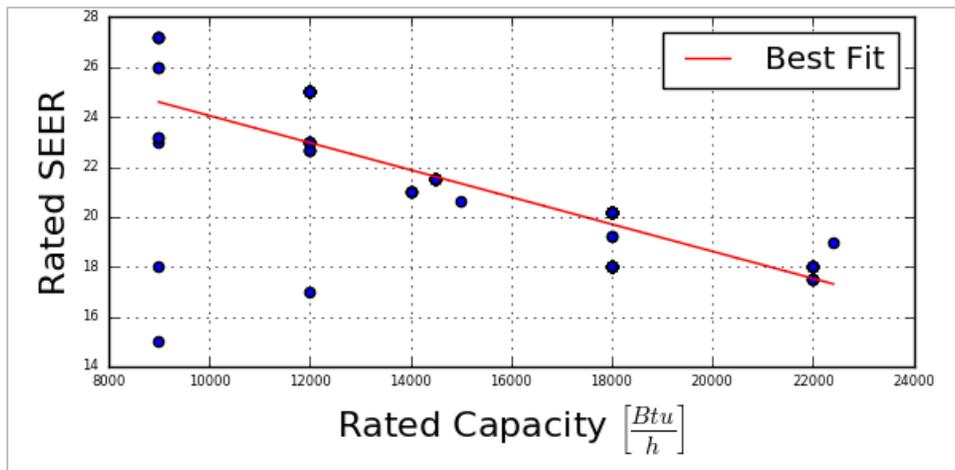


Figure 48. Winter 2016 Rated HSPF vs. Rated Capacity, N=60

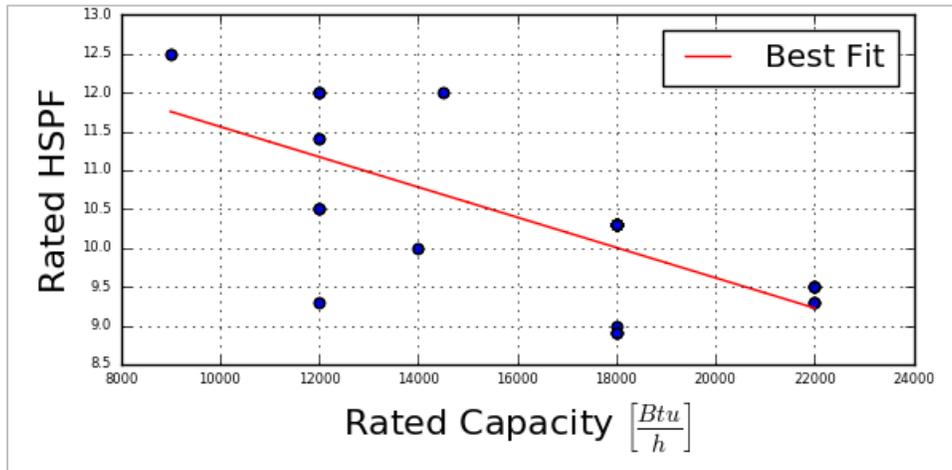


Figure 49, Figure 50, and Figure 51 present measured seasonal average efficiencies (“field” HSPFs and SEERs) for the measured units, plotted against each unit’s rated efficiency. In general, this produced measured average efficiencies lower than rated, but some units performed at levels higher than rated. As previously discussed, this result was not unexpected for several reasons:

- Homeowners used DMSHPs in highly variable ways, and these behaviors affected efficiency. For example, if a DMSHP was only used to cool on the hottest days, its measured cooling seasonal efficiency would be closer to its rated EER value (i.e., the efficiency rating at 95 °F outdoor ambient) than to its rated SEER value.
- SEER and EER tests were run at specific conditions, which may not fully represent actual operating behaviors or conditions. For example, the SEER rating test stipulated the return air at 80 °F—a temperature much warmer than most homeowners would choose. The test’s original intent may have been to simulate heat gain in return ducts, a factor obviously not applicable for DMSHP units.
- Units were used for other functions that could reduce rated performance, including fan-only modes and dry or dehumidification modes.

Figure 49. Winter 2015 Observed HSPF vs. Rated HSPF, N=86

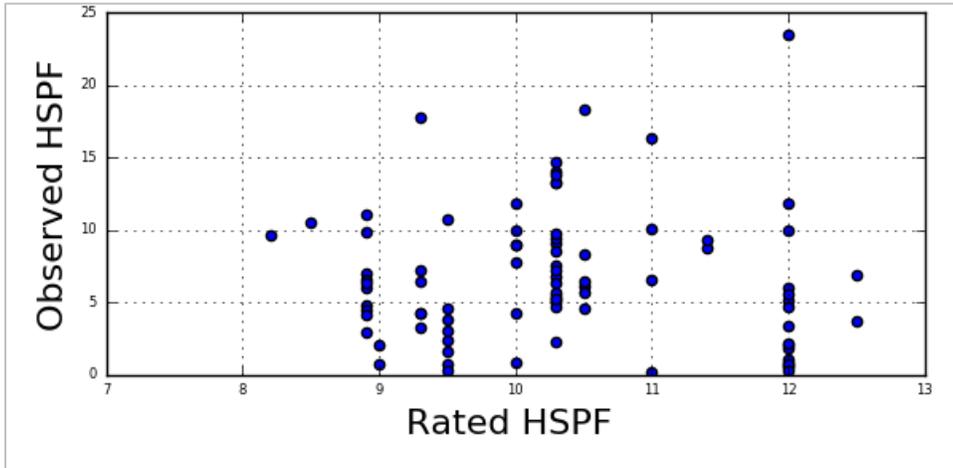


Figure 50. Summer 2015 Observed SEER vs. Rated SEER, N=113


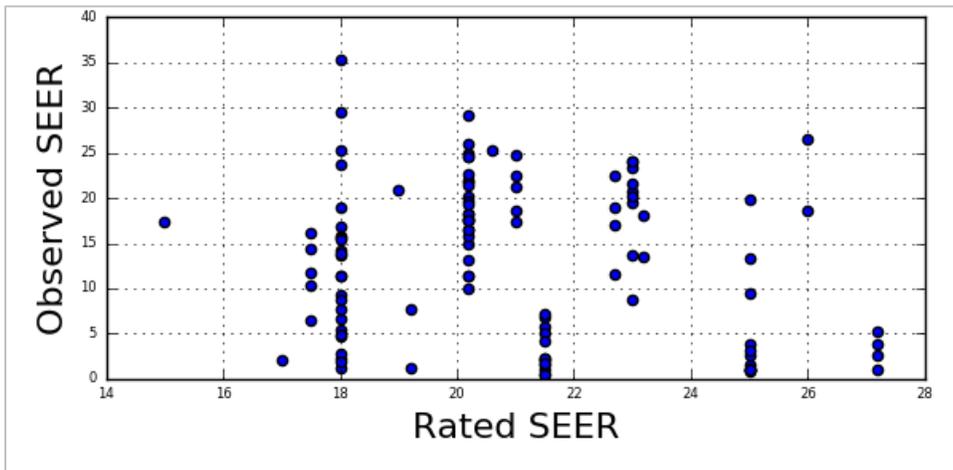



Figure 51. Winter 2015 Observed HSPF vs. Rated HSPF, N=57

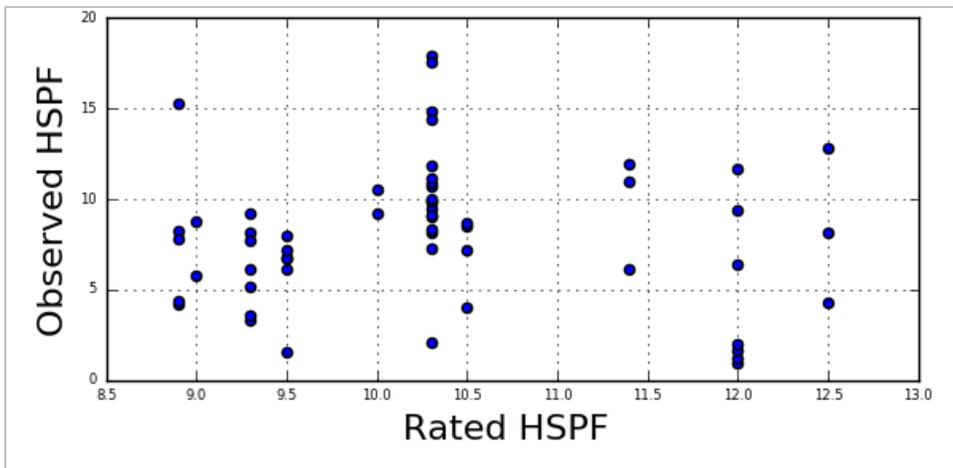

**Unit Efficiency COP**

Figure 52 and Figure 53 provide data critical for understanding DMSHP operations, along with the average metered efficiency of units across a range of outdoor air temperatures. These measurements of field efficiency are only possible where delivered heating and cooling (i.e., BTUs) are metered. These graphs show season-long measurements for dozens of DMSHP units. Winter 2015 (Figure 52) experienced prolonged periods of deep snow and cold temperatures, and accumulated snow and ice around outdoor units can inhibit performance; so the COPs could vary greatly between this winter and the following (2016) winter. Observed units operated more efficiently the following winter (also Figure 52), with COPs averaging 1.5 at -10 to 0 °F. This is significant because it means that even for the coldest temperatures, DMSHP are far superior to electrical resistance heating, offering effective heating efficiencies 50% higher. Similar data follow for cold climate units in Figure 54 and Figure 55.


**Figure 52. Winter 2015 Average COP vs. Outdoor Air Temperature, N=87**

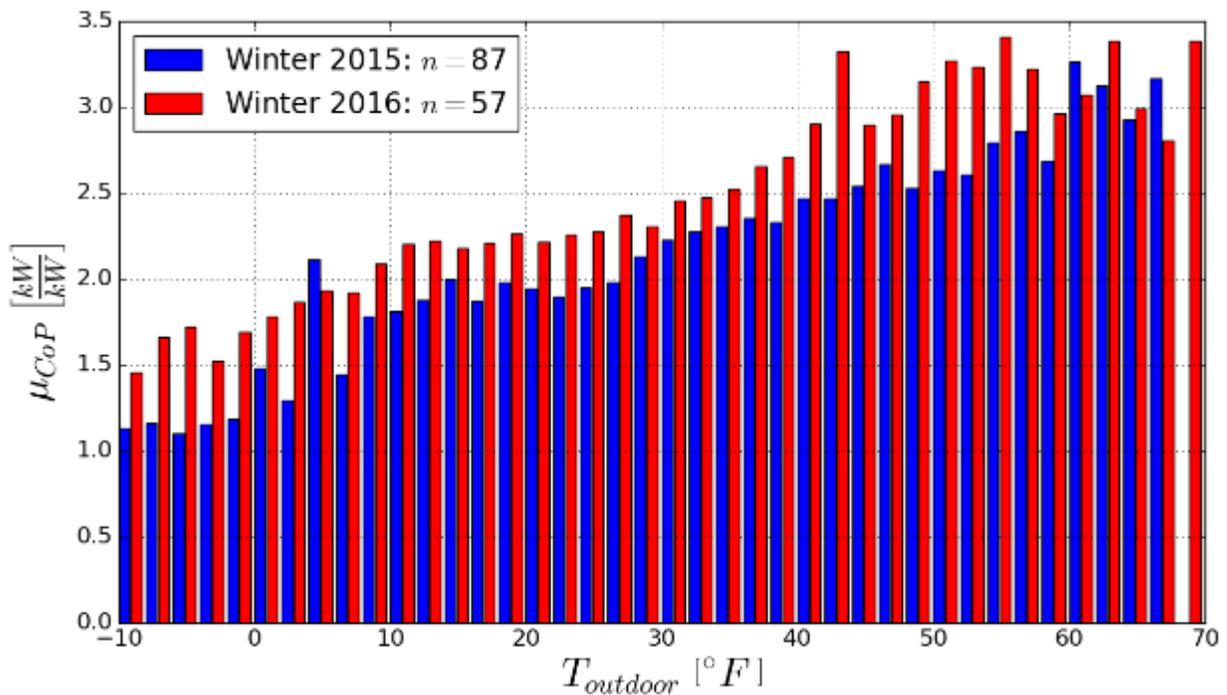

Cooling efficiency’s pattern differed from heating, dropping at lower outdoor ambient temperatures (when seldom used). The average DMSHP maintained high and relatively flat efficiency at approximately a 5.0 COP from outdoor air temperatures of roughly 66 °F to about 76 °F (EER ~ 17). Average efficiency then steadily dropped with increasing temperature to an approximately 3.75 COP at 92 °F (EER ~ 13). The discontinuous efficiency drop from 92 °F to 94 °F could result from very few hours occurring in this bin and, therefore, very few hours metered, it is likely artifact of sample size and not a real trend.

Overall, the EER of 17 at milder outdoor temperatures fell below the average-rated SEER of approximately 20, but the high-temperature EER of 13 came close to the rated EER for most units.

**Figure 53. Summer 2015 Average COP vs. Outdoor Air Temperature, N=114**

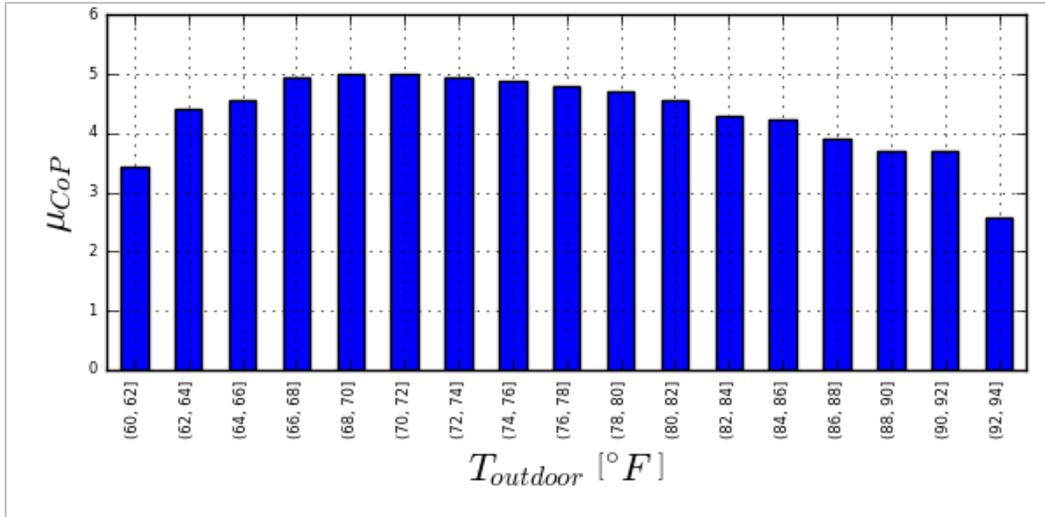

### Cold Climate Performance

DMSHP manufacturers continue to offer new units, with claims of increased performance at very cold outdoor ambient temperatures (i.e., well below 0 °F). Currently, various makers claim DMSHPs offer 100% capacity at 20 °F or at 5 °F (depending on how they are rated), and operations down to -15 °F. The evaluation team used the Efficiency Vermont TRM (current at the study’s planning phase) to identify cold-climate units. Table 18 presents these DMSHP models. Manufacturers have released more capable cold-climate units in the last two years, but this evaluation drew upon installed DMSHP populations from 2012, 2013, and 2014. This report characterizes these as “cold-climate” units, with all other units are identified as standard or “non-cold-climate” units.

**Table 18. Cold-Climate Unit Listing**


Maker & Brand	Model
Mitsubishi Mr. Slim Hyper Heat	<ul style="list-style-type: none"> <li>• MUZ/MSZ-FE09NA</li> <li>• MUZ/MSZ-FE12NA</li> <li>• MUZ/MSZ-FE18NA</li> </ul>
Fujitsu Halcyon Inverter	<ul style="list-style-type: none"> <li>• AOU/ASU9RLS2</li> <li>• AOU/ASU12RLS2</li> <li>• AOU/ASU15RLS2</li> <li>• AOU/ASU12RLS2H</li> <li>• AOU/ASU15RLS2H</li> </ul>
Daikin Altherma	<ul style="list-style-type: none"> <li>• ERLQ030BAVJU</li> <li>• ERLQ024BAVJU</li> </ul>

Figure 54 and Figure 55 present COPs<sup>40</sup> plotted for cold-climate and non-cold-climate units against outside ambient temperatures for winter 2015 and winter 2016, respectively. Because data points are each performance averages from many units, they are averages and should be considered approximations. Data for winter 2015 (already noted for deep snowfalls that buried many units) showed the separation of efficiency as COP only at temperatures below 40°F. The separation in COP grows to about 0.5 moving left in the plot to 0°F.

Winter 2016, without snowfall issues, shows separation of efficiency curves for the entire range of outdoor temperatures—a curve more in keeping with the roughly 1-point difference in rated HSPF (COP difference of 0.3) between the cold climate and non-cold climate units (see the figure key).


This ratings difference is consistent with comments engineers at major manufacturers told the evaluation team, stating that cold-climate units were of higher quality and featured more of the newest technology. As cold-climate units are increasingly demanded by customers, the engineers reasoned that putting more effort and innovation into the cold-climate models made sense. Notably, observed non-cold-climate models operated at outdoor ambient temperatures below 0 °F, but at a lower efficiency than cold-climate models.

**Figure 54. Average Heating COP vs. Outdoor Air Temperature for Cold-Climate and Non-Cold-Climate Systems – Winter 2015**

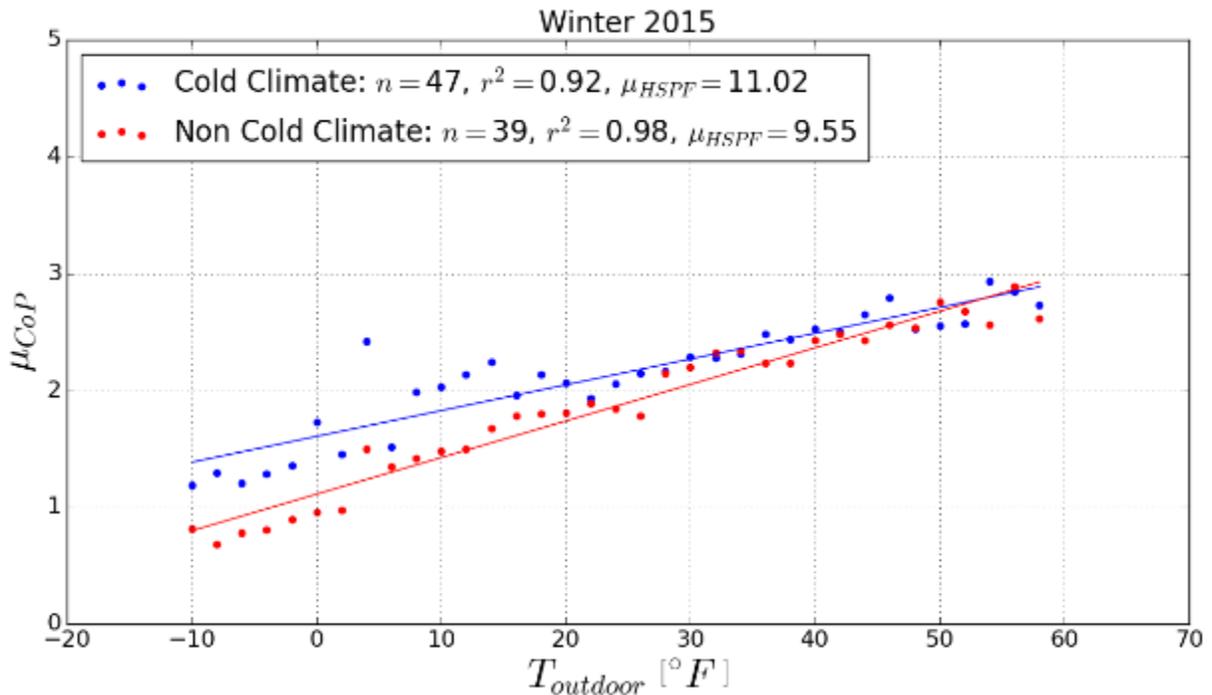

<sup>40</sup> Electrical resistance heating has a 1.0 COP; fuel heating has a COP equivalent to system efficiency (0.7 to 0.9).

Figure 55. Average Heating COP vs. Outdoor Air Temperature for Cold-Climature and Non-Cold-Climature Systems – Winter 2016

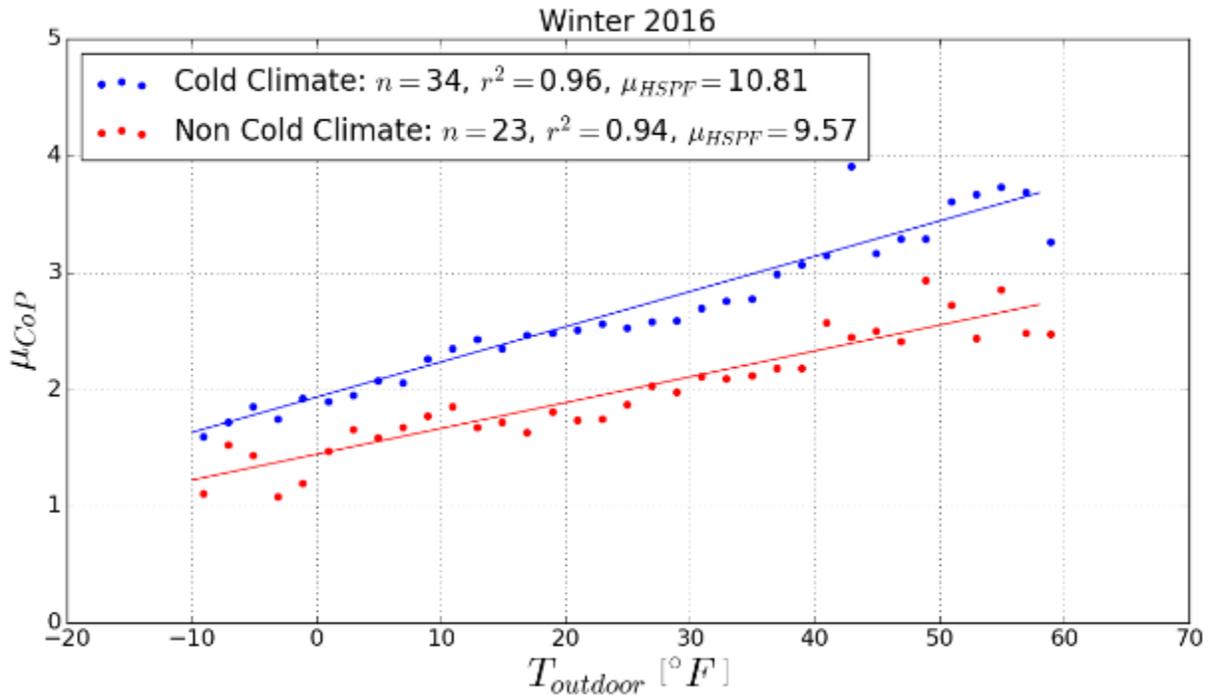

**Multi-Head Performance**

DMSHP manufacturers offer different system configurations, with some systems including more than one indoor unit (or “head”) for each outdoor unit. The evaluation team observed single-head systems most commonly, but many units included in the study had two, three, or even four heads.<sup>41</sup> System owners could choose to purchase a multi-head system for a number of reasons, but at the time of the installation of the units in this study, no cold-climate multi-head systems were available. Multi-head units are generally rated lower than single-headed systems in this study and metering data seems to follow this trend.

Figure 56 and Figure 57 show the range of efficiencies by the number of heads. Figure 56 presents COPs plotted against outdoor ambient temperatures for the heating season, and compares units with one, two, and three indoor heads per each outdoor unit. The resulting plot indicates that single-head units, in general, operated more efficiently than multi-head options. Cold-climate units were rated higher and proved more efficient than standard or non-cold-climate units (see the Cold Climate Performance section), so the trend in declining efficiency with increased head count could arise simply from ratings or from a combination of factors.

<sup>41</sup> The team observed one four-head system through the study, but excluded it from the plot due to the small sample size.

Figure 57 presents the same data as Figure 56, but for only non-cold-climate units. Though essentially identical, this plot shows (single head) non-cold-climate single-head units operating less efficiently, with a rated HSPF generally 1-point lower (equivalent to a COP difference of 0.3). The two and three head curves are identical in both figures because there are no multi-head cold climate units. The two-headed units' efficiency curve rises more steeply than the one- or three-headed units do. At this time, the technical reason for this remains unknown.

**Figure 56. Average Heating COP vs. Outdoor Air Temperature for One-, Two-, and Three-Head Systems**


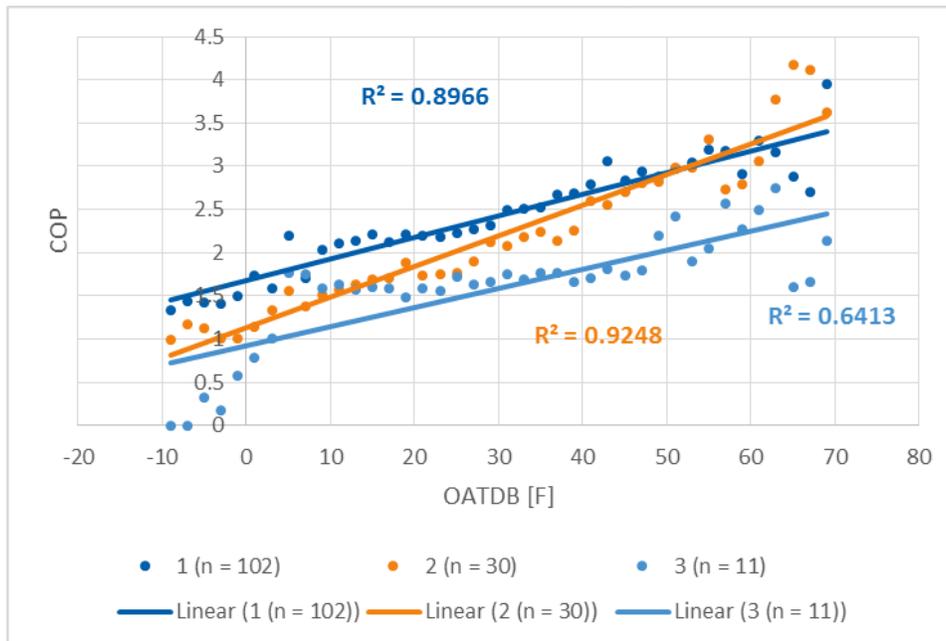


Figure 57. Average Heating COP vs. Outdoor Air Temperature for One-, Two-, and Three-Head Non-Cold-Climate Systems

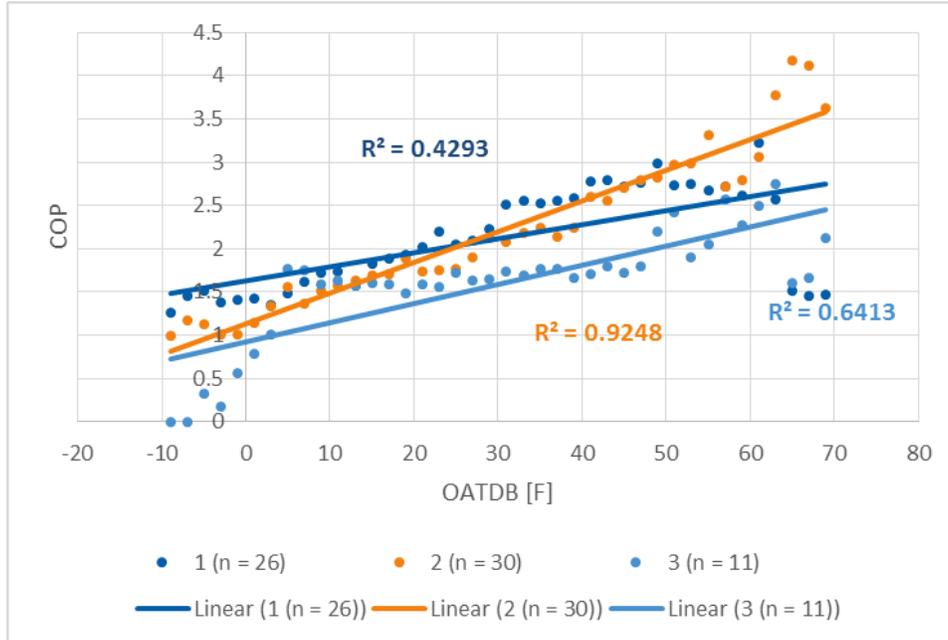

### Performance Related to Installing Contractors

In Massachusetts, one installer accounted for a relatively large number of installations, and several program sponsors indicated concerns about the substandard quality of their work. At multiple installations by this contractor, the evaluation team noted extra lengths of line set (up to 30 feet) coiled behind the outdoor unit. Manufacturer’s installation guidance directs installers to trim line sets to minimum reasonable lengths.

To examine whether this contractor’s installation practices affected efficiency, the team plotted the average COP against outside temperatures for sites installed by the contractor, along with sites installed by other contractors. Figure 58 and Figure 59 show average COP for the largest contractor and all other contractors versus outside air temperatures. The figures indicate the largest contractor’s COPs were lower for all temperatures by about 0.5 COP points in winter 2015 and 1.0 for winter 2016. The average HSPF for units installed by the largest contractor was 10.3 (10.0 for both winters), while the average HSPF of units installed by others were 10.4 and 10.5. The difference of 0.1 to 0.5 points equals a rated COP difference of 0.03 to 0.15, far lower than the actual difference in the graph. Therefore, the figure differences cannot be explained by differences in rated efficiencies. This evaluation did not focus on installation quality, and any issues beyond long line sets (previously noted) would not have been directly observable. It appears however that there was an issue exists with installations by the discussed contractor.

Figure 58. Average Winter 2015 COP vs. Outdoor Air Temperature for Installing Contractor


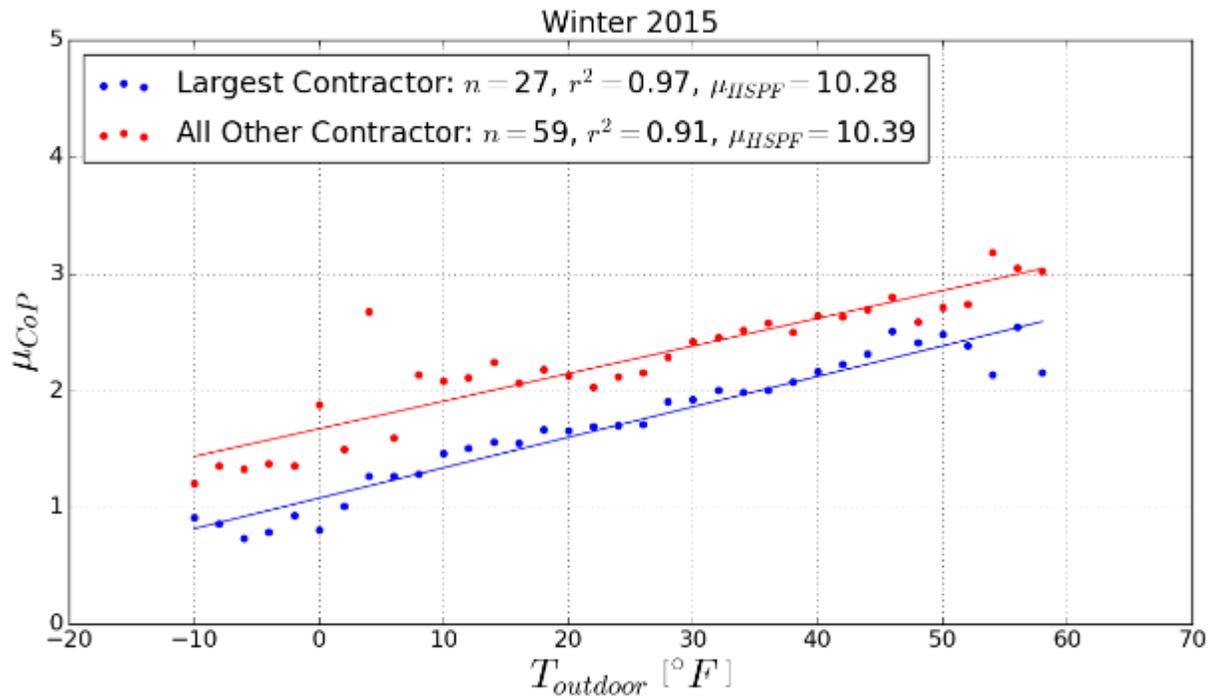


Figure 59. Average Winter 2016 COP vs. Outdoor Air Temperature for Installing Contractor

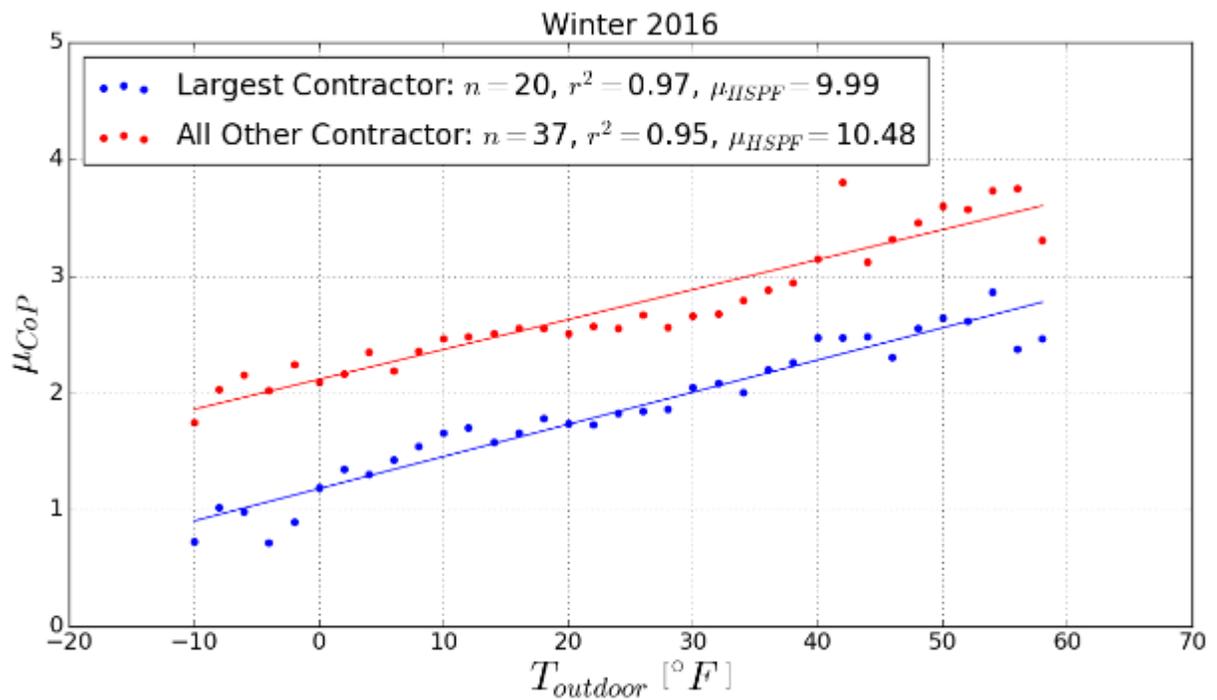


**Heating System Interaction**

Figure 60, Figure 61, and Figure 62 present representative heating system interactions for three homes. These stacked area charts illustrate the relative contribution of each system across a range of temperatures. The heat output rate (BTU/h) dropped to zero at the home’s balance point,<sup>42</sup> at roughly 60 to 65 °F. The heat output rate increased in a nearly linear fashion (from right to left) as outdoor temperatures declined. The DMSHP heating rate displayed a different shape in the three sites, but, in each case, the relative contribution remained small, and the average heat output did not approach the capacity of the alternative heating unit. For Site M0193, the heat output rose to 10,000 BTU/h—the greatest value from these three sites.

The relatively small contribution of the DMSHP versus the primary system could arise from multiple reasons. Heat loss from the room could be low. At site M0193, heat provided by the DMSHP rose linearly with temperature. The amount of heat delivered (10,000 BTU/h) was relatively large, equaling the mean heat loss shown in Figure 63. The shape and magnitude of the curve may indicate it contributed most of the heat to a zone or space. In contrast, sites M0198 and M0011 exhibited a decreased DMSHP contribution as the outdoor ambient temperature dropped.

**Figure 60. Site M0193, Heating System Interaction**

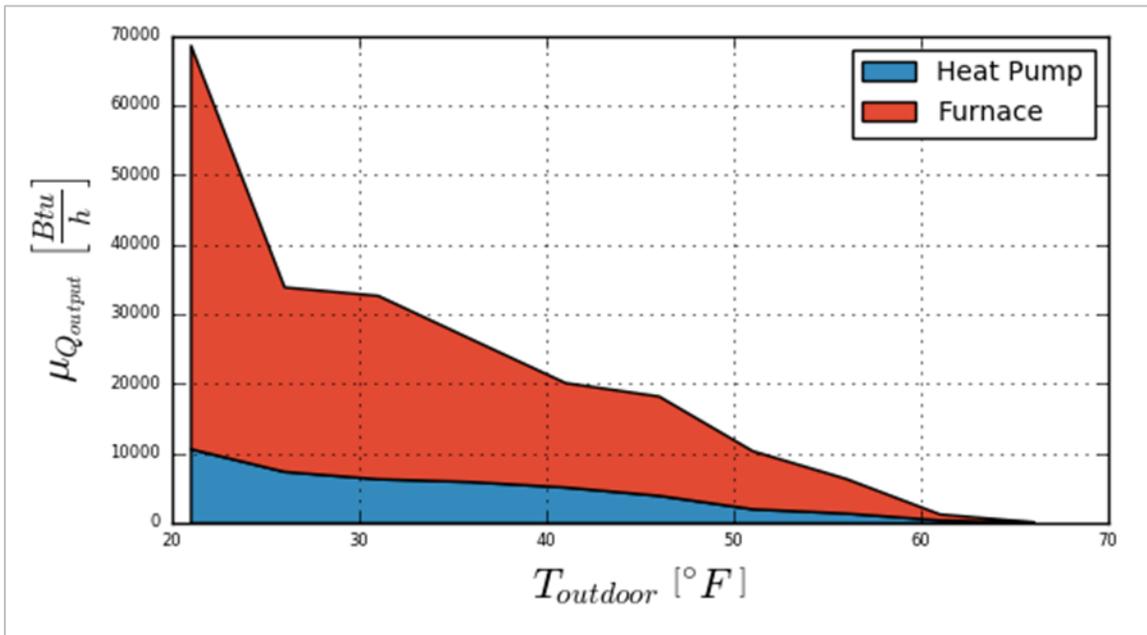

<sup>42</sup> The balance point is defined as the outdoor ambient temperature where heat gains from internal loads equal heat losses to the outdoor environment; so heating or cooling are not needed to maintain internal conditions.

Figure 61. Site M0198, Heating System Interaction


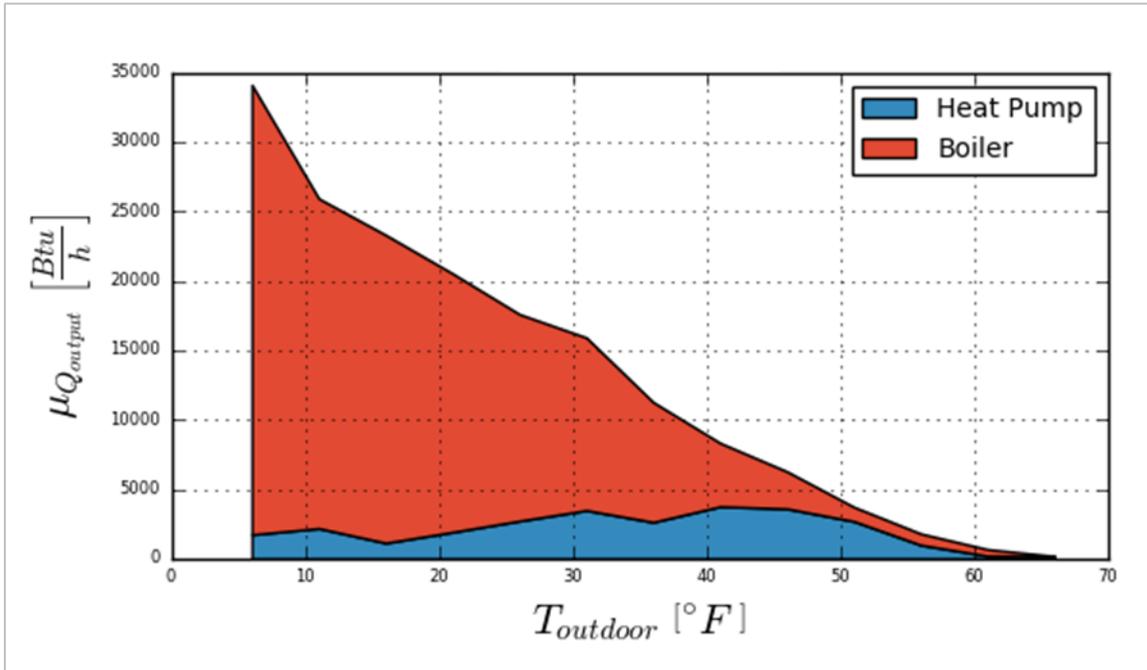


Figure 62. Site M0011, Heating System Interaction

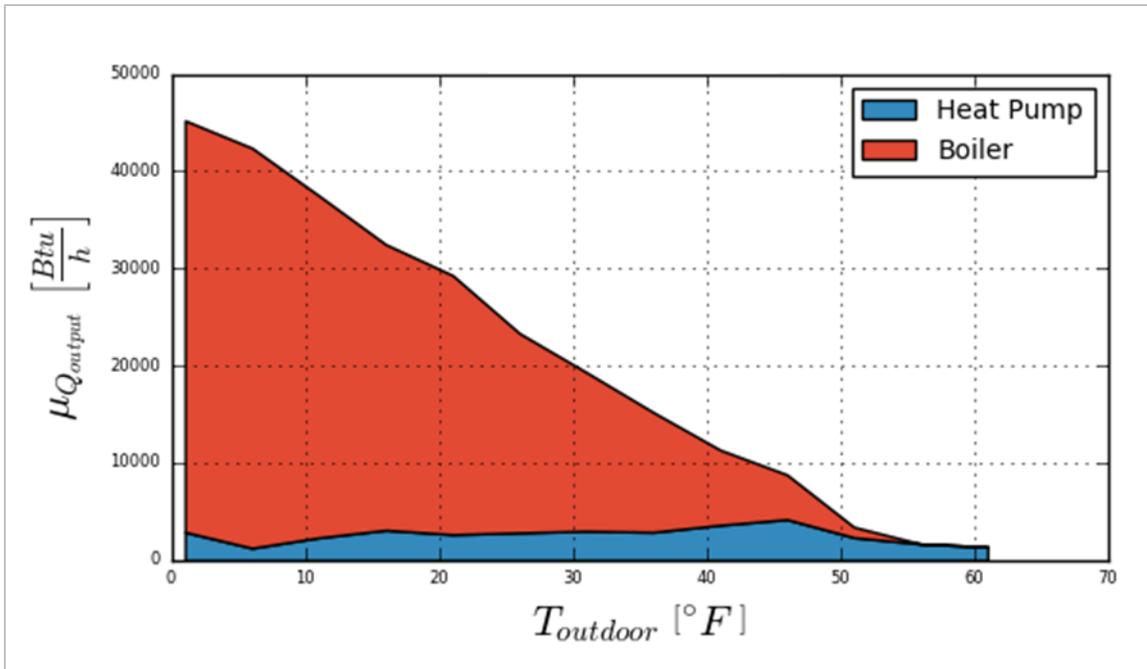

### Unit Sizing

For each indoor head, the evaluation team calculated the design's heat gain and heat loss using ANSI's *Manual J: Residential Load Calculation (Eighth Edition)*. Figure 63 shows the range of calculated heating and cooling load for each space served. In general, the calculated heat load was 5,000 to 10,000 BTU/h at 6 °F, and the median calculated cooling load was 5,000 BTU/h with a relatively tight range. Given that most DMSHP heads have rated capacities of 9,000 BTU/h and greater, these plots seem to indicate that DMSHPs were sized larger than necessary for cooling. As discussed later, this may be because they were sized to meet heating needs. Fully half of all systems have heating loads above 10,000 BTU/h at 6 °F, and 25% have loads great than 13,000 BTU/h. These loads will be roughly 20% higher at -5°F, assuming a balance point of 65 °F), or 12,000 and 16,000 respectively.

Figure 64 shows the ratio of rated unit capacity to calculated thermal load. This ratio was slightly above 100% for heating and just above 200% for cooling. As noted, the heating ratio probably was exaggerated as heat loss was calculated at a design temperature of 6F, while units were rated at 17°F. That is the median is likely below 100% of needs at colder temperatures as discussed below. Even at 17°F, nearly half of the units were undersized for the space's heating needs. The ratings of units' heating capacity at 5°F are not standardized, with methods varying by manufacturer and AHRI ratings limited to 17°F.

The efficiency of a unit drops as the outside temperature drops, but capacity is dependent on airflow and compressor speed. Some manufacturers report a flat capacity from 17°F to 5°F. Lacking standardized metrics at colder temperatures, to roughly estimate how much capacity might drop from 17°F to 5°F, the evaluation team took a ratio of the two ratings for fixed airflow, using manufacturer's engineering data, and found about a 20% drop. Increased compressor speeds and higher airflows could make up for this but that would be hard to determine without testing. Very roughly, if the median capacity at 17°F was 110%, and if it dropped by 20%, the capacity would be as low 88% at 5°F. Even without this drop, some 50% of units did not meet the heating load at temperatures below 17°F.

Conversely, the cooling ratio was slightly higher than indicated as the capacity was rated at 95°F, while the heat gain was calculated at 86°F. Because DMSHPs have variable speed compressors and variable speed fans, the evaluation team does not think that oversizing for cooling will appreciably affect savings or efficiency.

Figure 63. Calculated Thermal Loads of Spaces Served by DMSHPs, N=141

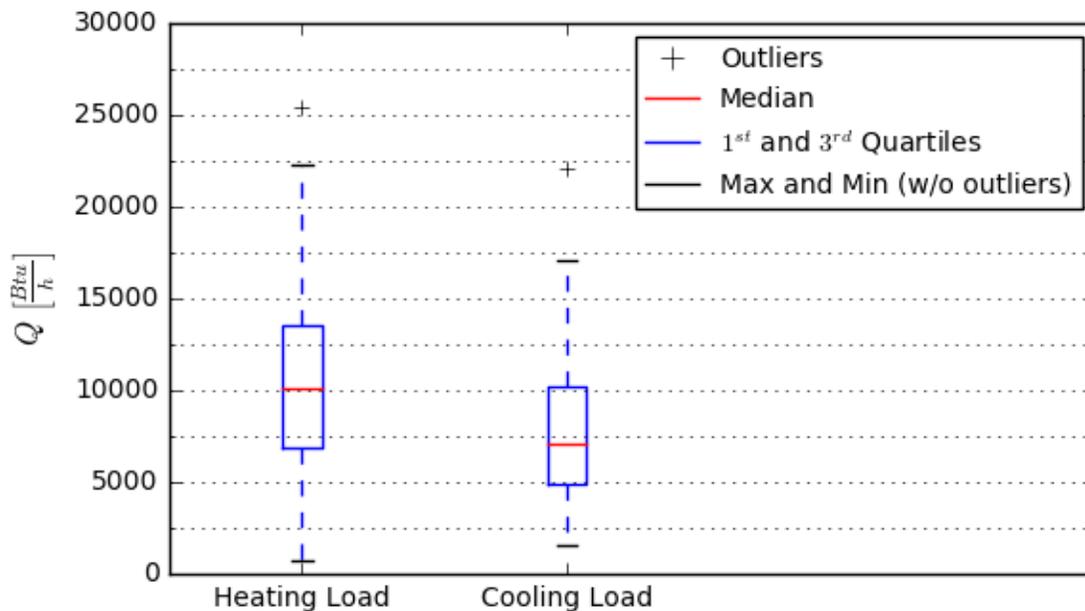


Figure 64. Ratio of DMSHP Rated Capacity to Calculated Thermal Load of Spaces Served, N=140

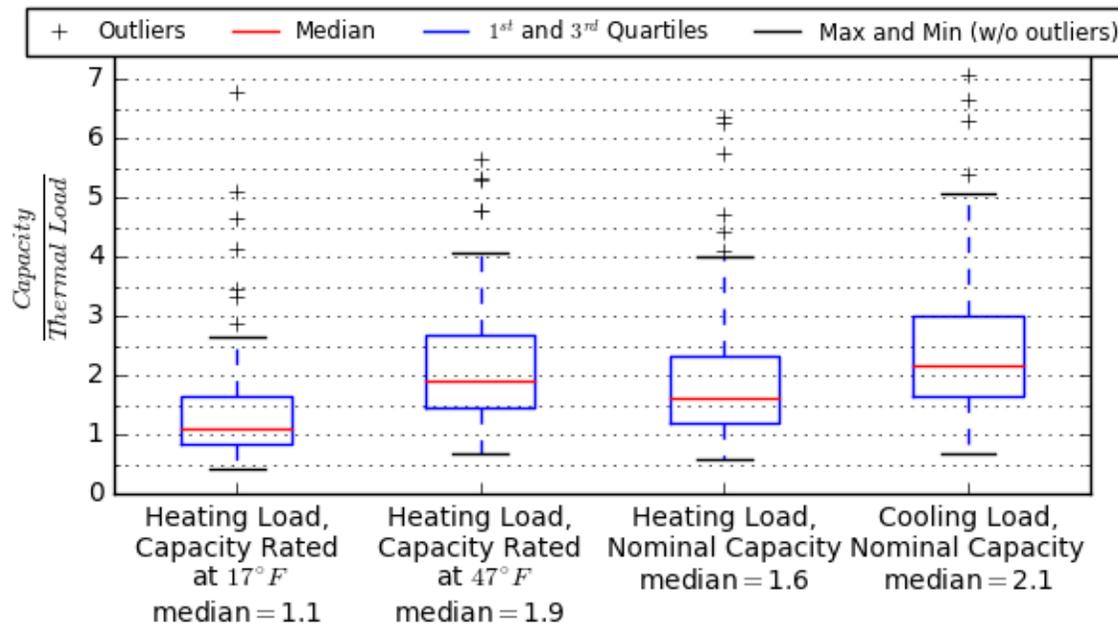


Figure 65. Ratio of DMSHP Rated Capacity to Floor Area of Spaces Served

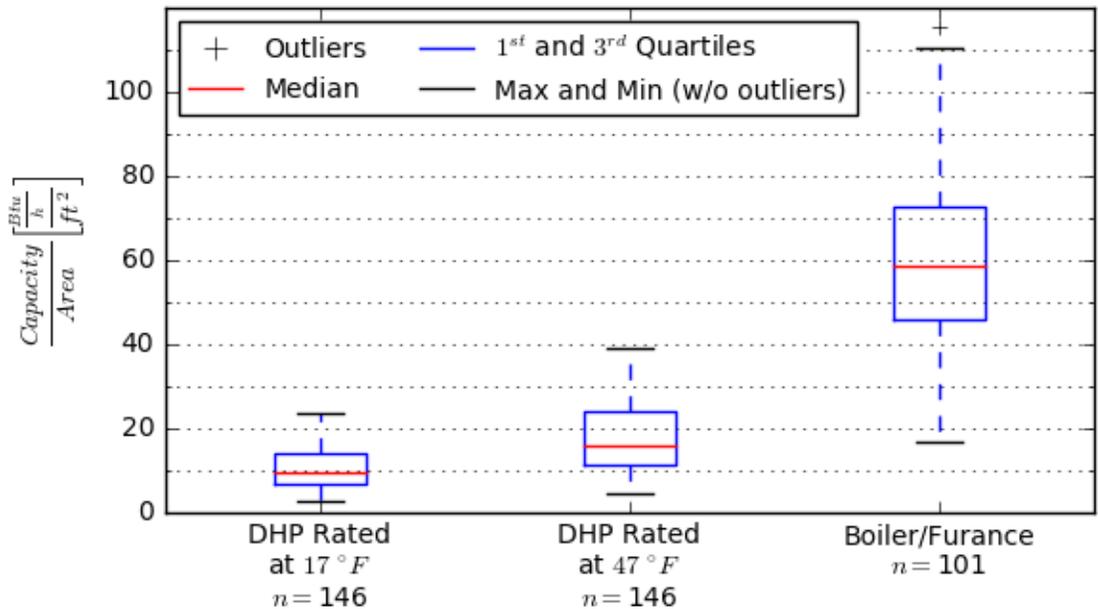


Figure 66 presents the ratio of rated unit capacity to the calculated design heat load; values greater than one indicate the unit has more capacity than the calculated load for the space served with the caveats discussed above. Table 19 summarizes these data. The team used the unit’s nominal capacity for these calculations, calculating the design loads using a set of outdoor design conditions, set forth by ANSI in *Manual J*. For Framingham, Massachusetts, this calculation results in outdoor ambient conditions of 86 °F during the summer and 6 °F during the winter.

Systems that could be characterized as outliers (i.e., capacity at greater than a 4:1 ratio to heat loss or heat gain) resulted from installation of indoor units in spaces with only a small amount of area adjacent to the exterior, such as hallways. In these cases, the heating and cooling likely spilled over and served adjacent areas.

Figure 66. Heating and Cooling Rated Capacities Normalized by Calculated Design Loads

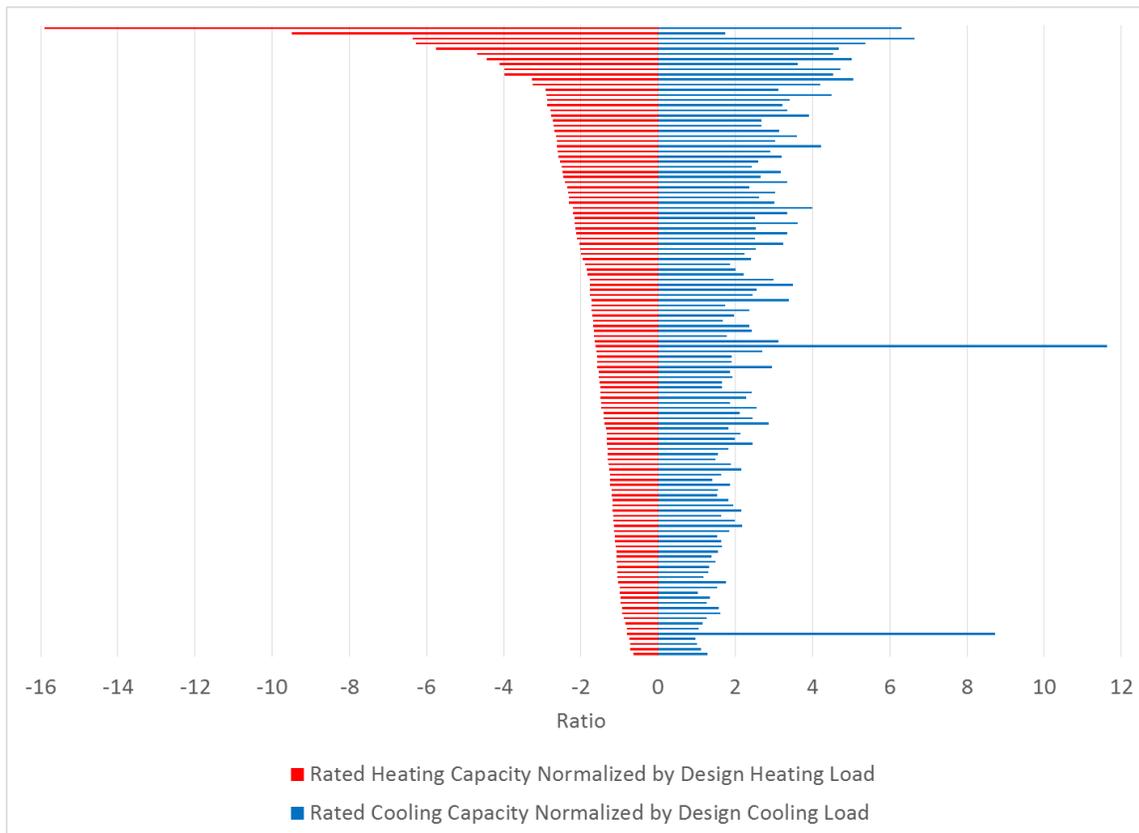


Table 19. Heating and Cooling Capacities, N=137


	Heating Capacity Ratio (Rating / Design)	Cooling Capacity Ratio (Rating / Design [86°F])	Floor Area Served / Cooling Capacity (s.f. / ton)	Heating Capacity / Floor Area Served (BTU/h per s.f.)
Minimum	64%	96%	104	11
Maximum			1,129	115
Average	See above	262%	333	36
Median	110% (17°F)	210%		

The evaluation team received only a handful of complaints from homeowners, who regarded their units as undersized to meet their cooling loads in summer; more common were complaints regarding insufficient heat during the winter. The previous discussion supports this observation.

Figure 67 presents a scatter-plot of rated capacities and calculated (*Manual J*) capacities, mapped as a function of floor area served. Based on the characteristics of homes participating in the evaluation and the resulting calculations completed via *Manual J*, the evaluation team considers it unlikely that contractors use *Manual J* to size DMSHP systems. Based on these data, it also remains unlikely that contractors use a “rule of thumb” to size a unit’s capacity to the floor area. As shown in Figure 67, none

of the data exhibit a good trend fit or strong correlation (as the  $R^2$  values are low relative to an ideal fit of 1.0).

**Figure 67. Relationship Between Design Cooling, Design Heating, and Rated Capacities as a Function of Floor Area Served**

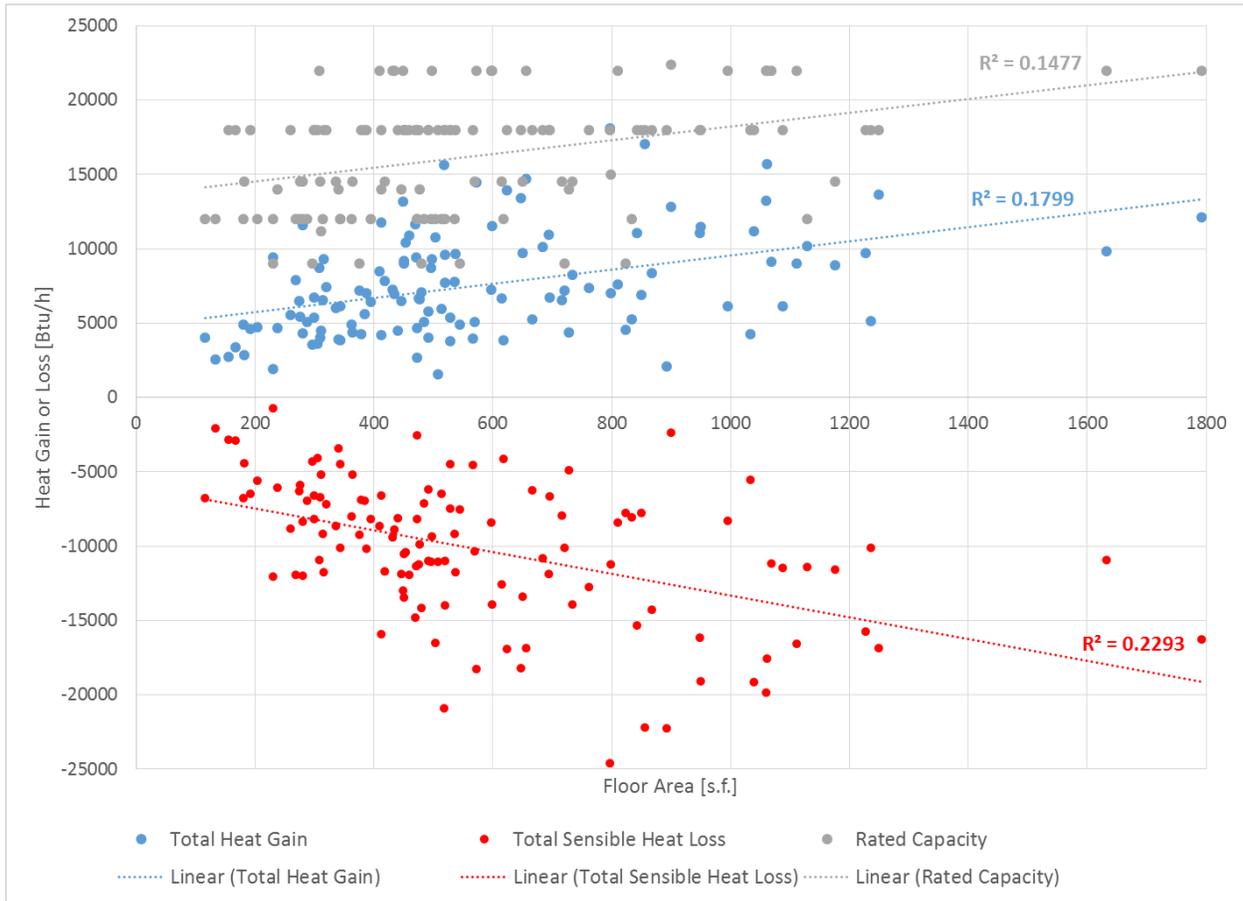

To test for use of rules-of-thumb, the evaluation team calculated the average floor area (in square feet) served per ton of capacity for cooling and the BTU/h per square foot supplied for heating. The result averaged 333 sq. ft. per ton of cooling capacity, and 36 Btu/h per sq. ft. of floor area.


Finally, as shown in Figure 68, the team calculated the total rated cooling and heating capacity per total floor area of each home, which included both DMSHPs and alternative heating or cooling systems. This calculation examined the approximate portion of design capacity contributed by DMSHPs.

The figure shows the capacity of each HVAC system in the home, normalized by the home’s total floor area. For most homeowners, a DMSHP system served as their only cooling source. Of homes in the study, only eight had cooling capacities greater than 20 Btu/h per total s.f. of the home (or roughly 600 s.f./ton). The average cooling capacity was about 11.5 Btu/h per total s.f. of the home (or roughly 1,043 s.f. of home/ton). This is a far lower installed capacity than most central air conditioners (CAC) that Cadmus has observed during other studies. This means that while the capacity of the DMSHP is far

greater than the cooling needs of the immediate space served, the overall installed cooling capacity of DMSHP homes is far lower than homes cooled by a CAC. For heating, the average installed capacity was 67 Btu/h per s.f., where DMSHP accounted for 9.5 Btu/h per s.f. of that value.

Because DMSHP systems only accounted, on average, for about 14% of the total installed heating capacity, one can reasonably consider these units secondary or spot-heating solutions, with the bulk of home heating performed by an alternative system or systems. About 7% of homeowners in Figure 68 used their DMSHP systems in conjunction with window air conditioning units; often to meet needs in their home’s represented central areas (which would otherwise require multiple window units for cooling). About 8% of homeowners used the system in conjunction with central air conditioners, presumably because the DMSHPs allowed homeowners more control over individual set points within their homes. Homeowners also indicated that DMSHPs helped to condition areas added to homes after original construction and only served partially by the existing systems.

**Figure 68. Normalized HVAC System Capacities**

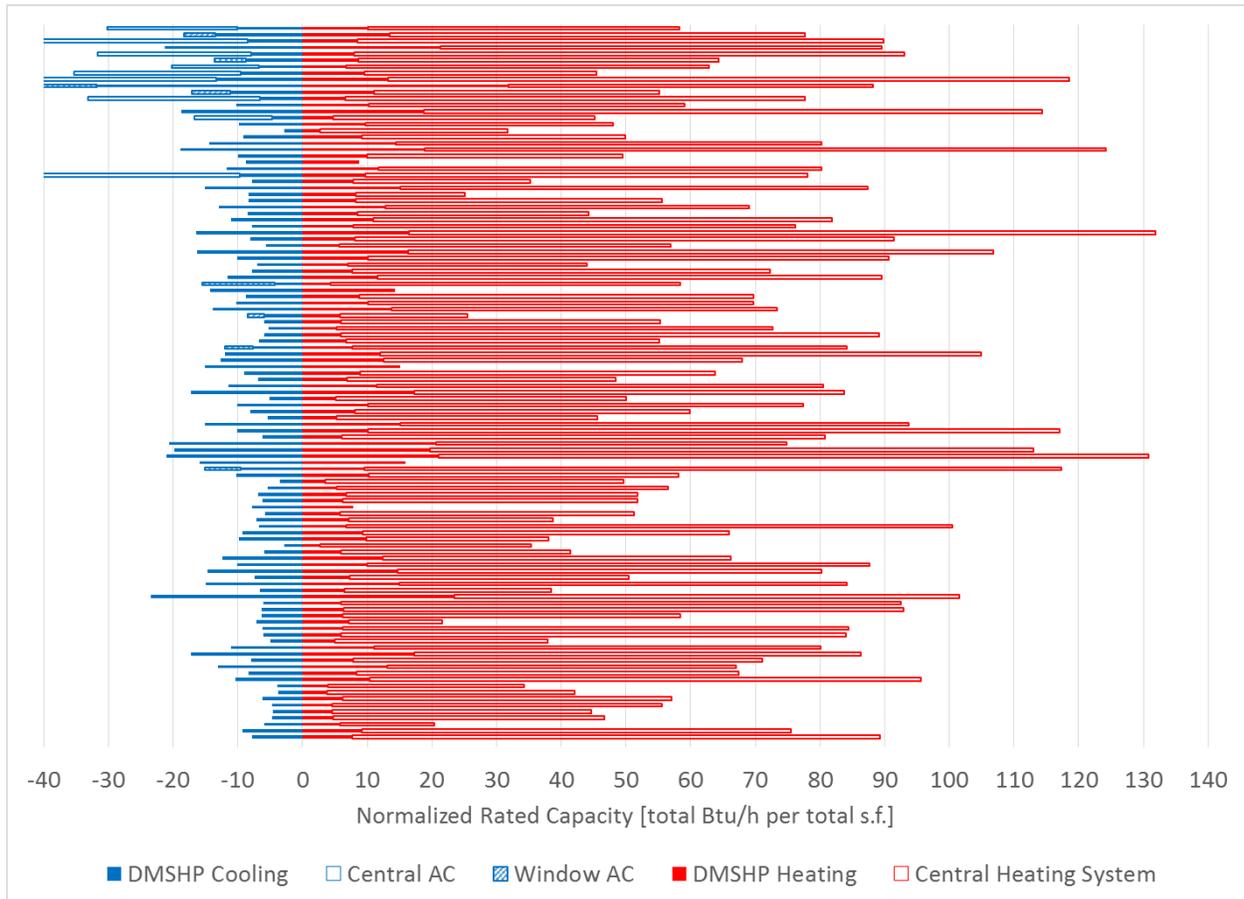

**Behavior Influence**

At the beginning of winter 2016, the evaluation team distributed a postcard to a small group of study participants. All participants had existing, operational electric resistance heat in the same room as their newer DMSHP. The postcard was intended to encourage changes in operating behaviors by homeowners and to promote more efficient operations of the coincident systems. Figure 69 presents the postcard’s primary content.

Figure 69. Behavior Influence Postcard


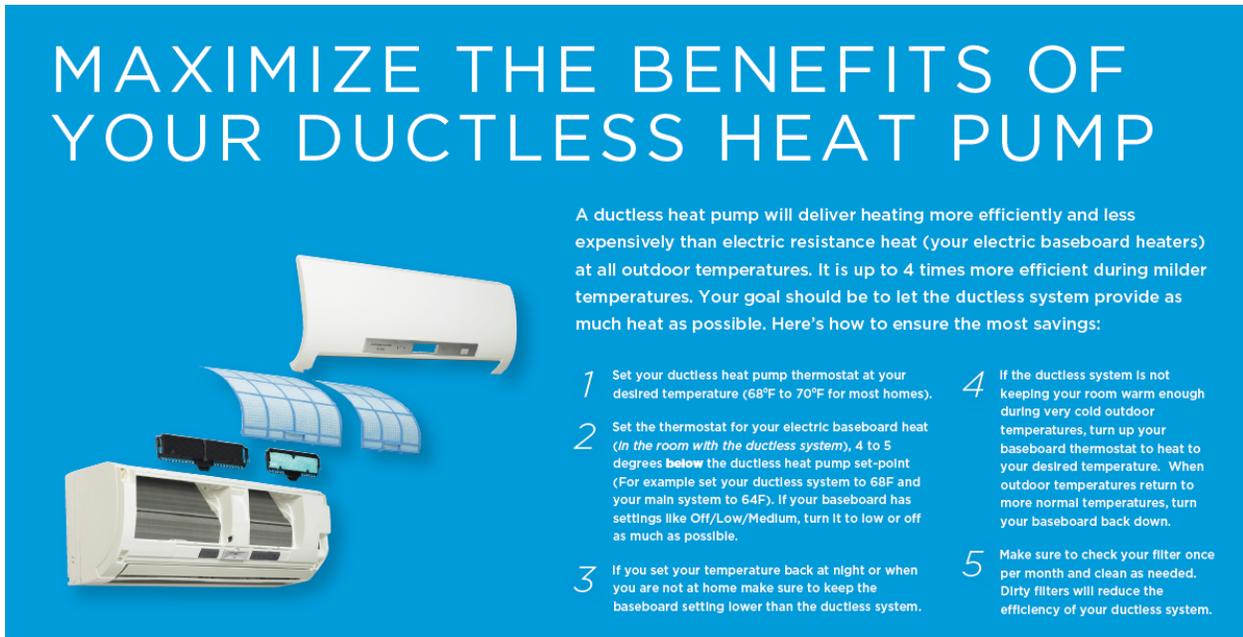


Figure 70 presents compares behavior for these participants from winter 2015 to winter 2016. After normalizing for different weather conditions between the two winters, it appears this postcard mailing had the intended effect, and DMSHP usage increased among recipients. This finding indicates some potential exists for behavior-influence efforts to increase the efficiency of customer operating behaviors.

Figure 70. DMSHP Usage for Behavior Influence Postcard Recipients

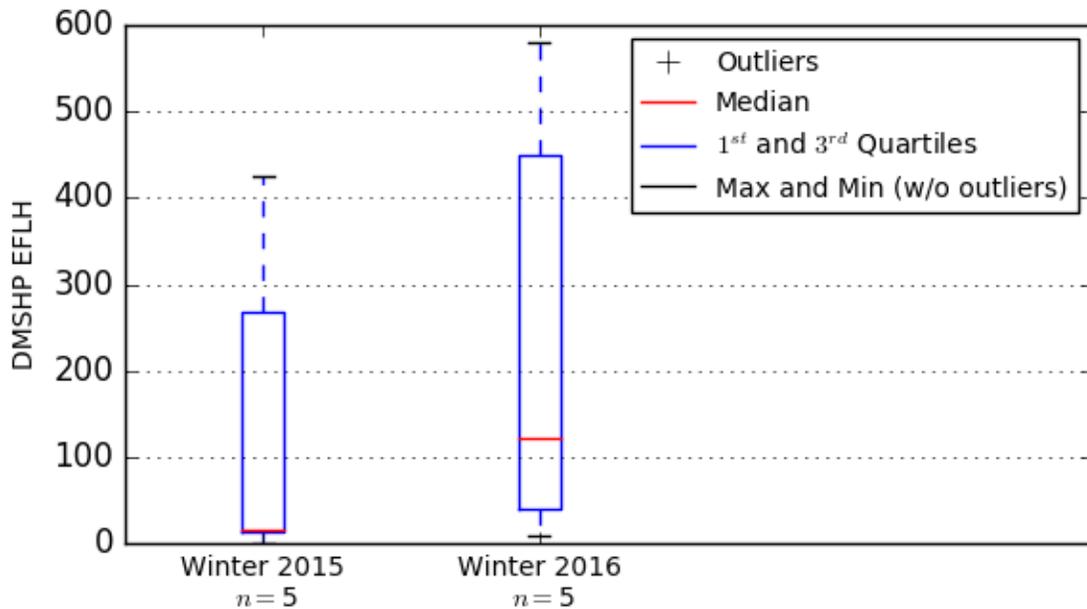

### Additional Findings

Throughout the study, the field team had multiple opportunities to speak with homeowners and learn about their experiences in purchasing and installing DMSHPs. The team observed a range of situations where homeowners noted diminished performance and sought guidance from field staff on improving their units’ operation.

### Filter Cleanliness

Staff observed the cleanliness of filters and rated them from one to three, noting whether they were clean (1), moderately dirty (2), or very dirty (3), respectively. The average filter received a rating of 1.5 to 1.6, indicating that filters typically fell between clean and moderately dirty. Dirty filters more often occurred alongside the following conditions (in descending order of influence):

- Pets in the home
- Wood or wood-pellet stoves used as a heat source
- Homeowner was unaware of the filter’s presence
- Homeowner was unable to reach the filter for cleaning

As shown in Figure 71, filters can be checked for cleanliness visually. In this extreme case, dust accumulation on the filter hindered the fan’s full-speed volume by 69%. Filters can be cleaned with a household vacuum or in a sink, leaving the filter to air dry before reinstalling.

The evaluation team examined filter cleanliness’ impacts of on fan performance and air volumes. Under laboratory and field conditions, the team tested units under “as-is” filter conditions, without a filter,

with a clean filter, and using an apparatus to simulate a dirty filter. The testing results indicated a filter’s cleanliness changed the operating point along the “fan current vs. air volume” curve, but even a very dirty filter shifted the curve down by less than 10% versus a cleaned filter and by about 5% versus an average filter. Based on these data, the team concluded that no adjustments to account for filter cleanliness were necessary when processing measured data, since the measurement approach (i.e., logging indoor head current) accurately represented the unit’s delivered airflow.

**Figure 71. Filter Maintenance**



## Outdoor Unit Placement

The field staff observed many DMSHP outdoor units improperly mounted or lacking appropriate clearances from roof drain water. During the winter, many units were exposed to snowmelt from a home’s roof or to water collected from the defrost cycle (as melted snow and ice can build up on the unit itself). Without adequate clearance below the unit, this water could freeze and impair condenser fan operation. The team observed this scenario for at least one site, illustrated by Figure 72. The manufacturer’s recommended clearance illustration<sup>43</sup> does not clearly define a minimum clearance value above the ground, but it implies that mounting the unit on two cement blocks would be appropriate. While the unit in the photo (left) has about one inch of clearance, the illustration (right) implies a unit should have about four inches of clearance below the unit.


---

<sup>43</sup> Mitsubishi Electric Corporation. *Outdoor Unit Service Manual No. OBH543 Revised Edition-A*. September 2010. Available online: [http://www.mitsubishipro.com/media/214712/muz-fe09-18na\\_service\\_obh543a\\_9-10.pdf](http://www.mitsubishipro.com/media/214712/muz-fe09-18na_service_obh543a_9-10.pdf)

**Figure 72. Clearances Underneath Outdoor Units**



**REQUIRED SPACE**

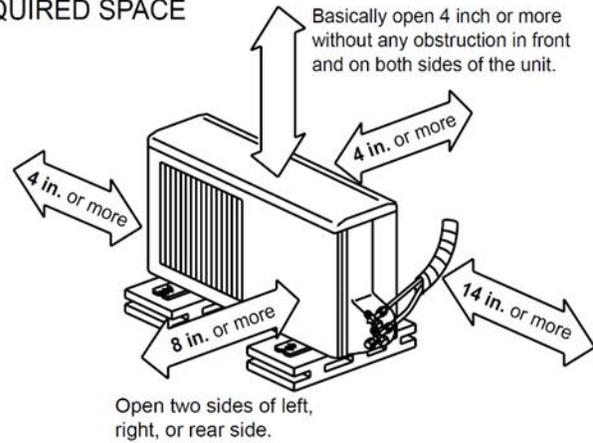

Clearance issues do not exclusively result from installation practices. Several homeowners reported experiencing rapidly diminishing capacity over time, and field staff found outdoor units within piles of items or other debris. In one notable case, shown in Figure 73, a pile of lawn furniture encircled an outdoor unit, which was half-protected from scratches by a tarp.

Figure 73. Clearances Around Outdoor Units



The effort required to maintain a DMSHP outdoor unit's operable condition during winter presents another anecdotal finding. As this study stretched across the winter months, particularly January and February of 2015 (which experienced extended freezing temperatures and uncommonly high snowfall), several participants' DMSHP outdoor units became encased in snow and/or ice. Figure 74 shows a DMSHP unit that the evaluation team visited in February 2015. Without clearance around the outdoor unit, the DMSHP could not provide heating to the home's interior. The team removed snow from the front and rear of the unit, using only their hands to prevent damage to the exposed heat exchanger fins or the refrigerant lines.

Figure 74. Maintaining Clearances in Wintertime



The direction and presence of significant, prevailing winds also can play a role in outdoor unit performance. At an oceanfront site examined during the study, the DMSHP outdoor units were directly exposed to a strong ocean breeze. During summer, this unit placement boosted performance as the ocean breeze helped draw heat out of the unit and aid in the cooling process.

During winter, however, the DMSHP occasionally went into a defrost cycle to remove accumulated frost that can build up on the outdoor unit. During this process, the refrigeration cycle reversed, pushing heat into the outdoor unit's coils. Normally, without significant wind, the defrost cycle turns off indoor and outdoor unit fans, while the coil reaches a temperature sufficient to melt the accumulated ice. With the outdoor unit subjected to windy conditions constantly, the outdoor coil had difficulty reaching the cut-off temperature, and the cycle continued for prolonged periods. This process drew heat out of the house, which was quite frustrating to the homeowner and detrimental to the unit's energy performance. Figure 75 shows these two units, roughly 100 feet from the shoreline and exposed to ocean breezes. Relocating these units to the home's leeward side would remove issues occurring during the defrosting process.

Figure 75. DMSHPs in Windy Environment



### Indoor Unit Placement

Placement of the DMSHP's indoor unit serves as a major driver for a system's overall efficacy. The DMSHP head must be placed so it can circulate air through the entire conditioned space and can provide a uniform comfort level. Properly placed indoor units include ample space above the unit; so air can be drawn from the space and through the unit, and to provide sufficient clearance for filter access and cleaning. During the study, the field staff encountered several units installed too close to the ceiling, and the resulting airflow suffered from the flow restriction. Figure 76 shows a unit that, though with the minimum clearance specified by the installation manual, did not achieve airflows as high as other metered units of the same model.

Figure 76. Vertical Clearance on Indoor Unit



### Unit Controls


During the study, field staff continually encountered homeowners confused by the operation of the DMSHP remote. Generally, many homeowners found images on the remote too small to read and too similar to each other to understand. These homeowners reported a lack of clarity when using the remote resulted in several service calls to installers for nonoperational units that, ultimately, were resolved by adjustments of the remote settings.

As shown in Figure 77<sup>44</sup> (inside the red box), the symbols for cooling (symbol 2 from the top) and heating (symbol 4 from the top) look very similar, especially given the remote's actual size (one-half the size of the image shown in the figure). During a visit by the evaluation team, the homeowner sat in a 92 °F house with the DMSHP set to heat, believing it was set to cool.

---

<sup>44</sup> Mitsubishi Electric Corporation. *Indoor Unit Service Manual No. OBH542 Revised Edition-A*. September 2010. Available online: <https://www.rfwel.com/downloads/manuals/KMO8C-User-Manual.pdf>

Figure 77. Operation of DMSHP Remote Control

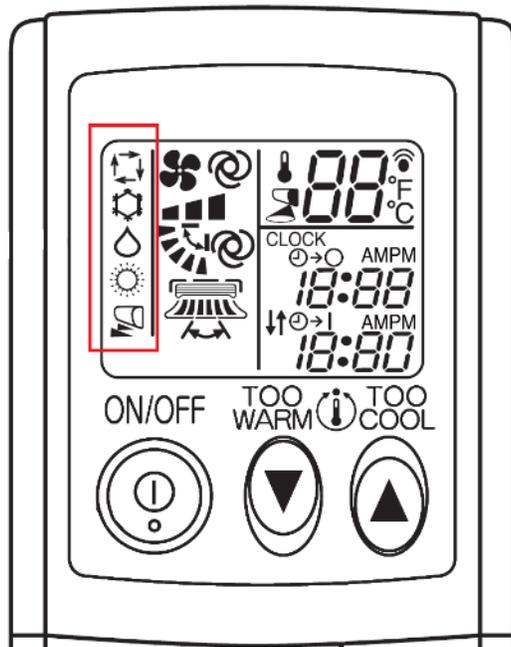

### Staging of Alternative Heating Systems

Homeowners frequently asked the evaluation team about interactions between two or more forms of heat within a home. Specifically, homeowners wanted to know when to use each system and how to set the thermostats for each (i.e., “staging”). Based on data the team collected and subsequent analysis, the team determined that using the DMSHP proved more cost-effective at milder heating temperatures.

As the COP of DMSHP units decrease with outdoor temperatures, the price of each heat unit increases. This stands in contrast to fossil-fuel heating systems, which typically draw combustion air from a semi-conditioned space and produce the same amount of heat across a wide band of temperatures. As one system becomes more expensive to generate heat and the other stays constant, a crossover point occurs where a fossil-fuel heating system becomes the more cost-effective heating method. This crossover point depends on each heating system’s efficiency, the fuel’s cost, and the fuel’s heat content.

To illustrate this concept, the COP chart in Figure 52 can be used as a reference. On average, because DMSHP units exceeded a COP of 1.0 at all temperatures, a DMSHP proved a more efficient use of energy than an electric resistance heater.

The crossover point, defined as the point where using either source proves is equally cost-effective, is characterized by the following equation:

$$\frac{\$}{\text{Heat Provided}_{\text{DMSHP}}} = \frac{\$}{\text{Heat Provided}_{\text{Other Heat Source}}}$$

Generally, the price per unit of energy is written as follows:

$$\frac{\$}{\text{Heat Provided}} = (\text{Price of Fuel Input})/(\text{Efficiency})$$

Evaluating this in terms of BTUs and for the DMSHP, this becomes:

$$\frac{\$}{\text{BTU}_{\text{DMSHP}}} = \left(\frac{\$}{\text{kWh}}\right) * \left(\frac{1 \text{ kWh}}{3,412 \text{ BTU}}\right) * \left(\frac{1}{\text{COP}}\right)$$

Where:

*COP* is related to temperature through Figure 52 and Figure 53  $\frac{\$}{\text{kWh}}$  = price of one kWh of electrical energy. For an oil boiler, this equation is written as follows:

$$\frac{\$}{\text{BTU}_{\text{Boiler}}} = \left(\frac{\$}{\text{Gallon of Oil}}\right) * \left(\frac{\text{Gallon of oil}}{139,600 \text{ BTU}}\right) * \left(\frac{1}{\text{Efficiency}}\right)$$

Where:

$$\frac{\$}{\text{Gallon of Oil}} = \text{price of one gallon of \#2 heating oil}$$

*Efficiency* = the boiler's efficiency

For a gas furnace, this equation is written as:

$$\frac{\$}{\text{BTU}_{\text{Furnace}}} = \left(\frac{\$}{\text{therm of gas}}\right) * \left(\frac{\text{cubit feet of gas}}{1,050 \text{ BTU}}\right) * \left(\frac{1}{\text{Efficiency}}\right)$$

Where:

$$\frac{\$}{\text{therm of gas}} = \text{price of one therm of natural gas}$$

*Efficiency* = the furnace's efficiency

Figure 78 shows a two-dimensional map of electric and fuels prices. The topographical style lines show a third dimension of the temperature breakpoint discussed above, where a DMSHP becomes less expensive to operate than an alternative fuel-fired heating system. The temperature dependence results from DMSHPs' drop in efficiency at lower temperatures. A round blue circle indicates average energy prices for winter 2016; a red triangle indicates energy pricing for winter 2015.

For natural gas, the figure shows a temperature breakpoint above 70°F for either winter, meaning a DMSHP only operates cost-effectively above 70°F (compared with an 80% efficient heating system).<sup>45</sup> This effectively means a DMSHP does not provide a viable direct replacement for a gas-fired system at

---

<sup>45</sup> System efficiency is inclusive of duct losses, and furnace fan and boiler pump energy use. It is, however, lower than the rated or measured combustion efficiency.

today's energy prices. This analysis does not account for zonal savings. For example, if a homeowner used a DMSHP to heat 30% less of their home, that temperature balance point would drop to 50°F.

The figure also shows a temperature balance point about 32°F for an oil-fired system in 2016 and 12°F in 2015. The balance point for propane was -15°F for both winters, meaning the DMSHP always was less expensive than the propane option.

Figure 79 shows the same analysis, but for units listed as cold climate units. These units operate somewhat more efficiently, and the economic balance points shift to colder temperatures, where gas balance points were above 58°F for both winters. Balance points were 26°F for an oil-fired system in 2016 and 8°F in 2015. These values do not account for zonal savings. For example, if a homeowner can use a DMSHP to heat 30% less of their home, the temperature balance point would drop by 20°F or more.

Figure 80 shows the same analysis, but bases it on the rating curve of a current cold-climate unit, with an HSPF of 13. A DMSHP operates more economically than propane for all temperatures; so it is not shown in this figure. The balance point for oil dropped slightly, about 15°F in 2016 and 8°F in 2015. The balance point for natural gas dropped to 40°F for 2015 and 28°F for 2016.

Figure 78. Operational Break Point Temperature of Heating with DMSHP, Winter 2016, All Units

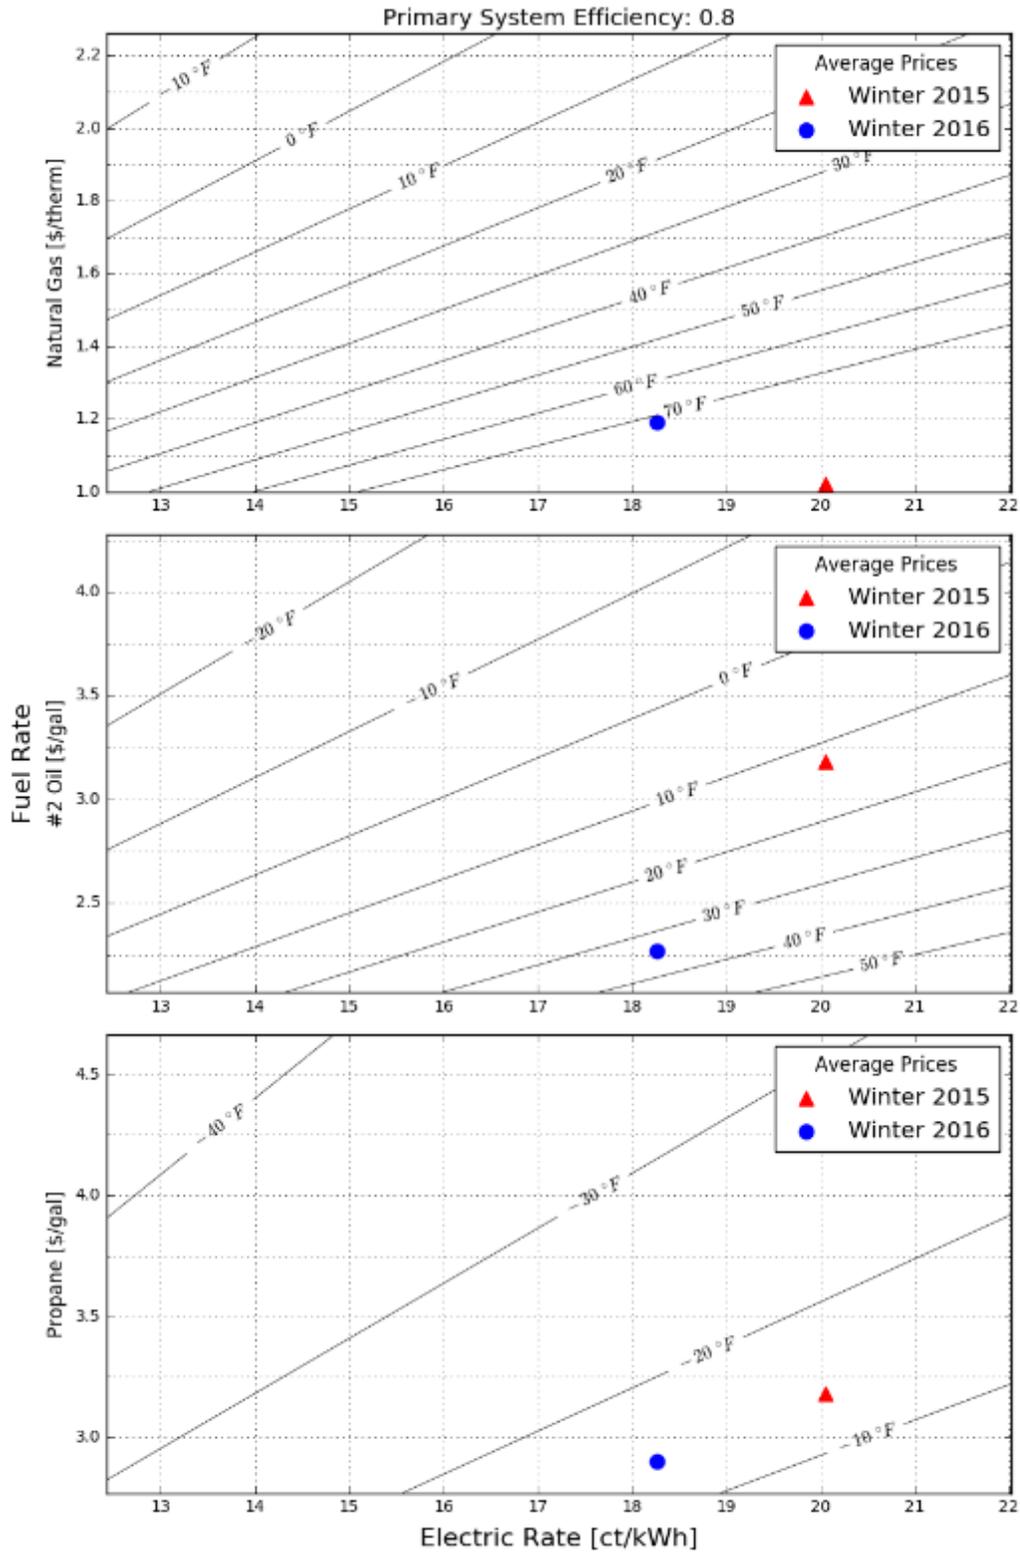


Figure 79. Operational Break Point Temperature of Heating with DMSHP, Winter 2016, Cold Climate Units


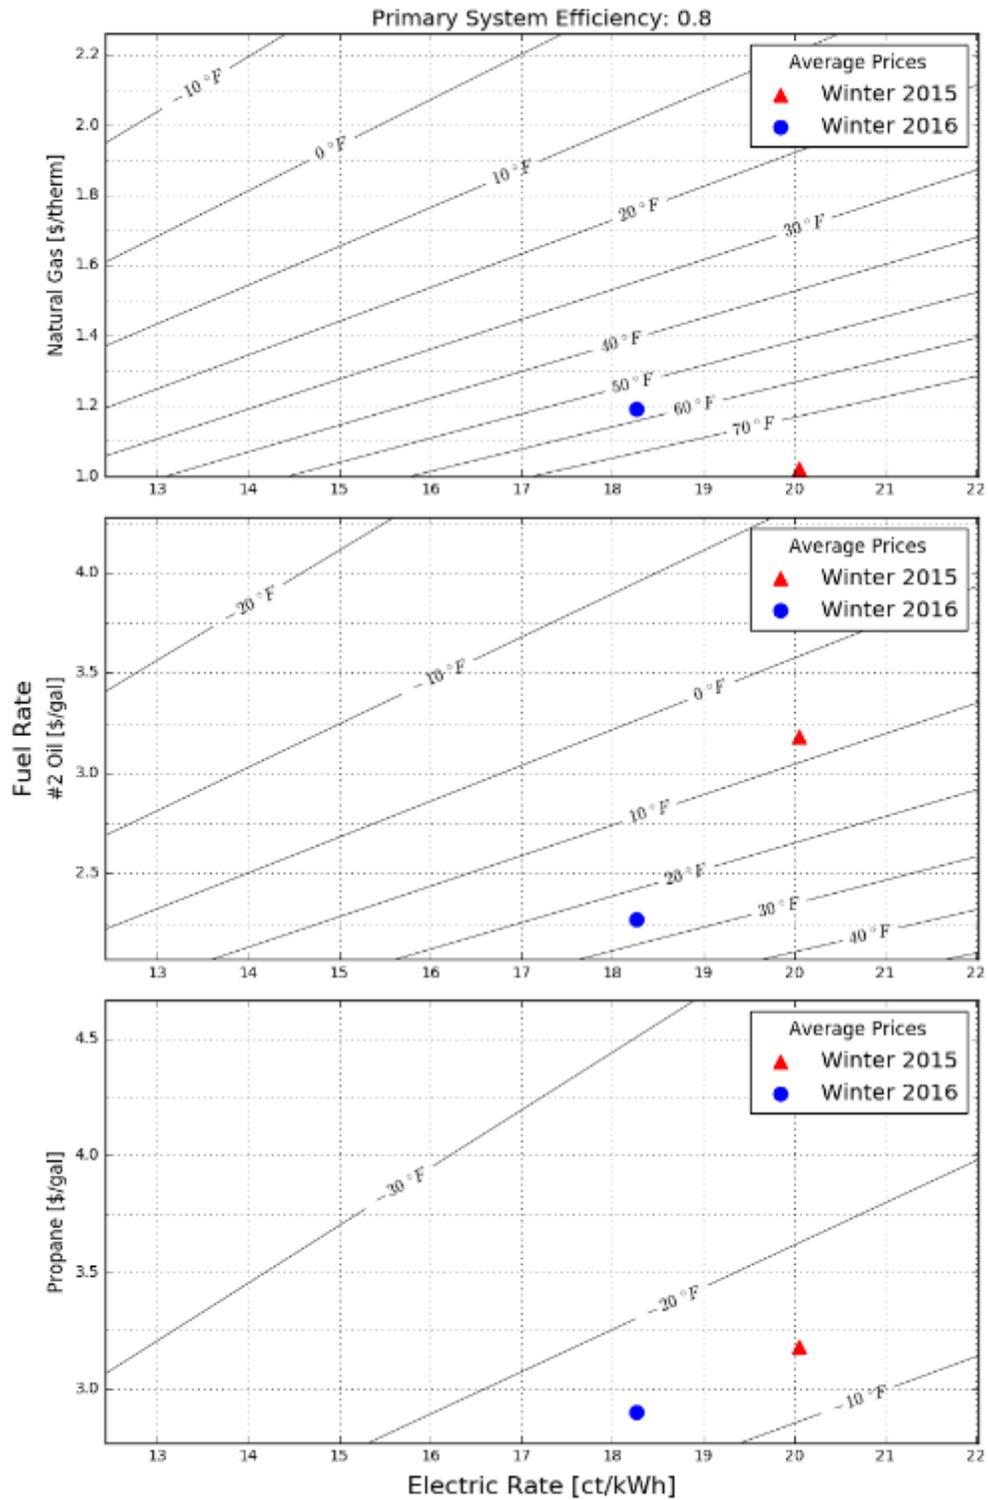


Figure 80. Operational Break Point Temperature of Heating with DMSHP, Assumed HSPF of 13

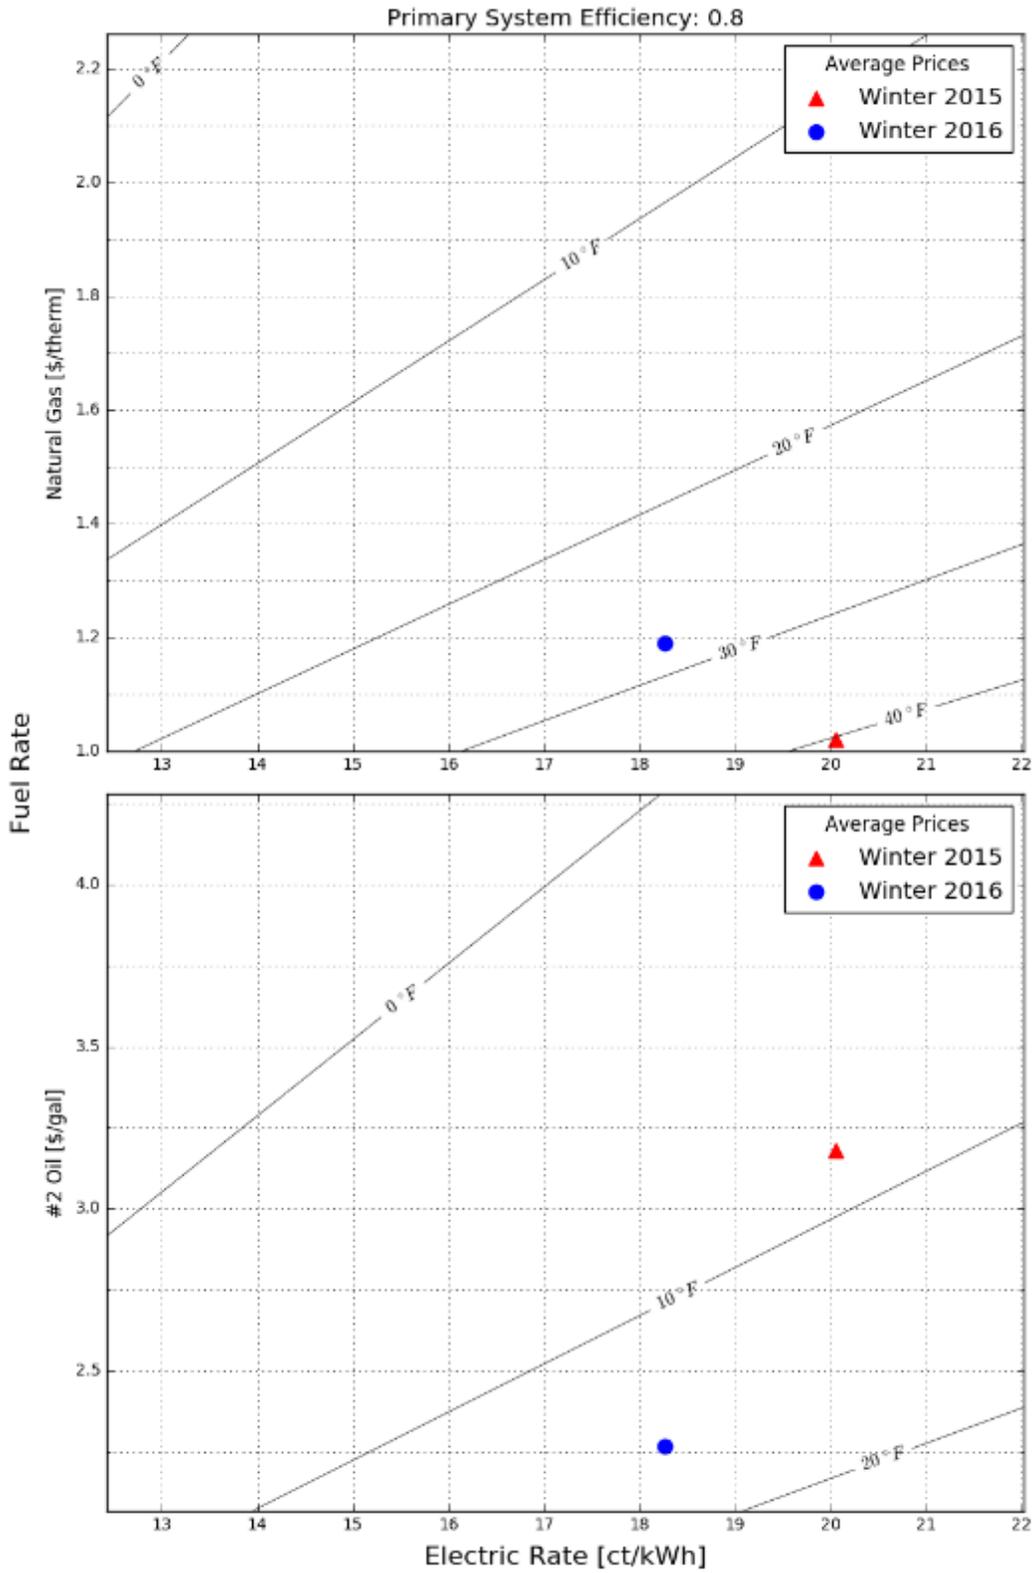

At outdoor temperatures above the crossover point and where zoning allows, the evaluation team recommends setting the DMSHP thermostat to the desired temperature and setting the boiler/furnace zone thermostat several degrees below. When the outdoor temperature drops below the crossover point, the relationship of the two systems should switch. The boiler/furnace should then be set at the desired temperature, and the DMSHP should be set several degrees below. In both cases, the system set to the lower temperature will act as a backup should the primary system not maintain the desired temperature.

When setting the DMSHP as the primary system, a risk exists: it is possible that sections of pipe for the boiler and radiators could freeze if on the outer walls of a home or if air infiltration occurs near a pipe. If possible, circulating water within the pipes can be helpful at low outdoor temperatures to avoid freezing. Alternatively, utilizing the boiler intermittently at low outdoor temperatures will help avoid frozen pipes.

### Localized Heating

The field team identified another potential savings source by interviewing participants about their heating behaviors. Several participants responded that they often used the DMSHP to heat a small section of the home, while leaving central heat at a lower set point. For homes without zone control (i.e., just one central thermostat), this approach creates energy savings.

When operating the DMSHP in this way, interactions with central heating should be considered, especially at the thermostat's location. For example, if the DMSHP heats the section of a house where the thermostat controlling a central heating boiler is located, that thermostat may never call for heat as the DMSHP satisfies its requirement. In this scenario, the home outside the DMSHP area grows cold as DMSHP heat will not reach these areas, and the boiler will not provide heat as its control senses a space controlled properly above its set point.

### Non-Energy Benefits

Although non-energy benefits can be difficult to quantify, they can provide insights into consumer behaviors. During the study, the evaluation team learned of many non-energy benefits that customers reported from their experiences. Largely, these benefits divided into two subgroups, based on equipment displaced by the DMSHP:

- For customers replacing window air conditioners, non-energy benefits included the following:
  - Use of operable windows for ventilation and daylighting
  - Increased control over indoor air temperatures and humidity
  - Increased uniformity in air temperatures throughout a served space
  - Increased security from locking windows
  - Increased auditory comfort from compressors isolated away from the house framing
  - Quieter operation of indoor air fans
  - Isolation of outside noises from closed windows

- Decreased exposure to outdoor allergens
- Additional heating available, if needed
- Decreases in personal and property risk from installations or removals of window air conditioners
- Increased safety from decreased indoor outlet electrical draws
- Customers who purchased DMSHPs rather than centralized cooling systems reported the following non-energy benefits:
  - Increased control of localized cooling
  - Easier installation experiences (as ductwork was not needed)
  - Heating and cooling provided by a single technology
  - Multiple units decreasing the mean time to total failure for the entire HVAC system
  - Lower installed costs if a cooling system served only a portion of the home

## Discussion

In general, the evaluation found DMSHPs operated in highly variable ways, resulting in widely varying hours of use, energy consumption, and energy savings among units. Some variation results from a variable speed design, but a larger factor appears to be how users operate their equipment. A discussion follows that addresses results from cooling, heating, efficiency ratings, and airflow.

### Cooling

The evaluation identified an average EFLH cooling value of 218 hours, well below the value of 360 hours assumed in the Massachusetts and Rhode Island TRMs. Units often operated at low capacity, or customers turned them off for periods. The following elements contributed to the low EFLH:

- Units sometimes operated in dehumidifier or “dry” mode, where users could not increase or decrease set temperatures. In dry mode, the indoor unit senses the indoor ambient temperature, and lowers the coil temperature a few degrees to induce condensation formation. The unit then operates the fan on the lowest speed setting to avoid decreasing the space temperature too much.
- Some units cooled seldom-used spaces and were turned on only when needed.
- As DMSHP units did not experience duct losses or suffer from insufficient evaporator airflow (as some central air conditioning units might), they provided the same cooling level with fewer EFLH. That is, a central air conditioner can lose efficiency at the air handler due to low airflow, and then lose more energy through duct leakage and heat losses/gains as ducts pass through unoccupied spaces. DMSHPs did not experience these losses.
- On average, units were sized to provide about 2.6 times the design-cooling load calculated using Manual J. This could result from contractors sizing DSMHP units to meet larger design-heating loads. Units also may be designed to cool adjacent spaces when doors to a cooled room remain open.
- TRM sources for the legacy EFLH values may be inappropriate for DMSHPs (i.e., the cooling EFLH value was based on a 2009 study of central air conditioners).
- The top 25<sup>th</sup> percentile units had EFLHs that were very close to and in some seasons, above the TRM values, showing a good portion of units were used more heavily.

Given these factors, it is not entirely surprising that the average EFLH fell below TRM values. Savings calculations in the Massachusetts and Rhode Island TRMs are a function of this EFLH parameter, but also of unit capacity. A low EFLH reduces savings in a TRM equation, but it may not mean reduced savings in relation to a smaller unit that would have higher EFLH. For example, if a unit’s size were reduced by 50%, the EFLH would roughly double, but the TRM equation would yield the same savings:

$$2 \text{ (EFLH)} * 0.5 \text{ (Capacity)} = \text{EFLH} * \text{Capacity}$$

The evaluation team based savings on the baseline and efficient systems providing identical cooling but at varying efficiencies (i.e., a 16 SEER air conditioner can deliver cooling using 75% of the energy required for a 12 SEER air conditioner).

In many cases, DMSHPs provide additional savings beyond more efficient operation, and therefore may provide higher savings than indicated through comparisons with baselines. As shown later in this report, DMSHPs were installed at approximately 1 ton of capacity per 1,043 s.f. of home floor area, a value far lower than typically observed for central air conditioners. Homeowners frequently shut off DMSHPs due to unoccupied rooms or mild outdoor temperatures. Thereby, a DMSHP can deliver zonal savings by performing less cooling. DMSHP also can run in dehumidification mode, further reducing the need for cooling.

When considering new construction program, DMSHPs could potentially deliver savings from zonal behaviors where homeowners fully cool only a portion of their house, while central air conditioners typically do not offer this control—to cool one room, the homeowner must cool their entire house.

For this study, the majority of DMSHPs served as the only cooling source. Homes cooled solely with DMSHPs used an average of 194 kWh for the cooling season, including standby power. Using the Massachusetts TRM value for a central air conditioner's EFLH (360 hours), a home would use approximately 830 kWh/season for a 2.5-ton unit, and about 1,000 kWh/season for a 3-ton unit. This striking difference (830 – 1,000 kWh vs. 194 kWh) argues for investigating marketing and incentivizing DMSHP units as an alternative to central air conditioners in new construction.

## **Heating**

The study found an EFLH heating value of roughly 450 hours. In nearly all cases, observed DMSHP units provided heat coincidentally with other systems. In most cases, DMSHPs served as secondary systems, either to provide heat for a single space or to provide heat above a primary system's base load.

The cost-effectiveness of DMSHPs used for heating depends on alternative heating systems, energy prices for a given period, and outside air temperatures. Compared against electrical resistance and propane heating, DMSHPs proved more cost-effective for all energy prices (using the same energy source) and all outdoor air temperatures. For oil-fired systems, the relative energy price determines the temperature above which a DMSHP became more cost-effective. Given low current oil prices, relative to historic values, DMSHPs offer cost-effective heating when compared to oil but only for temperature ranges discussed in this report. A DMSHP, however, seldom proved cost-effective when compared to natural gas heating systems (excepting a scenario where a DMSHP heats single space, thus negating the need to turn on a whole house heating system).

## **COP/SEER/HSPF**

The evaluation team directly metered efficiencies of DMSHP units during winter and summer seasons. Most previous studies have estimated COP using metered power (i.e., not very accurate), or have calculated COPs for brief periods and small unit quantities. This study found unit efficiencies varied

widely by site and period to period, partly due to temperatures and partly due to set points. Field-measured seasonal efficiencies for most units fell below their rated values, on average, although some units met or exceeded their ratings. Measured SEER values below unit ratings occurred for the following reasons:

- Some seldom-used units still used some standby power.
- Some homeowners used DMSHPs only used to cool on the hottest days; so their cooling efficiency was closer to rated EER values (i.e., the efficiency rating at 95 °F) than to SEER values.
- SEER and EER tests run under specific conditions might not fully represent actual operations. For example, the SEER test uses return air is 80 °F—a temperature much higher than most homes during the cooling season.
- Units used for other functions could reduce a units rated performance (e.g., fan-only mode, dry or dehumidification mode).

Measured HSPF values could fall below rated values for the following reasons:

- Some homeowners used DMSHPs during very cold outdoor conditions, when the resulting DMSHP COP fell below its rated value.
- HSPF tests run at specific conditions may not fully represent actual operations.
- Units used for other functions could reduce rated performance (e.g., fan-only mode).
- Site conditions could cause units to run in defrost mode for long periods of time, decreasing efficiency. The evaluation team has completed other studies that discovered marked differences in the frequency of defrost cycles for different brands.

Although field-measured efficiencies generally fell below rated efficiencies, this does not mean that manufacturers have not been forthright. Others including AHRI stipulate test procedures for cooling and heating at 47°F and 17°F. Many manufacturers use third-party laboratories for testing, so values are verified. A number of units performed at their ratings, supporting the contention that operating conditions and operators' behaviors greatly contribute to delivered efficiencies.

This study metered units with a rated average 20.6 SEER and a rated average 10.3 HSPF. Manufacturers continue to increase the efficiency ratings of systems they offer, with the upper range of units currently offered at 33 SEER, with many units above 25 SEER. DMSHP manufacturers offer units with HSPF ratings up to 14, with many units above 12 HSPF. These new units would deliver cooling and heating more efficiently than units measured for the study.

### ***Savings Values***

EFLH and savings values are based on averages that included lightly used equipment as well as on equipment with rated efficiencies below that currently available in the marketplace. While current EFLH and savings values may be low relative to legacy TRM values, the evaluation team has observed high

heating usage and EFLH in northern New England by populations motivated to displace oil heat.<sup>46</sup> As outlined in the recommendations section, the team recommends incentivizing the highest-tier efficiency levels to increase savings, and combining incentives with contractor and consumer education. This approach could target high-use customers found in this study's customer distributions.

### **Controls and Zoning**

Use of preexisting heating systems limit DMSHP use for heating. Most furnaces are single-zone systems, meaning a single thermostat and single set point controls the home's temperature. In these homes, if a DMSHP heats only one or two rooms, homeowners find it difficult to use the DMSHP as a primary heating system because if they rely solely on the DMSHP, other portions of the house remain unconditioned. If they turn on the baseline system to heat the rest of the house, the area served by the DMSHP is also heated. A similar issue occurs with boiler-heated homes, but might be more solvable as boilers often heat separate zones, served by separate zone valves or separate secondary pumps. In homes with individually controlled electric strip heating, the primary system can be more readily replaced with a DMSHP.

To increase DMSHP heating use and associated savings, the zone served by the DMSHP needs to match a zone of the primary system. This can be accomplished by targeting homes with zoned (e.g., oil or propane-fired) boilers, room controlled electrical resistance heating, or by installing multi-head systems that combine to serve a complete zone. The DMSHP's temperature setting would then be set above the dead band of the primary system's thermostat (i.e., 3°F). For example, if the DMSHP were set to 70°F, the primary system's thermostat would be set to 67°F.

Allowing the DMSHP and the primary thermostat to communicate with each other would improve this situation. Under this scenario, set points for the primary and DMSHP would be 67°F and 70°F, respectively. When the room became unoccupied, the set points could drop to lower temperatures. This way, the DMSHP would become the primary heating system, and additional zonal savings could be achieved where unused portions of the home were not fully heated.

Achieving this communication, however, currently remains a challenge. Major ductless system manufacturers and wireless thermostats makers recently have made progress in designing systems that work together. The evaluation team recommends makers of various smart thermostats and DMSHP manufacturers continue collaborating to develop protocols that allow the devices to communicate.

### **Airflow**

Generally, airflow measuring airflow is difficult due to its variable nature, and most methods present large associated uncertainties. Compounding this, measuring a DMSHP's airflow is even more difficult as the airflow is free discharge (i.e., not ducted) and variable, with most indoor heads capable of four or

---

<sup>46</sup> Unpublished Cadmus study on Vermont.

more speeds. This evaluation reviewed the most current methods for measuring DMSHP airflow (e.g., fan amperage, volumetric) spot measurements and added some notable improvements.

The evaluation team measured a large number of models and units, which decreased uncertainty. The team constructed and employed a quasi-laboratory flow nozzle to check measurements of a field-practical balometer. The testing found airflows 10% less than the units' rated values generated by independent laboratories. That these field-measured airflows are close to rated values makes sense; unlike central-ducted systems, DMSHP units installed in homes generally are similar to those installed on the wall of a test facility (i.e., no ducts or obstructions to modify airflow).

Uncertainty exists regarding these and any airflow measurements. For five test homes, the evaluation team deployed the powered, quasi-laboratory flow nozzle and the balometer. For these homes at all indoor fan speeds, the balometer measured airflow similar to but 5% to 10% higher than the flow nozzle. As no compelling evidence emerged to support one method as more accurate than another, the team used the balometer readings without adjustment. This judgment did not affect DMSHP savings estimates, as baseline system efficiencies were decremented by an equivalent amount, along with proposed DMSHP systems (see Analysis: Savings section).

## Recommendations

### *Recommendations*

#### Program

**Recommendation: The evaluation team recommends exploring ways to improve the PAs' existing lost opportunity program for DMSHPs, such as how best to encourage the installation of multiple DMSHP heads to better match existing zones and displace primary system operation.** Although the EFLHs decreased from the values prescribed in the Massachusetts TRM, the study still finds that a modest level of savings are achievable by moving from a standard efficiency DMSHP to a higher efficiency DMSHP. Substantially more savings could be achieved (i.e., the top 25% of savings) if newly installed DMSHPs are operated more regularly and continuously by better matching and integrating them zonally with primary heating systems, through better configuration design and installation and contractor and customer education and training. For example, contractors would focus their design efforts on specifying the appropriate number and size of DMSHP heads to match and heat entire zone(s) rather than a single room. Customers would then be educated on how to properly set the set points for both their primary and DMSHP heating systems, which will depend on their primary fuel type and outdoor temperatures. Finally, establishing program incentives for the generally more efficient, cold climate heat pumps would lead to increased program savings.

**Recommendation: The evaluation team recommends exploring methods for targeting homes with electric resistance heating for DMSHP retrofits.** DMSHPs will nearly always be less expensive to operate than electric resistance heat, as shown by the COP of DMSHPs remaining above 1.0 on average for nearly all outdoor temperatures. Even at very cold temperatures where some non-cold climate units approach a COP of 1.0, the number of hours in this condition are very few. Prior to new activities, program and consumer cost-effectiveness would require review.

**Recommendation: The team recommends targeting propane-heated homes for DMSHPs.** As Figure ES-6 and Figure ES-7 show DMSHPs always operate less expensively than propane heating systems. Prior to new activities, program and consumer cost-effectiveness and regulatory considerations for fuel switching would require review.

**Recommendation: The team recommends exploring methods for addressing oil-heated homes.** To target these homes, homeowners should be educated to turn off a DMSHP during very cold outdoor conditions (below 8°F in 2015 and below 25°F in 2016), when an oil-fired system would operate less expensively (depending on energy prices and cold temperature COPs). This operating scheme, however, may not appeal to all customer types, as many may not wish to concern themselves about which heating system to operate and when. If oil prices increase against electric energy rates, the switchover temperature point for oil to DMSHP heat may move lower, allowing continual use of a DMSHP. Switchover points for all fuel comparisons will decrease as more efficient DMSHP units become

available. Prior to new activities, program and consumer cost-effectiveness and regulatory considerations for fuel switching would require review.

**Recommendation:** Based on large energy-usage differences in DMSHP-cooled homes and central air conditioner-cooled homes, **the team recommends examining opportunities for a new construction measure to substitute DMSHPs for central air conditioners.**

### Future Studies

This study provided a great deal of data describing how DMSHPs actually operate in Massachusetts and Rhode Island homes. These operations varied widely among units, with some used heavily and others used more like appliances turned on for short periods. Highest savings could be achieved by targeting homes where such units would deliver greater amounts of heating and cooling (i.e., where they can be installed to match the zoning of existing systems).

Another factor in increasing DMSHP savings will be development of controls that allow ductless systems and primary thermostats to interact and share information. The evaluation team recommends either targeting studies for new construction homes without natural gas available and where central air conditioning systems would be installed; or existing homes with electrical resistance and propane heating. These studies would help refine the best ways for DMSHP programs to achieve maximum savings.

Other future studies could explore the use of interfaces between learning thermostats and ductless systems. Future research questions include the following:

- How can utilities target homes with a high probability of using DMSHPs to displace more heating and cooling, therefore producing higher savings?
- What potential exists for new high-HSPF units to displace heating?
- What optimal zonal and control characteristics maximize use of DMSHPs?
- For new construction, how large would zonal savings have to be to avoid installations of single-zone central systems?

## Appendix A: Measuring Airflow in DMSHPs

### Airflow

Appendix A may repeat certain report elements, but the evaluation team chose to provide additional detail on methods used for establishing DMSHP airflow. The team hopes that the following discussion will help inform future field studies regarding best practices for estimating airflow, especially for extended-duration conditions.

The evaluation team recommends the following the airflow measurement methods developed in previous published studies and refined through this study:

1. Use either a balometer or a powered flow hood for measuring volumetric airflow coincidentally with measured fan amperage. For large studies, a non-powered flow hood or a powered balometer (for low flows)—such as a Flow Blaster—would be practical.
2. The team does not recommend using a flexible flow bag for airflow measurement, as applied in other studies.
3. A flow nozzle, such as the one tested in this study, can be used for small-scale, controlled, or laboratory studies, but it is not recommended for large-scale field studies. It does, however, prove useful for calibrating or adjusting the measurements of equipment recommended in #1.

### Motivation and Intention

The concluding equation presented in the Method/Energy section defines energy removed or added to air as a direct function of the volumetric air flow ( $\dot{V}$ ). To determine that volumetric air flow, the evaluation team used a combination of on-site point measurements and logged values. The team chose these methods for their ease of implementation, lack of interference with unit operations, quality of data collection, and preservation of unit integrity and housing.

### Background Literature for Flow Hoods

At the project's beginning, the evaluation team reviewed publicly available literature, seeking to understand the existing body of knowledge and to check the proposed approach for measuring volumetric air flow against other methods. In November 2012, a Lawrence Berkeley National Laboratory (LBNL) publication proposed a variety of methods for taking such measurements, and presented seven methods of measuring air flow using flow hoods against a laboratory metric.<sup>47</sup>

Typically, flow hoods are composed of fabric stretched over a collapsible, rigid frame that guides the air flow over a velocity or pressure-sensing element. Commercially produced, these units are frequently

---

<sup>47</sup> J. Chris Stratton, W.J.N Turner, Craig P. Wray, Iain S. Walker. *Measuring Residential Ventilation System Airflows: Part 1 – Laboratory Evaluation of Airflow Meter Devices*. LBNL-5983E. Ernest Orlando Lawrence Berkeley National Laboratory. November 2012. Available online: <<https://buildings.lbl.gov/sites/all/files/lbnl-5983e.pdf>>.

used in the air-balancing industry. Flow hoods can be divided into two categories—powered or non-powered—with the 2012 LBNL study testing a representative sample of 366 and 369 hoods, respectively.

The November 2012 LBNL publication cited an earlier 2001 LBNL publication that clarified the division of flow hoods. The 2001 publication divided standard flow hoods among two examined categories (i.e., active and non-powered):<sup>48</sup>

- Active (or powered) flow hoods reduce the effects of back pressure on flow measurements, usually through use of an exhaust fan to draw static pressure within the flow hood to equal the ambient environment.
- Non-powered flow hoods cannot forcefully remove the buildup of static pressure. To compensate for this, these instruments typically employ a damper to evaluate the impact of static pressure on the calculated flow and to produce a revised number, factory calibrated against a standard.

Using powered/non-powered segregation, the 2012 LBNL report concluded that two of the four non-powered flow hoods tested did not produce acceptable accuracy (defined at  $\pm 5$  cfm or  $\pm 10\%$  of the measurement reading from the reference airflow). In contrast, all three powered flow hoods produced acceptable accuracy.

On the surface, this conclusion helps reinforce decades-old skepticism in the industry regarding the accuracy of flow hoods for airflow measurement. Both the 2012 LBNL report and a separate 1999 publication, however, confirmed that flow hoods realistically provide the best method for measuring airflow with adequate accuracy.<sup>49</sup>

Excerpted from LBNL-5983E, Figure 81 shows a test for the model used in this study. The graph shows a range of airflow, tested up to 220 CFM, or roughly the two lower speeds of the DMSHP metered in this study. The boundary of accuracy is shown in green: at  $\pm 5$  CFM for low flows and at  $\pm 10\%$  for higher flows, with  $y = 0$  representing laboratory measurements taken as the true measurement.

---

<sup>48</sup> Walker, I.S., C.P. Wray, D.J. Dickerhoff, and M.H. Sherman. *Evaluation of Flow Hood Measurements for Residential Register Flows*. LBNL-47382. Lawrence Berkeley National Laboratory. September 2010. Available online: <http://epb.lbl.gov/publications/pdf/lbnl-47382.pdf>

<sup>49</sup> Ernest E. Choat, P.E. "Resolving Duct Leakage Claims." *ASHRAE Journal* (March 1999). Accessed June 6, 2016. Available online: <http://search.proquest.com/openview/d6c7203563370c8a9e8e050b11f0b2a9/1?pq-origsite=gscholar>

Figure 81. LBNL-5983E Figure 14

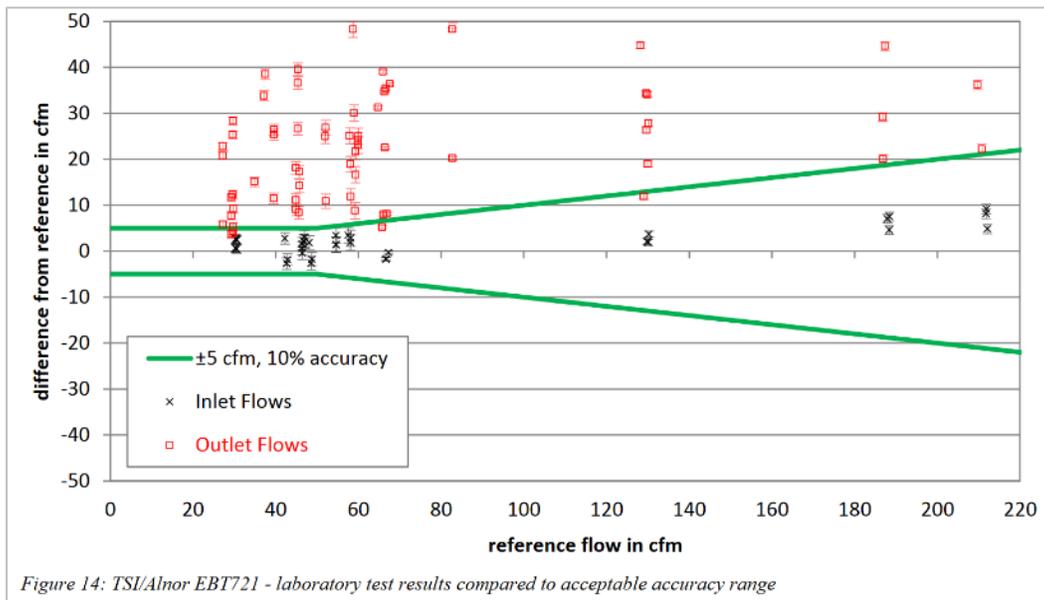



Figure 14: TSI/Alnor EBT721 - laboratory test results compared to acceptable accuracy range

At first glance, the balometer would appear inaccurate and imprecise, with varied readings outside of the accuracy boundary. The figure presents, however, two types of data: inlet flows, which represent typical use of a balometer; and the method used in this study, where air enters a wide mouth and flows to a measurement area; and outlet flows, where the balometer is used in reverse. Filtering Figure 81 for only inlet flows (black crosses) yields Figure 82, which shows TSI/Alnor EBT721 measurements within 5% of the reference measurement above 80 CFM (few DMSHPs even have speeds below this flow rate).

As stated in the 2012 report and in personal communications with its lead author,<sup>50</sup> the TSI/Alnor EBT721 produces acceptable accuracy when used to measure inlet flows.

<sup>50</sup> Personal communications with Dr. Iain Walker. Response to question via e-mail regarding LBNL-5983E Publication. May 19, 2016.


Figure 82. LBNL-5983E Figure 14, Adapted

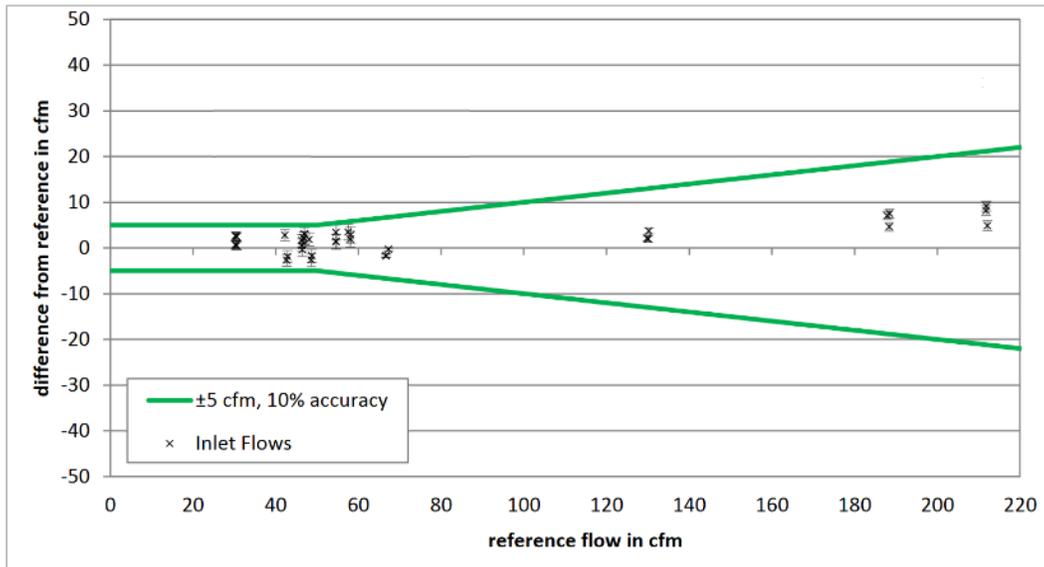

This large difference in accuracy results from the design of the balometer itself. As shown in Figure 83, during inlet flow, the air stream is guided towards the measurement section in the fabric cone. This results in smoother (more laminar) flow. In contrast, during outlet flow, air abruptly enters the measurement section and exits into the DMSHP. This does not smooth the airflow and consequently lowers the measurement accuracy. Fortunately, this study only used balometers for the inlet mode.

Figure 83 show differences between inlet and outlet flows and assists in explaining data presented in Figure 81.

Figure 83. Inlet vs. Outlet Flow

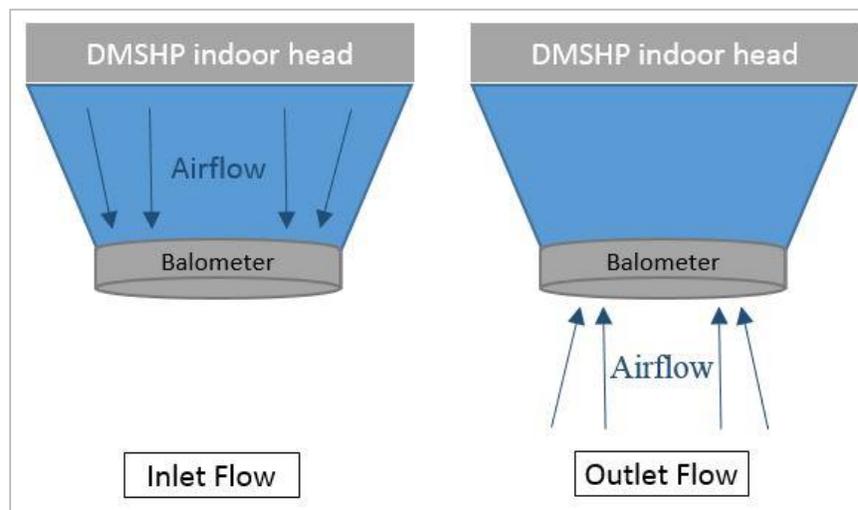

### Background Literature on Proximity Sensor Data Collection

Presented as a “Short-Term Air Flow Test,” a method<sup>51</sup> proposed in a NREL paper for providing long-term recording uses a proximity sensor, mounted close to a fan on an indoor unit. This arrangement used a thin, steel shim, bonded to the fan for the proximity sensor to detect each rotation, and the rotational speed would correlate to a volumetric flow determined on site. Figure 84 shows a proximity sensor, as mounted in the NREL paper.

**Figure 84. Proximity Sensor Arrangement (NREL Image 18330)**



\*Zia Fang. National Renewable Energy Lab. August 27, 2010.

<<https://images.nrel.gov/bp/#/search?q=18330&filters=%257B%257D#6309983>>.

The evaluation team attempted to reproduce this method under laboratory conditions, but could not obtain consistent results from the proximity sensor, and abandoned this approach. In the process, the team broke several plastic tabs on the laboratory unit while removing the protective grille and vertical louvers that shield immediate access to the fan, indicating this approach would prove unfeasible as a general field protocol.

The team also contacted the paper’s authors to understand how short-term measurements would be logged for long-term application and deployment. The authors answered this and indicated they had abandoned the proximity sensor approach in favor of using an optical tachometer to avoid working behind the louvers.

---

<sup>51</sup> D. Christensen, X. Fang, J. Tomerlin, and J. Winkler (National Renewable Energy Laboratory); E. Hancock (Mountain Energy Partnership). *Field Monitoring Protocol: Mini-Split Heat Pumps*. U.S. Department of Energy Building Technologies Program. March 2011. Available online: <http://www.nrel.gov/docs/fy11osti/49881.pdf>

Further, the authors reported that they recently achieved success by not measuring the fan speed at all; rather, they used the fan current as a proxy for airflow—a method discussed in this appendix (see Background Literature on Current Transformer Data Collection).<sup>52</sup> The authors also referenced a more recent study that used fan current as a proxy for airflow.<sup>53</sup>

### Background Literature on Optical Tachometer Data Collection

As discussed, the NREL authors also employed an optical tachometer for measuring airflow. Very similar to the proximity sensor method, this method uses a strip of reflective tape placed on the fan blades.

The evaluation team verified that this method generated values for a fan's rotational speed, although equipment available to the team would not allow long-term concurrent readings of fan rotational speeds and air volumes supplied by the unit. In addition, the team found that, to deploy an optical sensor, the DMSHP head had to be disassembled. Due to the way some heads are constructed, this would very likely damage many units.

Lastly, the team expressed concerns that installing a sensor close to a rotating fan could cause the sensor wire to entangle the fan, in some cases leading to damage and customer dissatisfaction. Consequently, this study did not rely upon optically sensing fan rotational speeds.

Figure 85 shows spot measurements conducted on the laboratory unit. Here, the vertical louvers and protective grille were removed to ease access to the fan; these should be reinstalled to return the unit to its proper condition.

---

<sup>52</sup> Personal communication with Dane Christensen and Dr. Jon Winkler. Response to question via e-mail regarding field monitoring protocol MSHP. March 30, 2016.

<sup>53</sup> Williamson, James, and Robb Aldrich. *Field Performance of Inverter-Driven Heat Pumps*. Prepared for the U.S. Department of Energy. August 2015.

Figure 85. Optical Tachometer Data Collection



### Background Literature on Current Transformer Data Collection

As previous fan speed measurements faced practical issues, the evaluation team chose to log airflow using fan amperage. DOE's latest report used fan amperage, and the team suspected the method would produce better results than alternative methods at detecting airflow differences due to wet coils and dirty filters. The team logged power going into the DMSHP indoor head as a proxy for power consumption of the indoor fan speed and volumetric airflow through the unit. In doing so, the team placed CTs on one wire providing power to the indoor head. Logging a value every minute for the study's duration, this method provided information on how the fan functioned. As the unit's fan speed fluctuated due to setting changes during the study, assuming a constant fan speed or volume would have been improper. Additionally, this method removed the need for direct access to the fan (difficult to achieve on most models and almost impossible on some). Figure 6, in the report's body, shows CTs installed on a DMSHP.

Using the current transformer method offers additional benefits from any debris accumulation or airflow restrictions from the indoor unit directly representing the power draw from the fan (see Filter Cleanliness section for more discussion).

### Moving from Indoor Head Current to Indoor Fan Current

Using CTs on outside units presents another complication: the measurement value is actually the total current supplied to the indoor head and not just the indoor fan current. As each DMSHP indoor head consumes a slight amount of power for the unit's circuitry and non-fan operations, this power must be estimated and removed from the measurements to arrive at the indoor fan current. The evaluation team, knowing of this impact's significance, developed a method to remove the non-fan components from the data.

First, during on-site testing, while logging the current at two-second intervals, the field staff turned the indoor unit on, letting it start blowing air, and then turning it off again. Leaving the indoor unit off for two to three minutes established more than 50 data points from which the team could evaluate the non-fan load. This load was subtracted from the raw data to establish the bound at which the fan remained non-operational. Everything above this line could be considered operational.

Field staff ran the unit in a fan-only or dehumidification mode (depending on the controls) to generate data for each fan speed. These data also were logged at two-second intervals, and the indoor fan volumetric airflow was logged concurrently with this data test. With these data available, the team could generate performance plots for each indoor fan at each fan level, drawing a regression line between available points to account for filter buildup and for operation changes.

### Measuring Airflow

As described in the [Background Literature for Flow](#) section, flow hoods are used to measure volumetric airflow through a DMSHP's indoor unit. The evaluation team used the TSI/Alnor EBT731, a replacement model for the now-discontinued TSI/Alnor EBT721 described in the literature review. The EBT731<sup>54</sup> maintains the same accuracy and fundamental properties of the EBT721;<sup>55</sup> so additional testing was not required to justify accuracy claims beyond those provided in the literature.

The team did, however, compare the non-powered flow hood (TSI/Alnor EBT731) against a powered flow hood to evaluate the accuracy of the non-powered flow hood used. In doing so, the team designed

---

<sup>54</sup> Alnor Products, TSI Incorporated. "EBT BALOMETER CAPTURE HOOD MODEL EBT731 AIR VOLUME INSTRUMENTS." Last modified May 5, 2014. Accessed July 27, 2016.


[http://www.tsi.com/uploadedFiles/Site\\_Root/Products/Literature/Spec\\_Sheets/EBT730-731\\_US\\_5001434.pdf](http://www.tsi.com/uploadedFiles/Site_Root/Products/Literature/Spec_Sheets/EBT730-731_US_5001434.pdf)

<sup>55</sup> Alnor Products, TSI Incorporated. "EBT Balometer Capture Hood Model EBT721." Last modified September 8, 2010. Accessed July 27, 2016.

[http://www.tsi.com/uploadedFiles/Site\\_Root/Products/Literature/Spec\\_Sheets/EBT720-721\\_2980561\\_Alnor-web.pdf](http://www.tsi.com/uploadedFiles/Site_Root/Products/Literature/Spec_Sheets/EBT720-721_2980561_Alnor-web.pdf)

a powered flow hood test using a setup very close to that used for the CARB 2015 “Filed Performance of Inverter-Driven Heat Pumps in Cold Climates” report,<sup>56</sup> shown in Figure 86.

**Figure 86. Basis of Experimental Powered Flow Hood Setup (Figure 4 from Williamson 2015)**

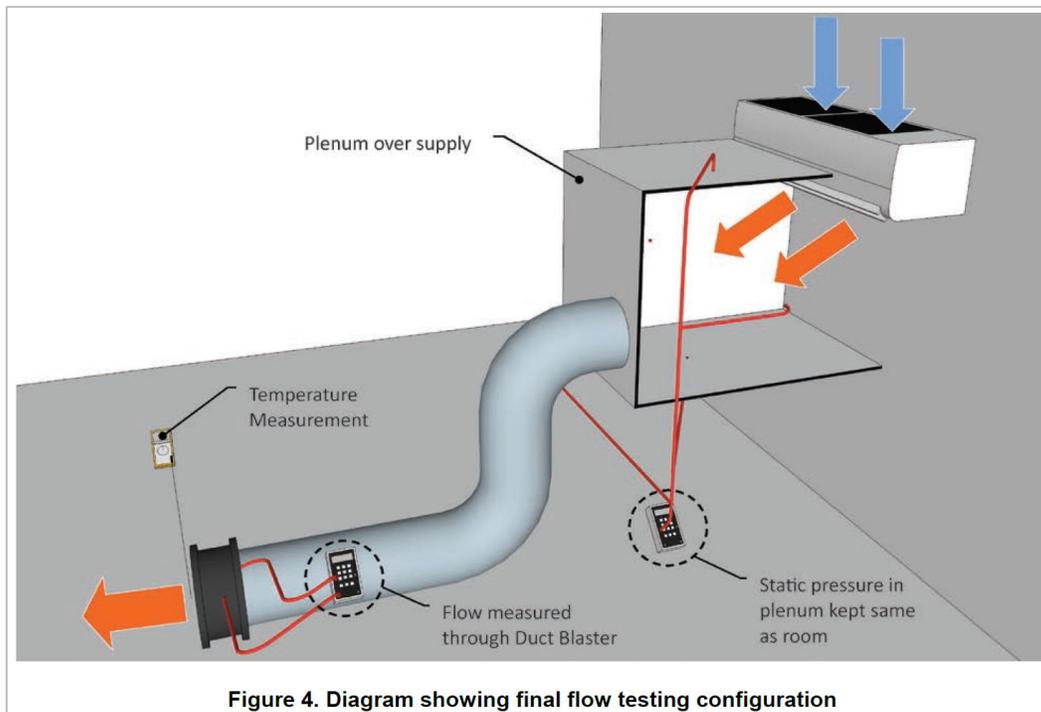

During the experimental setup’s development, concerns arose about the rapid convergence of flow required when using the arrangement shown in Figure 86. To correct for this, the team built a convergence nozzle to adapt the shape of the DMSHP’s indoor unit to the flexible plenum of the Duct Blaster. Referencing ASHRAE 51-1999,<sup>57</sup> Figure 5: Transformation Piece, excerpted in Figure 87, the team built the nozzle with a 7.5° convergence angle (shown in Figure 88). Additionally, the team minimized rapid changes in flow directions by keeping the convergence nozzle and plenum in line with the flow and by maintaining the linearity of the flexible plenum.

<sup>56</sup> Williamson, James and Robb Aldrich. *Field Performance of Inverter-Drive Heat Pumps in Cold Climates*. Prepared for U.S. Department of Energy. August 2015. Available online: [http://apps1.eere.energy.gov/buildings/publications/pdfs/building\\_america/inverter-driven-heat-pumps-cold.pdf](http://apps1.eere.energy.gov/buildings/publications/pdfs/building_america/inverter-driven-heat-pumps-cold.pdf)

<sup>57</sup> *Laboratory Methods of Testing Fans for Aerodynamic Performance Rating*. ANSI/AMCA 210-99, ANSI/ASHRAE 51-1999. Air Movement and Control Association International, Inc. 10CFR 430 Subpart B, App. M. Available online: <https://law.resource.org/pub/us/cfr/ibr/001/amca.210.1999.pdf>

Figure 87. Convergence Nozzle: ASHRAE 51-1999 Figure 5 (Excerpt)

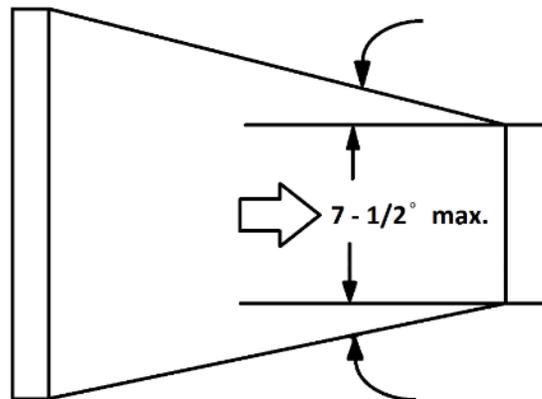


Figure 88. Powered Flow Hood Testing Setup



As Figure 88 shows, locking the convergence angle at  $7.5^\circ$  substantially extended the length of the entire setup—in this case, over 16 feet from the wall to the Duct Blaster's outlet (this did not include the necessary area at the Duct Blaster's outlet to reduce backpressure induced by constrained airflow). All testing completed for this study used at least eight feet of open space beyond the Duct Blaster's outlet.


Given the special constraints of the testing setup, applying this to a participant's homes clearly appeared neither feasible nor practical. Still, the team conducted this test at five homes, with setup time for a field team of two engineers at over an hour.

Per the CARB 2015 report setup and directions from Minneapolis Duct Blaster, the team included a flow conditioner in the setup, measuring the airflow using a single TEC DG700 Pressure and Flow Gauge, connected to a computer that logged values every second for the duration of a one-minute test. This

test operated similarly as the balometer tests, with all fan speeds sampled using individualized tests. Average flow rates and currents at each fan speed could then be used to build a fan curve and subsequently compared to the TSI/Alnor EBT731 balometer tests, conducted on the same indoor unit and utilizing the same outdoor metering setup.

Figure 89 shows the testing setup with the DG700 comparing pressures from the ambient environment, plenum static probe, fan, and fan ring, configured pursuant to Minneapolis Duct Blaster directions.

**Figure 89. Powered Flow Hood Testing Setup**

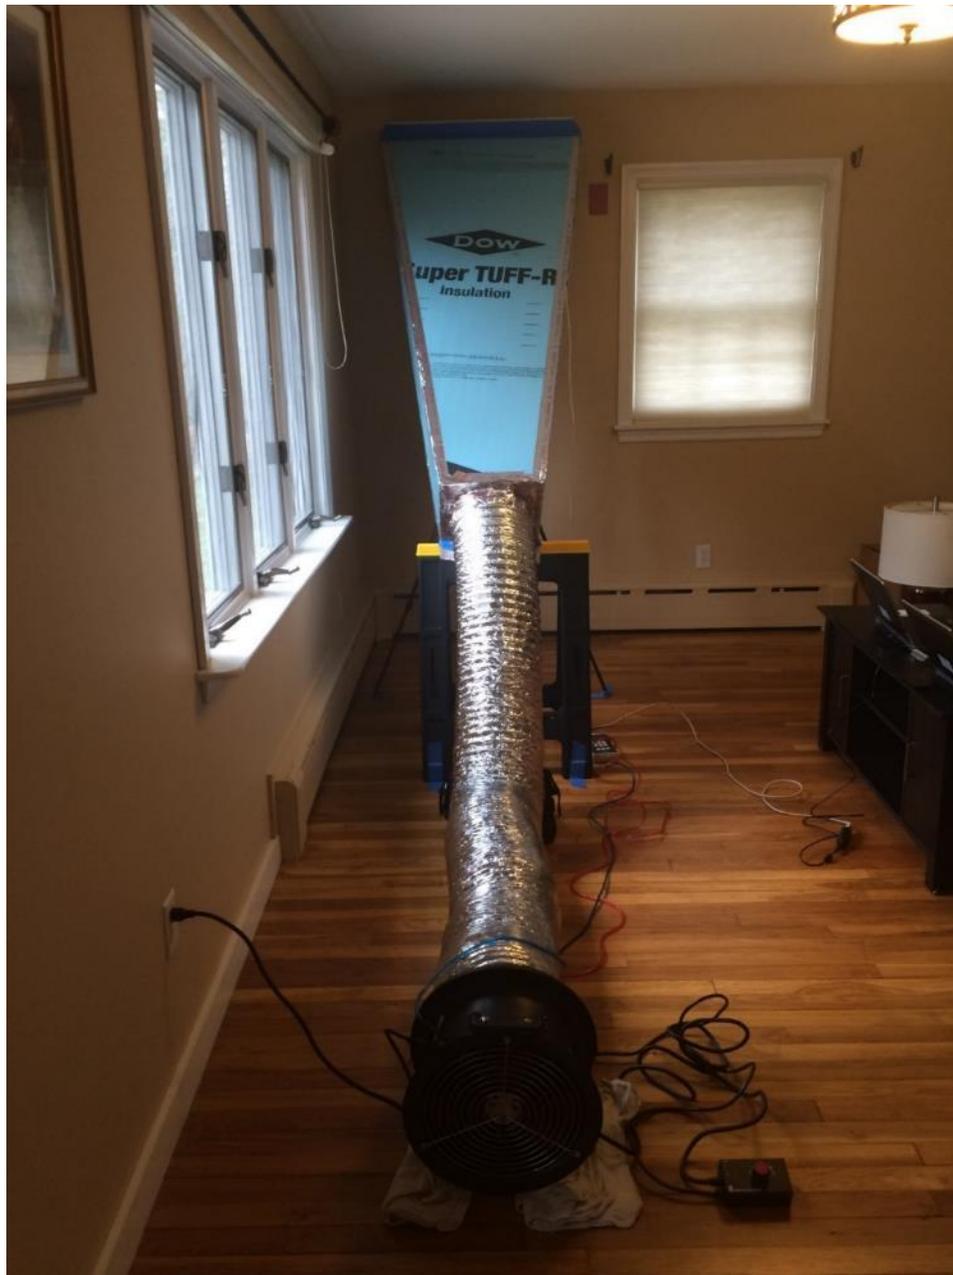

The plenum method faced a significant issue in the space required to run the test. Most DMSHP indoor heads average 32 inches in width, requiring only the single, six-foot-long section for testing. Larger units, however, could be as wide as 46 inches, requiring the nozzle to be extended up to 11 feet. Figure 90 shows the 11-foot nozzle being installed in a participant's home. To transport the nozzle to the home and through the home to the indoor head's location required fabricating the nozzle extension separately. The setup shown required 21 feet of open space from the wall, not including the eight feet required after the Duct Blaster outlet. As noted, many homes do not have an appropriate floor plan to accommodate such a setup.

**Figure 90. Extended Testing Site B: Large-Unit Powered Flow Hood**



### Measuring Airflow: Field Methods

Because a powered flow hood was not prove feasible for most sites, and the data alignment between the non-powered flow hood and the powered flow hood was high, the evaluation team used the non-powered Alnor/TSI EBT731 across the entire population to build up a robust airflow data sample as a function of the indoor head current.

Field staff began work by clearing an area near the DMSHP head of furniture and picture frames that could be damaged in the course of testing, as shown in Figure 91.

Figure 91. Indoor Head Prior to Testing



Field staff then set the vertical louvers to a midrange value and aligned the flow hood in the same direction as the louvers. Adopted throughout the study, this arrangement mitigated impacts from eddy currents and prevented units from swaying the louvers and introducing another analysis variable. Field staff supported the balometer in this position, taping it to the support stand. These staff decreased movement of the support stand using additional tape between the stand and the floor. Figure 92 shows the resulting positioning.

Although the balometer used an onboard battery, field staff nevertheless plugged the balometer's charger into the nearest wall outlet to reduce any variation induced by battery voltage. The evaluation team adopted this as a precaution, given an unsuccessful search for literature that stating the results were a function of battery voltage.

Figure 92. Non-Powered Flow Hood (Balometer) Setup



After setting up the balometer positioning, the field staff sealed any visible, potential leakage routes, as shown in Figure 93. Williamson 2015 identifies a slight potential for leakage via the seam of the filter flap, leading directly to the return air space. The evaluation team did not consider this leakage pathway significant as the filter flap mated to the main housing with very little bypass space when properly closed. Williamson 2015 also tested this pathway and did not find differences in return static pressure with or without the return pathway taped, effectively stating this return pathway proved negligible within system performance.

Prior to testing, the field team confirmed the sealing was adequate, both through a visual inspection and through observations when the unit ran at full power.

The body of this report provides additional descriptions of this testing in the Data Collection: Airflow section.

Figure 93. Non-Powered Flow Hood (Balometer) Setup




### Conditional Variations

In addition to testing the sampled population for airflow as a function of the indoor head current, the evaluation team conducted isolated testing of different factors that might influence an indoor head's current. These factors included the position of louvers or vanes, accumulated condensation on the indoor head, and imposed airflow restrictions to simulate mimicked filter cleanliness.

### Vane Position

During the study, the team conducted testing on the influence of vane positions to determine the elasticity of subtle variations in positioning the flow hood with respect to the reference direction. Figure 94 illustrates the influence of the vane's position on the recorded airflow volume using the powered flow hood. Per the figure, vane positions from the center to the most horizontal closely agree with one another.

Figure 94. Vane Position: Powered Flow Hood

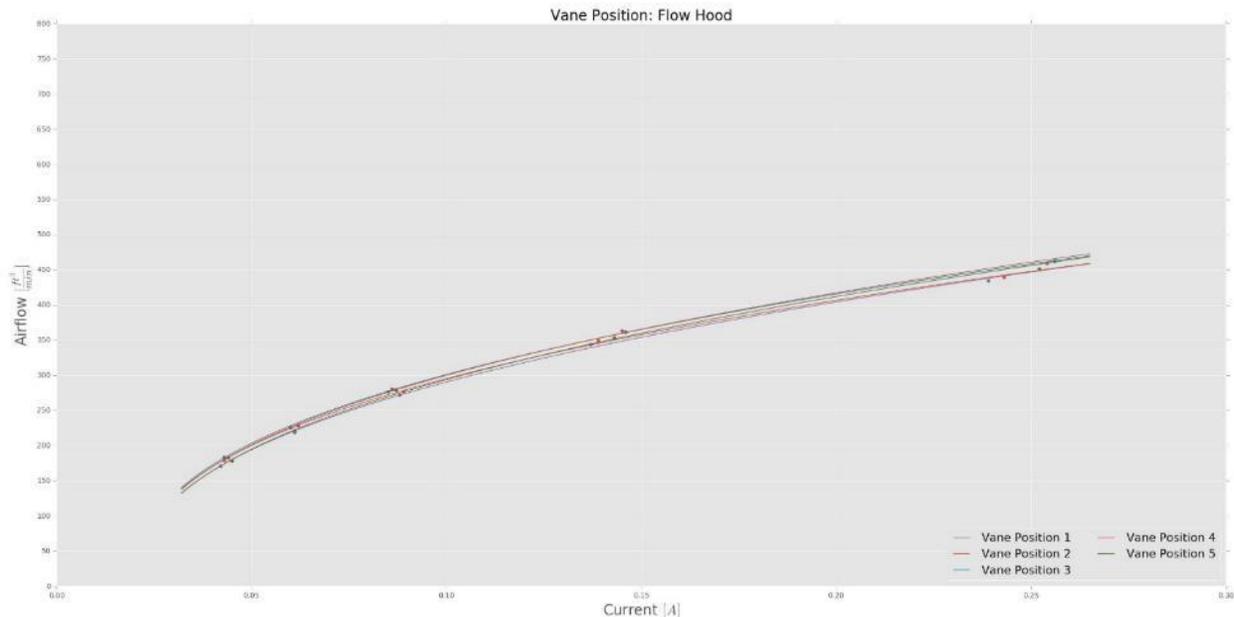


### Coil Moisture

Technical submittals from DMSHP manufacturers show changes in the volumetric airflow rate when coils are wet from accumulated moisture (previously in the air). In effect, water droplets on the indoor coil restrict airflow much as restricting airflow over filters. In testing this, field staff carefully poured more than a gallon of water onto the coils of a DMSHP indoor unit. Utilizing the powered flow hood, the team ran the unit through the same tests conducted as a baseline. These tests produced wet state and dry state data points, respectively. Performing this test across the entire sample would have been impractical, given the effort required to keep control electronics dry while wetting the coil.

As shown in Figure 95, although airflow and current values differed greatly between wet and dry, data points merely serve as migrations along the fan curve as opposed to shifts to the curve itself. Consequently, data adjustments based on perceived coil wetness need not be conducted; the indoor head current serves as a good proxy for volumetric airflow.

Figure 95. Coil State: Wet vs. Dry

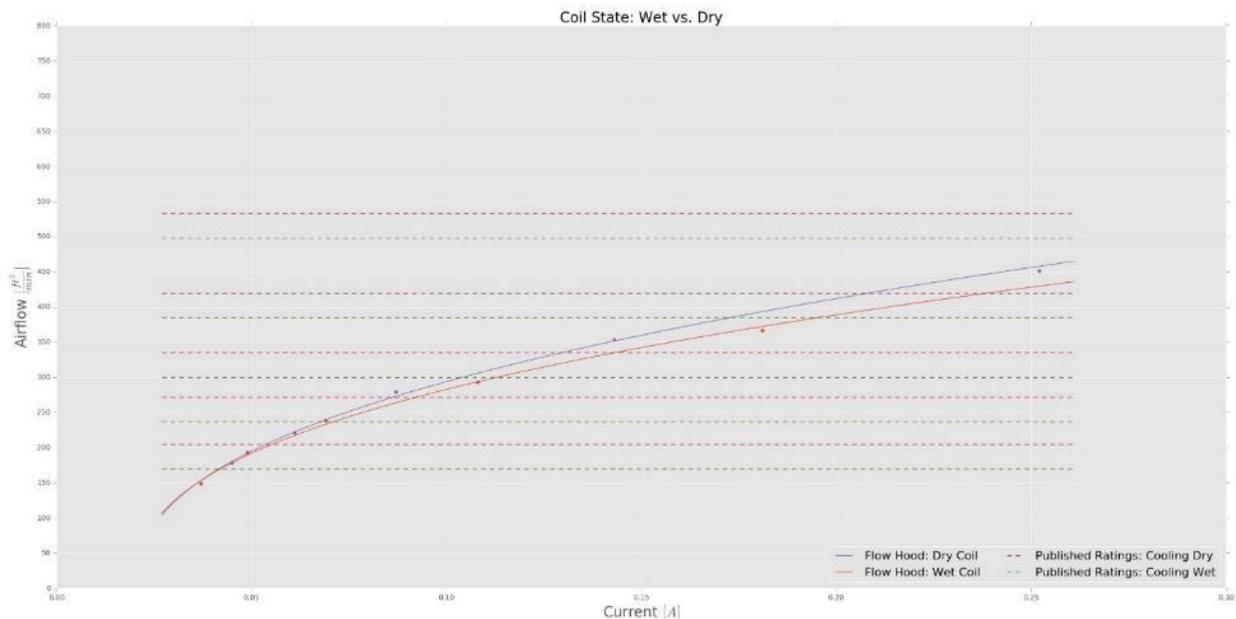


### Flow Restriction (Dirty Filter)

In using an indoor unit, a filter removes dust from the air, though this accumulates if not cleaned regularly. As the filter accumulates dust and particles, the pressure drops across the filter increases, and airflow is reduced. In a test setup, the evaluation team used foam inserts to simulate dirty filters. Figure 96 shows the impact of restricting airflow to the DMSHP—the equivalent of a very dirty filter.

Similar to restrictions induced by wet and dry coils, restrictions induced by obstruction caused decreases in the airflow quantity moved through the indoor unit. And, much like wet and dry coil results, when accounting for the indoor fan current, changes were primarily migrations along the curve and not major shifts of the fan curve itself. As seen in the figure, the vertical shift at a given fan amperage from the averaged curve (dotted line) to the simulated dirty curve was less than 5%. Therefore, the team judged that no data adjustments were needed to produce an airflow number within reasonable bounds, based solely on current supplied to the fan.

**Figure 96. Powered Flow Hood Flow Restriction**

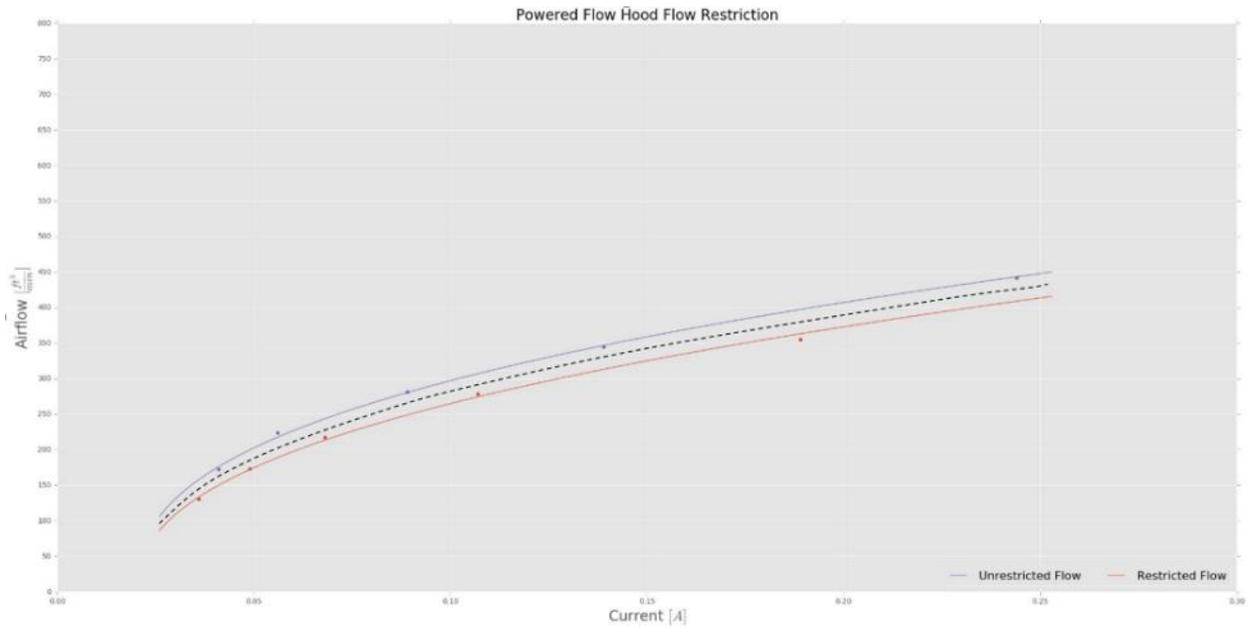


### Resulting Experimental Design

Given the findings, the evaluation team chose to measure airflow using the methodology discussed in earlier sections of this report.

## Appendix B: Baseline Memorandum Chart

Logic Flow Chart to Determine Baseline, with Response Percentages (n = 116)

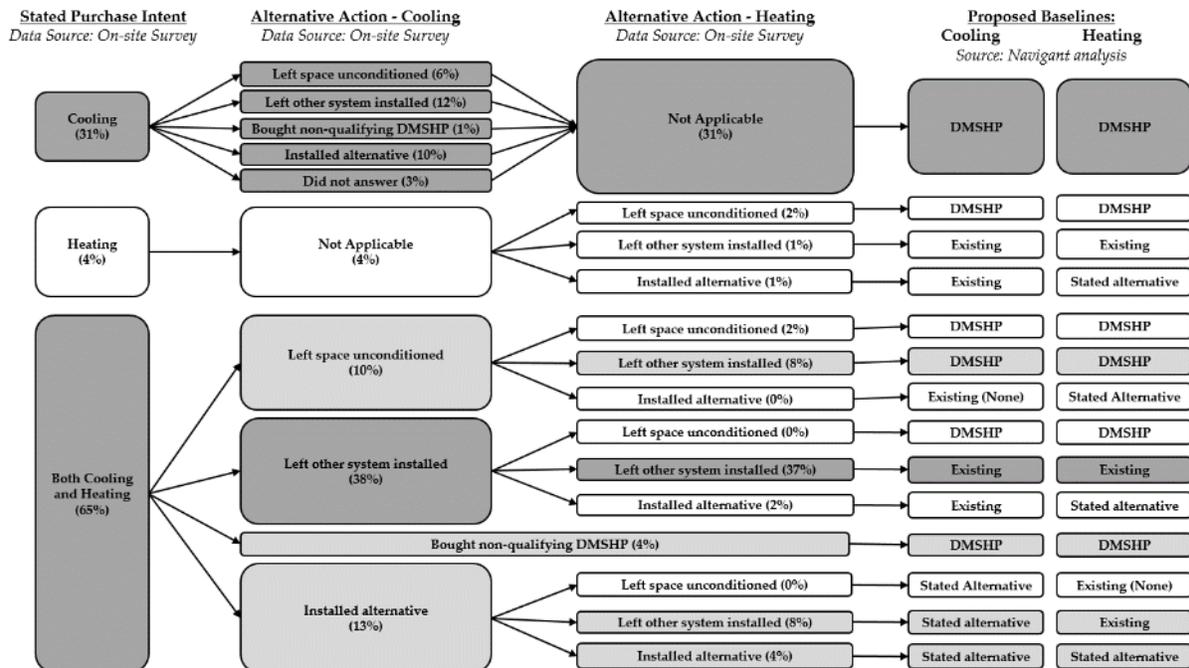

## Appendix C: TRM Memorandum, December 2, 2016

To: Massachusetts and Rhode Island Program Administrators  
 From: COOL SMART Impact Evaluation Team  
 Subject: Ductless Mini-Split Heat Pump Technical Reference Manual Recommendation  
 Date: December 2, 2016

This memo serves as a supplement to the forthcoming Ductless Mini-Split Heat Pump Impact Evaluation report prepared for the Massachusetts and Rhode Island Electric and Gas Program Administrators. It discusses the methods and assumptions employed by the Massachusetts Technical Reference Manual (TRM), from program years 2016-2018, for calculating energy and demand savings resulting from residential installations of ENERGY STAR® rated ductless mini-split heat pumps (DMSHPs). Provided the insights gained during the writing of the evaluation report, the basis of these TRM assumptions are reviewed, and updated inputs and methods are recommended for future use.

### Measure History

The residential installation of an ENERGY STAR® rated DMSHP is categorized as a lost opportunity, HVAC measure and specifically described as “The installation of a more efficient [DMSHP] system.” The significance of being “more efficient” is in reference to the assumed baseline equipment of a minimally efficient DMSHP, as determined by the Federal Register. Deemed energy and demand savings are calculated from the following sets of equations:

$$\Delta kWh_{HP} = Tons \times \frac{12 \text{ kBtu/hr}}{Ton} \left[ \left( \frac{1}{SEER_{BASE}} - \frac{1}{SEER_{EE}} \right) \times Hours_C + \left( \frac{1}{HSPF_{BASE}} - \frac{1}{HSPF_{EE}} \right) \times Hours_H \right]$$

$$\Delta kW_{COOL} = Tons \times \frac{12 \text{ kBtu/hr}}{Ton} \times \left( \frac{1}{EER_{BASE}} - \frac{1}{EER_{EE}} \right)$$

$$\Delta kW_{HEAT} = Tons \times \frac{12 \text{ kBtu/hr}}{Ton} \times \left( \frac{1}{HSPF_{BASE}} - \frac{1}{HSPF_{EE}} \right)$$

With quantities:

$\Delta kWh_{HP}$  = Reduction in annual kWh consumption of HP equipment

$\Delta kW_{COOL}$  = Summer reduction in electric demand of HP equipment

$\Delta kW_{HEAT}$  = Winter reduction in electric demand of HP equipment

$Tons$  = Capacity of HP equipment

$SEER_{BASE}$  = Seasonal efficiency of baseline HP equipment

$SEER_{EE}$  = Seasonal efficiency of new efficient HP equipment

$EER_{BASE}$  = Peak efficiency of base HP equipment

$EER_{EE}$  = Peak efficiency of new efficient HP equipment

$HSPF_{BASE}$  = Heating efficiency of baseline HP equipment

$HSPF_{EE}$  = Heating efficiency of new HP equipment

$Hours_C$  = EFLH for cooling

$Hours_H$  = EFLH for heating

Several assumptions are involved in these calculations, including 447 equivalent full load hours (EFLH) for heating; 360 EFLH for cooling; and a baseline SEER, EER, and HSPF of 14, 10, and 8.2, respectively. A TRM table provides various cases of high efficiency SEERs, EERs, and HSPFs and their resulting energy and demand savings; these inputs and savings are replicated in for reference, drawing on past and current TRM values.

**Table 1. Savings for Residential DMSHPs**

Year	$SEER_{EE}$	$EER_{EE}$	$HSPF_{EE}$	$\Delta kW_{COOL}$	$\Delta kW_{HEAT}$	$\Delta kWh_{HP}$
2013, 2014	14.5	12.0	8.2	0.250	0.119	186
2013, 2014	19	12.83	10.0	0.331	0.448	669
2013, 2014	23	13	10.6	0.346	0.533	820
2015	14.5	12.0	8.2	0.515	0.000	13
2015	19	12.83	10.0	0.596	0.329	497
2015	23	13	10.6	0.611	0.414	648
2016	20.5	13.3	9.9	0.11	0.34	286
2016	24.2	13.8	12	0.11	0.45	330

## Recommendations

The assumed EFLH for cooling were greater than the same values calculated during the evaluation, as shown in Table 2. The EFLH for heating were cited from a Cadmus memo providing initial results from the DMSHP evaluation, and are in agreement with the final values reported in the study. The average of the top 25% of EFLH are also included in .

**Table 2. Heating and Cooling Equivalent Full Load Hours for DMSHP**

Season	MA TRM EFLH	Measured EFLH	Top 25% of Measured EFLH
Winter 2015	447	442	1,275
Summer 2015	360	218	499
Winter 2016	447	451	1,117

As part of the study, a second winter of on-site metering was included, and so two sets of measured heating EFLH values are presented above. One reason for this extension was the concern that the unusually high amount of snowfall in 2015 would prevent the outdoor unit of the DMSHP from operating at normal capacity, and result in lower EFLH. Although the measured EFLH from the two winters are within

three percent of each other, the evaluation team recommends using the 2016 value as the data used in its calculation were collected under less extreme conditions. The assumed heating EFLH vary slightly from the final values reported in the evaluation; these differences resulted from refining the weather normalization method used by the evaluation team. The assumed cooling EFLH are higher than the reported values, but the added context of where this assumption was drawn from is important. The 360 EFLH for cooling were cited from an evaluation of central air conditioners, which the evaluation team expects to operate more continuously than DMSHP systems. Given these findings, it is recommended the TRM update the EFLH to 451 hours for heating and 218 hours for cooling.

The primary discrepancy between the current TRM methodology and that presented in this memo is the determination of an appropriate baseline for calculating savings. The evaluation team found homeowners frequently install DMSHP to displace existing HVAC systems or in lieu of some alternative; because of this behavior, assuming all baseline systems are minimally efficient DMSHPs will fail to accurately predict savings in many situations. Table 3 3 presents a concise set of baselines that were observed during this study.

**Table 3. Recommended DMSHP Baselines**

Season	Baseline Equipment	Assumed Baseline Efficiency*	Assumed Baseline Efficiency for TRM Algorithm
Cooling	Ductless Heat Pump	14 SEER, 10 EER	14 SEER, 10 EER
	Central Air Conditioner	13 SEER, 11 EER	13 SEER, 11 EER
	Window Air Conditioner	9.8 EER	14.5 SEER**, 9.8 EER
Heating	Ductless Heat Pump	8.2 HSPF	8.2 HSPF
	Boiler	0.82 AFUE	2.8 HSPF
	Furnace	0.9 AFUE	2.6 HSPF***
	Electric Resistance	1.0 COP	3.4 HSPF

\*Massachusetts Technical Reference Manual for Estimating Savings from Energy Efficiency Measures. Tech. Massachusetts Electric and Gas Energy Efficiency Program Administrators, Oct. 2015. Web. Dec. 2016. < <http://ma-eeac.org/wordpress/wp-content/uploads/2016-2018-Plan-1.pdf> >.


\*\*Because manufacturers do not report seasonal efficiencies for window air conditioning units, we have applied a scalar conversion factor derived from mean ratios between DHP EERs and SEERs values reported by AHRI. Acknowledging that window air conditioners generally do not have self-regulating, variable speed motors like DHPs, which can contribute to lower seasonal efficiencies, we have averaged only DHP systems from the bottom half of the calculated ratios.

\*\*\*Seasonal efficiency value includes an assumed 15% duct leakage, based on the MA PY 2016-2018 TRM duct sealing measure.

There are many nuanced arguments surrounding exactly how a DMSHP baseline should be determined, and for further discussion see the Baseline Memo, but for the purposes of a TRM algorithm the evaluation team recommends a simple approach based on the equipment present in the home, and in the absence of any coincident HVAC system, using a minimally efficient DMSHP baseline. By identifying a site specific Assumed Baseline Seasonal Efficiency from Table 3, savings can be calculated from the sets of equations currently presented in the TRM.

As a final recommendation, the evaluation team suggests that the actual SEER, EER, and HSPF ratings of the newly installed DMSHP systems reported to and tracked by the PAs are used in the high efficiency scenario of savings calculations. This change in the TRM methodology would acknowledge the wide range of ratings available to consumers and the increasing seasonal efficiencies, and provide more refined estimates of energy and demand reduction. Updating the residential, new installation DMSHP TRM algorithm with the recommendations presented in this memo will result in a more current, program specific, and data-based methodology that is informed through extended study of this measure.

Appendix D: Example DMSHP Time Series Data

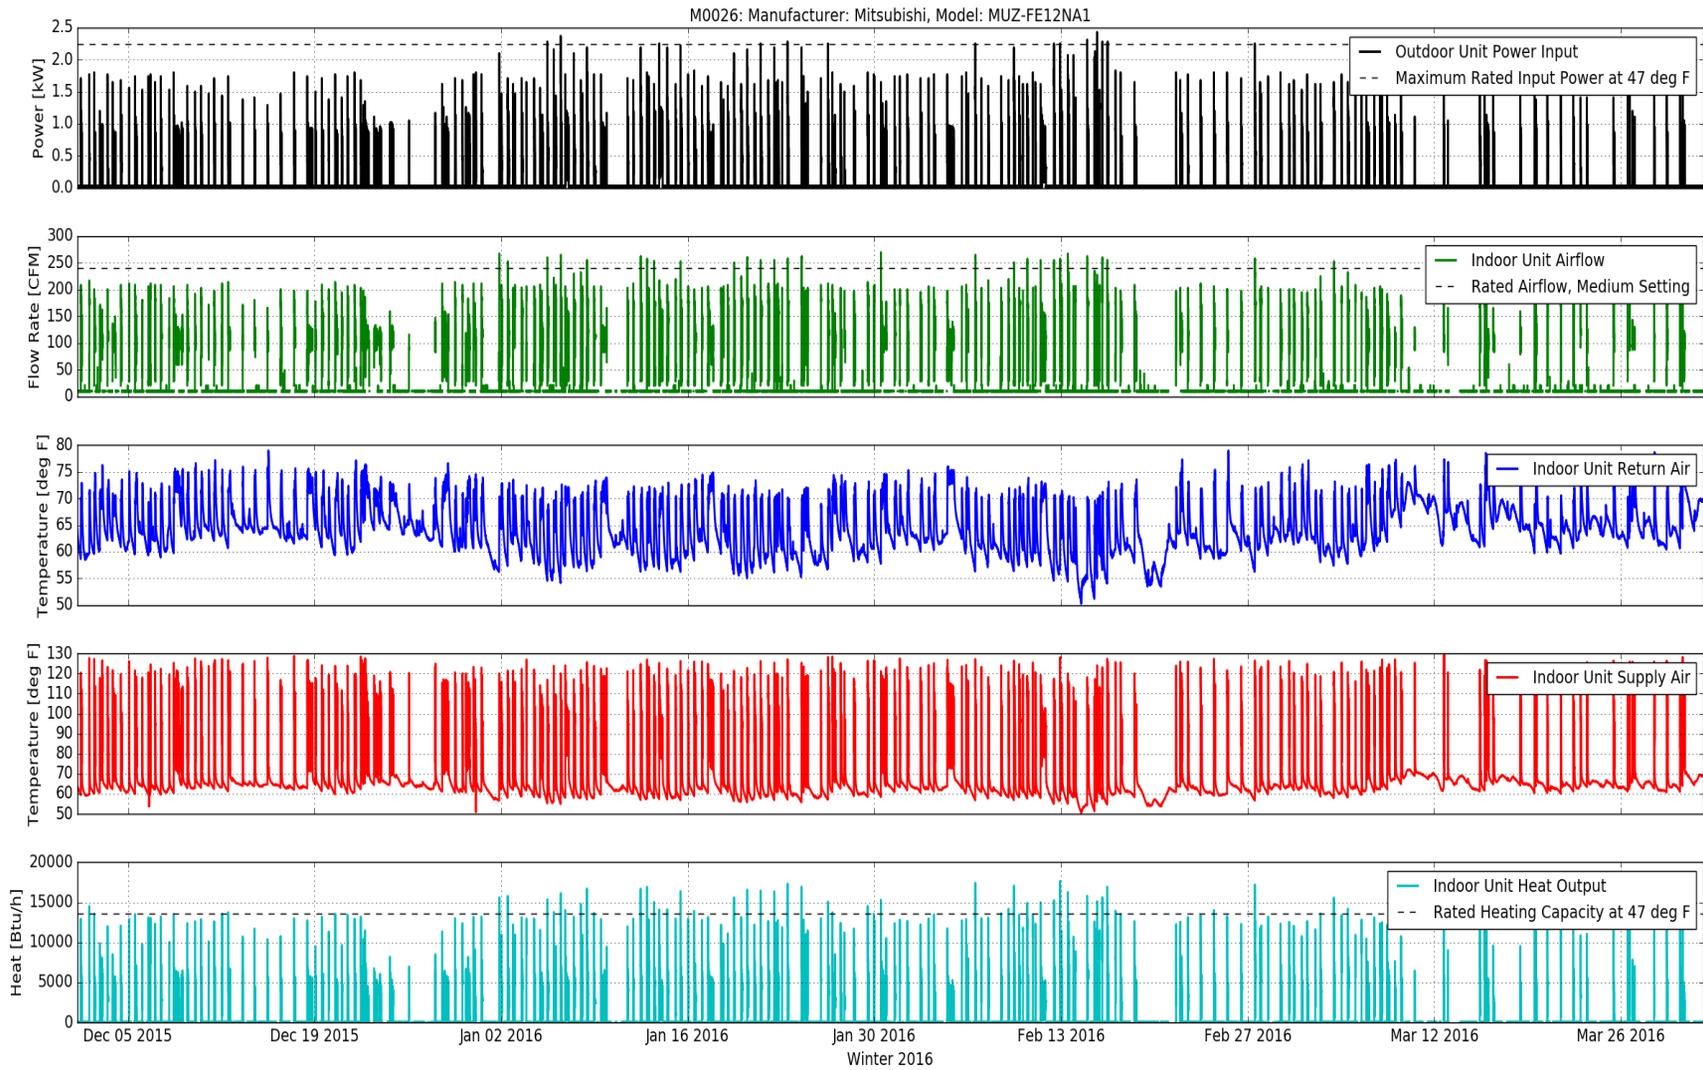

M0026: Manufacturer: Mitsubishi, Model: MUZ-FE12NA1

